




**ALLEN & MAJOR  
ASSOCIATES, INC.**

# DRAINAGE REPORT

Skyview Estates  
Leicester, MA

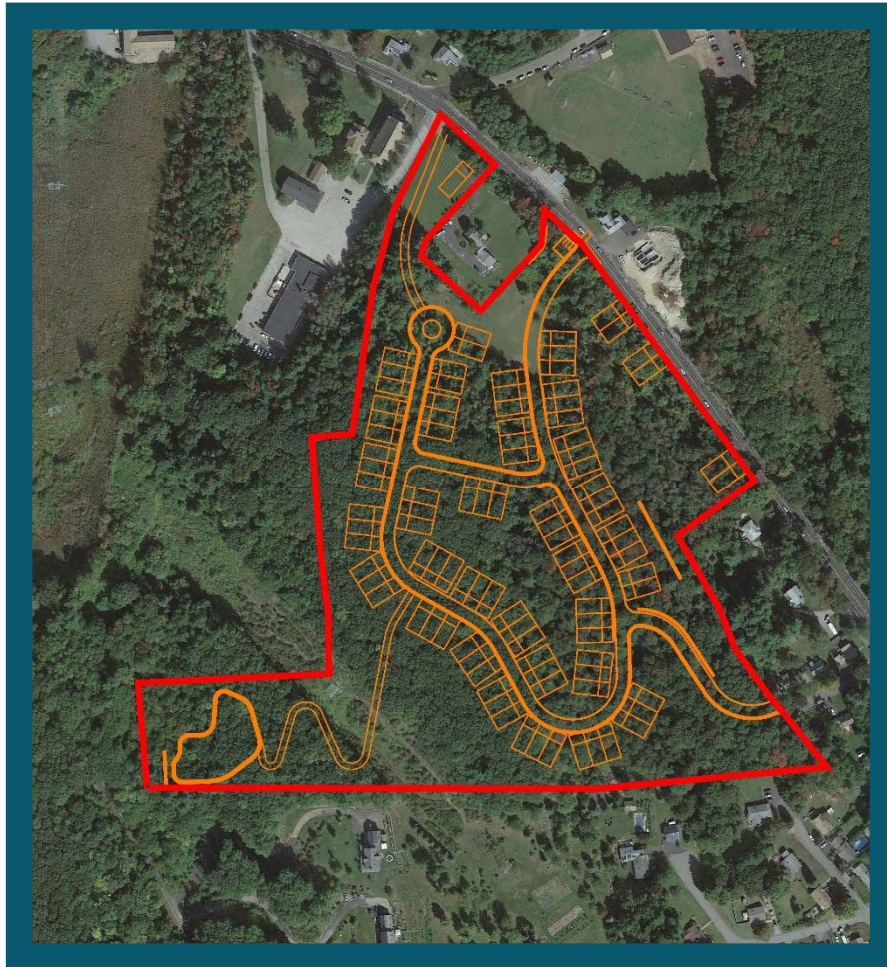

**APPLICANT:**

MKEP 770 LLC  
265 Sunrise Highway, Suite 1368  
Rockville Center, NY 11570

**PREPARED BY:**

Allen & Major Associates, Inc.  
100 Commerce Way, Suite 5  
Woburn, Massachusetts 01801






## **DRAINAGE REPORT**

Skyview Estates  
Leicester, Massachusetts

### **APPLICANT:**

MKEP 770 LCC  
265 Sunrise Highway, Suite 1368  
Rockville Center, NY 11570

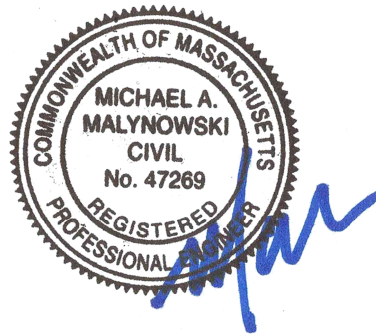

### **PREPARED BY:**

Allen & Major Associates, Inc.  
100 Commerce Way, Suite 5  
Woburn, Massachusetts 01801

### **REVISED:**

12-14-2021

### **ISSUED:**

07-16-2021

### **A&M PROJECT NO.:**

2889-01







## TABLE OF CONTENTS

<b>SECTION 1.0 - DRAINAGE REPORT .....</b>	<b>5</b>
Introduction.....	6
Site Categorization for Stormwater Regulations.....	6
Site Location and Access .....	6
Existing Site Conditions .....	6
Existing Soil Conditions .....	7
FEMA Floodplain/Environmental Due Diligence .....	8
Environmentally Sensitive Zones .....	8
Drainage Analysis Methodology .....	8
Proposed Conditions – Peak Rate of Runoff.....	8
MASSDEP Stormwater Performance Standards .....	11
MASSDEP Stormwater Checklist.....	16
<b>SECTION 2.0 - OPERATION &amp; MAINTENANCE PLAN .....</b>	<b>17</b>
Introduction.....	18
Notification Procedures for Change of Responsibility for O&M .....	18
Contact Information .....	19
Demolition & Construction Maintenance Plan.....	19
Long-Term Pollution Prevention Plan.....	20
Long-Term Maintenance Plan – Facilities Description .....	25
Inspection and Maintenance Frequency and Corrective Measures .....	27
Supplemental Information .....	28
<b>SECTION 3.0 - EXHIBITS.....</b>	<b>29</b>
USGS Site Locus Map .....	30
Aerial Photo.....	31
FEMA Flood Insurance Rate Map .....	32
NHESP Map .....	33
MASSDEP Wetlands Map .....	34

**SECTION 4.0 - EXISTING DRAINAGE ANALYSIS.....35**

Existing HydroCAD ..... 36

Existing Watershed Plan ..... 37

**SECTION 5.0 - PROPOSED DRAINAGE ANALYSIS .....38**

Proposed HydroCAD ..... 39

Proposed Watershed Plan ..... 40

**SECTION 6.0 - APPENDIX.....41**

Rainfall Data ..... 42

Manning’s Number Tables ..... 43

Soils Map ..... 44

Water Quality Flow Calculations..... 45

WQU Sizing ..... 46

Stormwater Pipe Sizing Calculation ..... 47

MADEP Calculations ..... 48



## SECTION 1.0 - DRAINAGE REPORT





## **Introduction**

The purpose of this drainage report is to provide an overview of the proposed stormwater management system (SMS) for the Skyview Estates site plan located at 651 Main Street in Leicester. The report will show by means of narrative, calculations and exhibits that the proposed stormwater management system will meet or exceed the Massachusetts Department of Environmental Protection (MassDEP) stormwater standards, and the Town of Leicester Stormwater Management Regulations.

The proposed site improvements include the construction of a neighborhood style residential development. The development will consist of two family town homes situated along a curvilinear roadway network. The entire development will remain private under the control of an established home owner association.

The proposed SMS incorporates structural and non-structural Best Management Practices (BMPs) to provide stormwater peak flow mitigation, quality treatment, and conveyance. The SMS includes catch basins, drain manholes, proprietary separators, subsurface detention systems, and gabion wall systems.

## **Site Categorization for Stormwater Regulations**

The proposed site improvements at 651 Main Street are considered a new development under the DEP Stormwater Management Standards due to the net increase in impervious area. A new development project is required to meet the all of Stormwater Management Standards listed within the MA DEP Stormwater Handbook.

## **Site Location and Access**

The site is a single lot (21-B5.1) that is proposed to be subdivided into 5 lots. Each of the proposed lots which front Main Street contains the minimum 100 feet of frontage. The remaining lot will be further developed into a residential development. The parcel is located along Main Street (Route 9) approximately 0.2 miles south of Waite Pond.

The parcel is abutted by the Residential 1 zone to the southeast and Suburban-Agricultural zone to the southwest. St. Josephs Church and Leicester Early Learning Center abut the parcel to the west while residential homes abut the parcel to the east and south.

The site is accessed to the southeast by an existing curb cut for Colonial Drive as well as to the north by a proposed curb cut on Main Street. The proposed private roadway network will be connected by these curb cuts to provide adequate traffic flow and safe travel throughout the site.

## **Existing Site Conditions**

The site currently includes unused land that is occupied by trees and various wetland pockets. There is an existing electrical tower and 250' easement that is located through the southwest portion of the site. Various stone walls, concrete walls, and a concrete



foundation were also found by an on the ground survey performed by A&M. The site topography ranges from elevation 815 in the southwest corner of the parcel to 948 in the southern-central portion of the site.

The surface drainage flows were analyzed at five Study Points. Study Point #1 summarizes off-site flows generated from the northeast portion of the parcel. This area flows to existing drainage infrastructure located within Main Street and discharges to the municipal drainage system. Study Point #2 summarizes off-site flows generated from southeast portion of the site. This area flows to an existing wetland/swale formed along an existing stone wall. Study Point #3 summarizes off-site flows generated from the southwest portion of the parcel. This area flows to an existing wetland that is enclosed by the parcel to the west and Henshaw Street to the east. Study Point #4 summarizes off-site flows generated from the northwest portion of the parcel. Study Point #5 summarizes off-site flows generated from the northern-central portion of the parcel.

### Existing Soil Conditions

The on-site soils were identified using the USDA Natural Resources Conservation Services (NRCS) Soil Survey for Worcester County. The site contains a range of soil types including: Ridgebury, Whitman, Paxton, Woodbridge, Charlton, Canton, and Udorthents. The majority of the site is made up of Paxton fine sandy loam. A copy of the NRCS Custom Soil Resource Report is included in the appendix of this report.

Based upon the NRCS soil report the project site is classified as multiple types of fine sandy loam. The NRCS soil survey classified the onsite soil as the following:

Symbol	Soil Taxonomic Name	Hydrologic Soil Group
70B	Ridgebury, 3-8% slopes	D
71B	Ridgebury (stony), 3-8% slopes	D
73A	Whitman, 0-3% slopes	D
305B	Paxton, 3-8% slopes	C
305C	Paxton, 8-15% slopes	C
305D	Paxton, 15-25% slopes	C
312B	Woodbridge, 0-8% slopes	C/D
407C	Charlton, 8-15% slopes	A
420B	Canton, 3-8% slopes	B
651	Udorthents, smoothed	A



Paxton fine sandy loam has a Hydrologic Soil Group “C” designation which has been used throughout the design. An Infiltration rate for the Paxton fine sandy loam was used for the design being 4.06 micrometers per second, converted to 0.575 inches per hour.

### **FEMA Floodplain/Environmental Due Diligence**

There are no portions of the site located within the FEMA Zone “AE” Special Flood Hazard Area Subject to Inundation by the 1% Annual Chance Flood (100-year floodplain). The official Flood Insurance Rate Map (FIRM) effective date July 4, 2011, map #25027C0782E, panel 782 of 1075. See section 3 of this report for a copy of the FEMA FIRM.

### **Environmentally Sensitive Zones**

The Commonwealth of Massachusetts asserts control over numerous protected and regulated areas including: Areas of Critical Environmental Concern (ACEC); Outstanding Resource Waters (ORWs); Priority and Protected Habitat for rare and endangered species, and areas protected under the Wetlands Protection Act. The subject property is not located within any of these regulated areas.

### **Drainage Analysis Methodology**

A peak rate of runoff will be determined using techniques and data found in the following:

1. Urban Hydrology for Small Watersheds – Technical Release 55 by the United States Department of Agriculture Soils Conservation Service, June 1986. Runoff curve numbers and 24-hour precipitation values were obtained from this reference.
2. HydroCAD © Stormwater Modeling System by HydroCAD Software Solutions LLC, version 10.1-5a. The HydroCAD program was used to generate the runoff hydrographs for the watershed areas, to determine discharge/ stage/storage characteristics for the stormwater BMPs, to perform drainage routing and to combine the results of the runoff hydrographs. HydroCAD uses the TR-20 methodology of the SCS Unit Hydrograph procedure (SCS-UH).

### **Proposed Conditions – Peak Rate of Runoff**

The stormwater runoff analysis of the existing and proposed conditions includes an estimate of the peak rate of runoff from various rainfall events. Peak runoff rates were developed using TR55 Urban Hydrology for Small Watersheds, developed by the U.S. Department of Commerce, Engineering Division and the HydroCAD computer program. Further, the analysis has been prepared in accordance with the MassDEP and the town requirements and standard engineering practices. The peak rate of runoff has been estimated for each watershed during the 2, 10, 25, and 100-year storm events.

The proposed stormwater management system for the site consists of deep sump catch basins, pipe detention systems, a detention basin, outlet control structures, and gabion walls (level spreaders). These systems have been designed in accordance with the MA DEP



Stormwater Management Policy to recharge groundwater and reduce rate of runoff from the parcel.

Detention system 1A and detention system 1B will overflow and discharges through an outlet control structure to an existing catch basin within Main Street (Study Point 1).

Detention system 2A overflows to gabion wall 2, which discharges into an existing wetland/swale at the eastern portion of the site that conveys stormwater to a proposed catch basin that is connected to the existing municipal system (SP-2) within Colonial Drive. Detention system 2B overflows through an outlet control structure that discharges to existing catch basin within the municipal system (SP-2).

Detention system 3 consisting of an extended dry detention basin overflows to gabion wall 2, which discharges to an existing wetland to the west of the site along Henshaw Street (SP-3). Stormwater runoff along the south-western border of the parcel will flow to the proposed Detention Basin which overflows to the existing wetland (SP- 3).

There are no proposed stormwater management systems used for on-site flows directed to Study Points 4 & 5. However, the rate of runoff to these points has been mitigated from the existing to proposed conditions.

The stormwater runoff model indicates that the proposed site development reduces the rate of runoff during all storm events at the identified points of analysis. The following tables provide a summary of the estimated peak rate, in Cubic Feet per Second (CFS) and total runoff volume, in cubic-feet (CF) at each of the five (5) Study Points for each of the design storm events. The HydroCAD worksheets are included in Section 4 and 5 of this report.

<b>STUDY POINT #1</b> (Existing Catch Basin 1)				
	2-Year	10-Year	25-Year	100-Year
Existing Flow (CFS)	3.95	10.15	15.72	28.02
Proposed Flow (CFS)	3.95	10.12	15.02	28.79
<b>Change (CFS)</b>	<b>0.00</b>	<b>-0.03</b>	<b>-0.70</b>	<b>0.77</b>
Existing Volume (AF)	0.439	1.014	1.537	2.714
Proposed Volume (AF)	0.639	1.382	2.012	3.370
<b>Change (AF)</b>	<b>0.200</b>	<b>0.368</b>	<b>0.475</b>	<b>0.656</b>





<b>STUDY POINT #2</b> (Existing Catch Basin 2)				
	2-Year	10-Year	25-Year	100-Year
Existing Flow (CFS)	2.81	8.34	13.67	25.99
Proposed Flow (CFS)	2.32	6.69	10.55	25.06
<b>Change (CFS)</b>	<b>-0.49</b>	<b>-1.65</b>	<b>-3.12</b>	<b>-0.93</b>
Existing Volume (AF)	0.738	1.682	2.534	4.447
Proposed Volume (AF)	1.090	2.251	3.220	5.288
<b>Change (AF)</b>	<b>0.352</b>	<b>0.569</b>	<b>0.686</b>	<b>0.841</b>

<b>STUDY POINT #3</b> (Existing Wetland East)				
	2-Year	10-Year	25-Year	100-Year
Existing Flow (CFS)	3.94	10.91	17.41	32.17
Proposed Flow (CFS)	3.23	10.26	13.52	25.86
<b>Change (CFS)</b>	<b>-0.71</b>	<b>-0.65</b>	<b>-3.89</b>	<b>-6.31</b>
Existing Volume (AF)	0.644	1.482	2.243	3.954
Proposed Volume (AF)	1.009	2.196	3.209	5.399
<b>Change (AF)</b>	<b>0.365</b>	<b>0.714</b>	<b>0.966</b>	<b>1.445</b>

<b>STUDY POINT #4</b> (Existing Wetland West)				
	2-Year	10-Year	25-Year	100-Year
Existing Flow (CFS)	1.57	3.91	5.98	10.55
Proposed Flow (CFS)	0.81	1.76	2.56	4.27
<b>Change (CFS)</b>	<b>-0.76</b>	<b>-2.15</b>	<b>-3.42</b>	<b>-6.28</b>
Existing Volume (AF)	0.144	0.329	0.495	0.869
Proposed Volume (AF)	0.061	0.128	0.186	0.312
<b>Change (AF)</b>	<b>-0.083</b>	<b>-0.201</b>	<b>-0.309</b>	<b>-0.557</b>

<b>STUDY POINT #5</b> (Off-Site)				
	2-Year	10-Year	25-Year	100-Year
Existing Flow (CFS)	0.46	1.12	1.70	2.98
Proposed Flow (CFS)	0.17	0.39	0.58	0.98
<b>Change (CFS)</b>	<b>-0.29</b>	<b>-0.73</b>	<b>-1.12</b>	<b>-2.00</b>
Existing Volume (AF)	0.050	0.112	0.168	0.292
Proposed Volume (AF)	0.013	0.028	0.042	0.072
<b>Change (AF)</b>	<b>-0.037</b>	<b>-0.084</b>	<b>-0.126</b>	<b>-0.220</b>



<b>TOTAL</b>				
	2-Year	10-Year	25-Year	100-Year
Existing Flow (CFS)	7.22	19.61	31.09	56.99
Proposed Flow (CFS)	6.44	17.20	26.15	54.83
<b>Change (CFS)</b>	<b>-0.78</b>	<b>-2.41</b>	<b>-4.94</b>	<b>-2.16</b>
Existing Volume (AF)	1.227	2.808	4.239	7.453
Proposed Volume (AF)	1.742	3.661	5.274	8.730
<b>Change (AF)</b>	<b>0.515</b>	<b>0.853</b>	<b>1.035</b>	<b>1.277</b>

### **MASSDEP Stormwater Performance Standards**

The MA DEP Stormwater Management Policy was developed to improve water quality by implementing performance standards for stormwater management. The intent is to implement the stormwater management standards through the review of Notice of Intent filings by the issuing authority (Conservation Commission or DEP). The following section outlines how the proposed Stormwater Management System meets the standards set forth by the Policy.

BMP's implemented in the design include:

- Deep Sump Catch Basins
- Proprietary Separators (CDS units)
- Detention Systems (Precast Concrete Chambers & Basin)
- Level Spreaders (Gabion Wall)
- Outlet Control Structures

Stormwater Best Management Practices (BMP's) have been incorporated into the design of the project to mitigate the anticipated pollutant loading. An Operations and Maintenance Plan has been developed for the project, which addresses the long-term maintenance requirements of the proposed system.

Temporary erosion and sedimentation controls will be incorporated into the construction phase of the project. These temporary controls may include straw bale and/or silt fence barriers, inlet sediment traps, slope stabilization, and stabilized construction entrances.

The Massachusetts Department of Environmental Protection has established ten (10) Stormwater Management Standards. A project that meets or exceeds the standards is presumed to satisfy the regulatory requirements regarding stormwater management. The Standards are enumerated below as well as descriptions and supporting calculations as to how the Project will comply with the Standards:

1. *No new stormwater conveyances (e.g. outfalls) may discharge untreated stormwater directly to or cause erosion in wetlands or waters of the Commonwealth.*



The proposed development will not introduce any new outfalls with direct discharge to a wetland area or waters of the Commonwealth of Massachusetts. The rate of discharges to existing wetlands will not be increased in comparison to the existing conditions (See Proposed Conditions Tables).

2. *Stormwater management systems shall be designed so that post-development peak discharge rates do not exceed pre-development peak discharge rates. This Standard may be waived for discharges to land subject to coastal storm flowage as defined in 310 CMR 10.04.*

The proposed development has been designed so that the post-development peak discharge rates do not exceed the predevelopment peak discharge rates. A summary of the existing and proposed discharge rates is included within this document (See Proposed Conditions Tables).

3. *Loss of annual recharge to groundwater shall be eliminated or minimized through the use of infiltration measures including environmentally sensitive site design, low impact development techniques, stormwater best management practices, and good operation and maintenance. At a minimum, the annual recharge from the post-development site shall approximate the annual recharge from pre-development conditions based on soil type. This Standard is met when the stormwater management system is designed to infiltrate the required recharge volume as determined in accordance with the Massachusetts Stormwater Handbook.*

The existing annual recharge for the site has been approximated in the proposed condition. There are proposed dry wells that are designed to meet this requirement. The proposed Recharge Volume is based on the Static Method per the MA DEP Stormwater Management Standards, Volume 3, Chapter 1.

See the appendix located at section 6 of this report for stormwater recharge calculations.

4. *Stormwater management systems shall be designed to remove 80% of the average annual post-construction load of Total Suspended Solids (TSS). This standard is met when:*
  - *Suitable practices for source control and pollution prevention are identified in a long-term pollution prevention plan, and thereafter are implemented and maintained;*
  - *Structural stormwater best management practices are sized to capture the required water quality volume determined in accordance with the Massachusetts Stormwater Handbook; and*



- *Pretreatment is provided in accordance with the Massachusetts Stormwater Handbook.*

Standard #4 is met when structural stormwater best management practices are sized to capture and treat the required water quality volume and pretreatment is provided in accordance with the Massachusetts Stormwater Handbook. Standard #4 also requires that suitable source control measures are identified in the Long-term Pollution Prevention Plan. The water quality volume for the proposed development is captured and treated using street sweeping, deep sump catch basins, and proprietary separators (CDS units).

The implemented BMPs have been designed to treat the contributing water quality volume. These water quality calculations can be seen within the appendix of this report.

The proposed stormwater management system has been designed to remove 80% of the average annual post-construction load for each treatment train. The TSS removal calculations can be seen within the appendix of this report.

5. *For land uses with higher potential pollutant loads, source control and pollution prevention shall be implemented in accordance with the Massachusetts Stormwater Handbook to eliminate or reduce the discharge of stormwater runoff from such land uses to the maximum extent practicable. If through source control and/or pollution prevention all land uses with higher potential pollutant loads cannot be completely protected from exposure to rain, snow, snow melt, and stormwater runoff, the proponent shall use the specific structural stormwater BMPs determined by the Department to be suitable for such uses as provided in the Massachusetts Stormwater Handbook. Stormwater discharges from land uses with higher potential pollutant loads shall also comply with the requirements of the Massachusetts Clean Waters Act, M.G.L. c. 21, §§ 26-53 and the regulations promulgated thereunder at 314 CMR 3.00, 314 CMR 4.00 and 314 CMR 5.00.*

The site is considered a source of higher potential pollutant loads because it has a proposed roadway, driveways, and vehicle travel daily. Pretreatment and Source reduction is provided to the maximum extent practicable. The drainage system will be designed to treat 1" water quality volume utilizing BMPs listed in Table LUHPPL, within the Massachusetts Stormwater Handbook, Volume 1: Overview of the Massachusetts Stormwater Standards, Chapter 1, Page 14. This requirement only applies to stormwater discharges that come into contact with the actual area or activity on the site that may generate the higher potential pollutant load.



6. *Stormwater discharges within the Zone II or Interim Wellhead Protection Area of a public water supply, and stormwater discharges near or to any other critical area, require the use of the specific source control and pollution prevention measures and the specific structural stormwater best management practices determined by the Department to be suitable for managing discharges to such areas, as provided in the Massachusetts Stormwater Handbook. A discharge is near a critical area if there is a strong likelihood of a significant impact occurring to said area, taking into account site-specific factors. Stormwater discharges to Outstanding Resource Waters and Special Resource Waters shall be removed and set back from the receiving water or wetland and receive the highest and best practical method of treatment. A "storm water discharge" as defined in 314 CMR 3.04(2)(a)1 or (b) to an Outstanding Resource Water or Special Resource Water shall comply with 314 CMR 3.00 and 314 CMR 4.00. Stormwater discharges to a Zone I or Zone A are prohibited unless essential to the operation of a public water supply.*

The project site does not discharge stormwater within a Zone II or Interim Wellhead Protection Area or near a critical area. Critical Areas are Outstanding Resource Waters as designated in 314 CMR 4.00, Special Resource Waters as designated in 314 CMR 4.00, recharge areas for public water supplies as defined in 310 CMR 22.02, bathing beaches as defined in 105 CMR 445.000, cold-water fisheries as defined in 314 CMR 9.02 and 310 CMR 10.04, and shellfish growing areas as defined in 314 CMR 9.02 and 310 CMR 10.04.

7. *A redevelopment project is required to meet the following Stormwater Management Standards only to the maximum extent practicable: Standard 2, Standard 3, and the pretreatment and structural best management practice requirements of Standards 4, 5, and 6. Existing stormwater discharges shall comply with Standard 1 only to the maximum extent practicable. A redevelopment project shall also comply with all other requirements of the Stormwater Management Standards and improve existing conditions.*

The proposed project is not considered a re-development project under the Stormwater Management Handbook guidelines as there is an increase in the amount of impervious area.

8. *A plan to control construction-related impacts including erosion, sedimentation and other pollutant sources during construction and land disturbance activities (construction period erosion, sedimentation, and pollution prevention plan) shall be developed and implemented.*



A plan to control construction-related impacts, including erosion, sedimentation and other pollutant sources during construction has been developed. A detailed Erosion and Sedimentation Control Plan is included in the Permit Drawings. The proponent will prepare and submit a Stormwater Pollution Prevention Plan (SWPPP) prior to commencement of construction activities that will result in the disturbance of one acre of land or more.

9. *A long-term operation and maintenance plan shall be developed and implemented to ensure that stormwater management systems function as designed.*

A Long-Term Operation & Maintenance (O&M) Plan has been developed for the proposed stormwater management system and is included within this document. See Section 2.0 of this report.

10. *All illicit discharges to the stormwater management system are prohibited.*

There are no expected illicit discharges to the stormwater management system. The applicant will submit the Illicit Discharge Compliance Statement prior to the discharge of stormwater runoff to the post-construction stormwater best management practices and prior to the issuance of a Certificate of Compliance.

See the next page for the MassDEP Stormwater Checklist.



## **MASSDEP Stormwater Checklist**



# Checklist for Stormwater Report

## A. Introduction

**Important:** When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A Stormwater Report must be submitted with the Notice of Intent permit application to document compliance with the Stormwater Management Standards. The following checklist is NOT a substitute for the Stormwater Report (which should provide more substantive and detailed information) but is offered here as a tool to help the applicant organize their Stormwater Management documentation for their Report and for the reviewer to assess this information in a consistent format. As noted in the Checklist, the Stormwater Report must contain the engineering computations and supporting information set forth in Volume 3 of the [Massachusetts Stormwater Handbook](#). The Stormwater Report must be prepared and certified by a Registered Professional Engineer (RPE) licensed in the Commonwealth.

The Stormwater Report must include:

- The Stormwater Checklist completed and stamped by a Registered Professional Engineer (see page 2) that certifies that the Stormwater Report contains all required submittals.<sup>1</sup> This Checklist is to be used as the cover for the completed Stormwater Report.
- Applicant/Project Name
- Project Address
- Name of Firm and Registered Professional Engineer that prepared the Report
- Long-Term Pollution Prevention Plan required by Standards 4-6
- Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan required by Standard 8<sup>2</sup>
- Operation and Maintenance Plan required by Standard 9

In addition to all plans and supporting information, the Stormwater Report must include a brief narrative describing stormwater management practices, including environmentally sensitive site design and LID techniques, along with a diagram depicting runoff through the proposed BMP treatment train. Plans are required to show existing and proposed conditions, identify all wetland resource areas, NRCS soil types, critical areas, Land Uses with Higher Potential Pollutant Loads (LUHPPL), and any areas on the site where infiltration rate is greater than 2.4 inches per hour. The Plans shall identify the drainage areas for both existing and proposed conditions at a scale that enables verification of supporting calculations.

As noted in the Checklist, the Stormwater Management Report shall document compliance with each of the Stormwater Management Standards as provided in the Massachusetts Stormwater Handbook. The soils evaluation and calculations shall be done using the methodologies set forth in Volume 3 of the Massachusetts Stormwater Handbook.

To ensure that the Stormwater Report is complete, applicants are required to fill in the Stormwater Report Checklist by checking the box to indicate that the specified information has been included in the Stormwater Report. If any of the information specified in the checklist has not been submitted, the applicant must provide an explanation. The completed Stormwater Report Checklist and Certification must be submitted with the Stormwater Report.

<sup>1</sup> The Stormwater Report may also include the Illicit Discharge Compliance Statement required by Standard 10. If not included in the Stormwater Report, the Illicit Discharge Compliance Statement must be submitted prior to the discharge of stormwater runoff to the post-construction best management practices.

<sup>2</sup> For some complex projects, it may not be possible to include the Construction Period Erosion and Sedimentation Control Plan in the Stormwater Report. In that event, the issuing authority has the discretion to issue an Order of Conditions that approves the project and includes a condition requiring the proponent to submit the Construction Period Erosion and Sedimentation Control Plan before commencing any land disturbance activity on the site.





# Checklist for Stormwater Report

---

## B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.

*Note:* Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.


A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.

---

### Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature

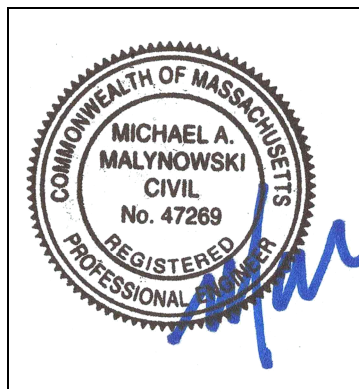

*Michael A. Malynowski*  
Signature and Date

---

## Checklist

**Project Type:** Is the application for new development, redevelopment, or a mix of new and redevelopment?

- ☒ New development
- ☐ Redevelopment
- ☐ Mix of New Development and Redevelopment



# Checklist for Stormwater Report

---

## Checklist (continued)

**LID Measures:** Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- ☒ No disturbance to any Wetland Resource Areas
- ☒ Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- ☐ Reduced Impervious Area (Redevelopment Only)
- ☐ Minimizing disturbance to existing trees and shrubs
- ☐ LID Site Design Credit Requested:
  - ☐ Credit 1
  - ☐ Credit 2
  - ☐ Credit 3
- ☐ Use of “country drainage” versus curb and gutter conveyance and pipe
- ☐ Bioretention Cells (includes Rain Gardens)
- ☐ Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- ☐ Treebox Filter
- ☐ Water Quality Swale
- ☐ Grass Channel
- ☐ Green Roof
- ☐ Other (describe): \_\_\_\_\_

### Standard 1: No New Untreated Discharges

- ☒ No new untreated discharges
- ☒ Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- ☒ Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 2: Peak Rate Attenuation

- ☐ Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.
- ☐ Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.
- ☒ Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

### Standard 3: Recharge

- ☒ Soil Analysis provided.
- ☒ Required Recharge Volume calculation provided.
- ☐ Required Recharge volume reduced through use of the LID site Design Credits.
- ☒ Sizing the infiltration, BMPs is based on the following method: Check the method used.
  - ☒ Static
  - ☐ Simple Dynamic
  - ☐ Dynamic Field<sup>1</sup>
- ☐ Runoff from all impervious areas at the site discharging to the infiltration BMP.
- ☐ Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.
- ☒ Recharge BMPs have been sized to infiltrate the Required Recharge Volume.
- ☐ Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:
  - ☐ Site is comprised solely of C and D soils and/or bedrock at the land surface
  - ☐ M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
  - ☐ Solid Waste Landfill pursuant to 310 CMR 19.000
  - ☐ Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.
- ☒ Calculations showing that the infiltration BMPs will drain in 72 hours are provided.
- ☐ Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

---

<sup>1</sup> 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 3: Recharge (continued)

- ☐ The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.
- ☐ Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

### Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
  - Provisions for storing materials and waste products inside or under cover;
  - Vehicle washing controls;
  - Requirements for routine inspections and maintenance of stormwater BMPs;
  - Spill prevention and response plans;
  - Provisions for maintenance of lawns, gardens, and other landscaped areas;
  - Requirements for storage and use of fertilizers, herbicides, and pesticides;
  - Pet waste management provisions;
  - Provisions for operation and management of septic systems;
  - Provisions for solid waste management;
  - Snow disposal and plowing plans relative to Wetland Resource Areas;
  - Winter Road Salt and/or Sand Use and Storage restrictions;
  - Street sweeping schedules;
  - Provisions for prevention of illicit discharges to the stormwater management system;
  - Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
  - Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
  - List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.
- ☐ A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.
  - ☐ Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:
    - ☐ is within the Zone II or Interim Wellhead Protection Area
    - ☐ is near or to other critical areas
    - ☐ is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
    - ☐ involves runoff from land uses with higher potential pollutant loads.
  - ☐ The Required Water Quality Volume is reduced through use of the LID site Design Credits.
  - ☒ Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 4: Water Quality (continued)

- ☐ The BMP is sized (and calculations provided) based on:
  - ☒ The ½" or 1" Water Quality Volume or
  - ☒ The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.
- ☒ The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the propriety BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.
- ☐ A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

### Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

- ☐ The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.
- ☐ The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted **prior to** the discharge of stormwater to the post-construction stormwater BMPs.
- ☐ The NPDES Multi-Sector General Permit does **not** cover the land use.
- ☒ LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.
- ☐ All exposure has been eliminated.
- ☐ All exposure has **not** been eliminated and all BMPs selected are on MassDEP LUHPPL list.
- ☐ The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

### Standard 6: Critical Areas

- ☐ The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.
- ☐ Critical areas and BMPs are identified in the Stormwater Report.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

- ☐ The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:
  - ☐ Limited Project
  - ☐ Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
  - ☐ Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
  - ☐ Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
  - ☐ Bike Path and/or Foot Path
  - ☐ Redevelopment Project
  - ☐ Redevelopment portion of mix of new and redevelopment.
- ☐ Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.
- ☐ The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

### Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
  - Construction Period Operation and Maintenance Plan;
  - Names of Persons or Entity Responsible for Plan Compliance;
  - Construction Period Pollution Prevention Measures;
  - Erosion and Sedimentation Control Plan Drawings;
  - Detail drawings and specifications for erosion control BMPs, including sizing calculations;
  - Vegetation Planning;
  - Site Development Plan;
  - Construction Sequencing Plan;
  - Sequencing of Erosion and Sedimentation Controls;
  - Operation and Maintenance of Erosion and Sedimentation Controls;
  - Inspection Schedule;
  - Maintenance Schedule;
  - Inspection and Maintenance Log Form.
- ☒ A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

- ☐ The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has **not** been included in the Stormwater Report but will be submitted **before** land disturbance begins.
- ☒ The project is **not** covered by a NPDES Construction General Permit.
- ☐ The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.
- ☐ The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

### Standard 9: Operation and Maintenance Plan

- ☒ The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:
  - ☒ Name of the stormwater management system owners;
  - ☒ Party responsible for operation and maintenance;
  - ☒ Schedule for implementation of routine and non-routine maintenance tasks;
  - ☒ Plan showing the location of all stormwater BMPs maintenance access areas;
  - ☒ Description and delineation of public safety features;
  - ☒ Estimated operation and maintenance budget; and
  - ☒ Operation and Maintenance Log Form.
- ☐ The responsible party is **not** the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:
  - ☐ A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
  - ☐ A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

### Standard 10: Prohibition of Illicit Discharges

- ☐ The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;
- ☐ An Illicit Discharge Compliance Statement is attached;
- ☒ NO Illicit Discharge Compliance Statement is attached but will be submitted **prior to** the discharge of any stormwater to post-construction BMPs.







## **SECTION 2.0 - OPERATION & MAINTENANCE PLAN**





## **Introduction**

In accordance with the standards set forth by the Stormwater Management Policy issued by the Massachusetts Department of Environmental Protection (MassDEP), Allen & Major Associates, Inc. has prepared the following Operations & Maintenance (O&M) Plan for the existing development at 651 Main Street, Leicester, MA.

The plan is broken down into three major sections. The first section describes construction-related erosion and sedimentation controls (Demolition & Construction Maintenance Plan). The second section describes the long-term pollution prevention measures (Long Term Pollution Prevention Plan). The third section is a post-construction operation and maintenance plan designed to address the long-term maintenance needs of the stormwater management system (Long-Term Maintenance Plan – Facilities Description).

## **Notification Procedures for Change of Responsibility for O&M**

The Stormwater Management System (SMS) for this project is owned by MKEP 770 LLC (owner). The owner shall be legally responsible for the long-term operation and maintenance of this SMS as outlined in this Operation and Maintenance Plan.

The owner shall submit an annual summary report and the completed Operation & Maintenance Schedule & Checklist to the Conservation Commission (via email or print copy), highlighting inspection and maintenance activities including performances of BMPs. Should ownership of the SMS change, the owner will continue to be responsible until the succeeding owner shall notify the Commission that the succeeding owner has assumed such responsibility. Upon subsequent transfers, the responsibility shall continue to be that of transferring owner until the transferee owner notifies the Commission of its assumption of responsibility.

In the event the SMS will serve multiple lots/owners, such as the subdivision of the existing parcel or creation of lease areas, the owner(s) shall establish an association or other legally enforceable arrangements under which the association or a single party shall have legal responsibility for the operation and maintenance of the entire SMS. The legal instrument creating such responsibility shall be recorded with the Registry of Deeds and promptly following its recording, a copy thereof shall be furnished to the Commission.



## Contact Information

Stormwater Management System Owner: MKEP 770 LLC  
265 Sunrise Highway, Suite 1368  
Leicester, MA  
Phone: (646) 483-2517

## Emergency Contact Information:

MKEP 770 LLC	Phone: (646) 483-2517
(Owner/Operator)	
Allen & Major Associates, Inc.	Phone: (781) 935-6889
(Site Civil Engineer)	
Leicester Development & Inspectional Services	Phone: (508) 892-7007
Leicester Fire Department	Phone: (508) 892-7022
(non-emergency line)	
MassDEP Emergency Response	Phone: (888) 304-1133
Clean Harbors Inc (24-Hour Line)	Phone: (800) 645-8265

## Demolition & Construction Maintenance Plan

1. Call Digsafe: 1-888-344-7233
2. Contact the Town of Leicester at least three (3) days prior to start of demolition and/or construction activities.
3. Install Erosion Control measures as shown on the Plans prepared by A&M. The Town shall review the installation of straw bales and silt fencing prior to the start of any site demolition work. Install Construction fencing if determined to be necessary at the commencement of construction.
4. Install construction entrances, straw bales, and silt fence at the locations shown on the Erosion Control Plan prepared by A&M.
5. Site access shall be achieved only from the designated construction entrances.
6. Cut and clear trees in construction areas only (within the limit of work; see plans).
7. Stockpiles of materials subject to erosion shall be stabilized with erosion control matting or temporary seeding whenever practicable, but in no case more than 14 days after the construction activity in that portion of the site has temporarily or permanently ceased.
8. Install silt sacks and straw bales around each drain inlet prior to any demolition and or construction activities.



9. All erosion control measures shall be inspected weekly and after every rainfall event. Records of these inspections shall be kept on-site for review.
10. All erosion control measures shall be maintained, repaired, or replaced as required or at the direction of the owner's engineer or the Town.
11. Sediment accumulation up-gradient of the straw bales, silt fence, and stone check dams greater than 6" in depth shall be removed and disposed of in accordance with all applicable regulations.
12. If it appears that sediment is exiting the site, silt sacks shall be installed in all catch basins adjacent to the site. Sediment accumulation on all adjacent catch basin inlets shall be removed and the silt sack replaced if torn or damaged.
13. Install stone check dams on-site during construction as needed. Refer to the erosion control details. Temporary sediment basins combined with stone check dams shall be installed on-site during construction to control and collect runoff from upland areas of this site during demolition and construction activities.
14. The contractor shall comply with the Sedimentation and Erosion Control Notes as shown on the Site Development Plans and Specifications.
15. The stabilized construction entrances shall be inspected weekly and records of inspections kept. The entrances shall be maintained by adding additional clean, angular, durable stone to remove the soil from the construction vehicle's tires when exiting the site. If soil is still leaving the site via the construction vehicle tires, adjacent roadways shall be kept clean by street sweeping.
16. Dust pollution shall be controlled using on-site water trucks and/or an approved soil stabilization product.
17. During demolition and construction activities, Status Reports on compliance with this O&M Document shall be submitted weekly. The report shall document any deficiencies and corrective actions taken by the applicant.

### **Long-Term Pollution Prevention Plan**

Standard #4 from the MassDEP Stormwater Management Handbook requires that a Long-Term Pollution Prevention Plan (LTPPP) be prepared and incorporated as part of the Operation and Maintenance Plan of the Stormwater Management System. The purpose of the LTPPP is to identify potential sources of pollution that may affect the quality of stormwater discharges, and to describe the implementation of practices to reduce the pollutants in stormwater discharges. The following items describe the source control and proper procedures of the LTPPP.



- Housekeeping

The existing development has been designed to maintain a high level of water quality treatment for all stormwater discharge to the wetland areas. An Operation and Maintenance (O&M) plan has been prepared and is included in this section of the report. The owner (or its designee) is responsible for adherence to the O&M plan in a strict and complete manner.

- Storing of Materials & Water Products

The trash and waste program for the site includes exterior dumpsters. There is a trash contractor used to pick up the waste material in the dumpsters. The stormwater drainage system has water quality inlets designed to capture trash and debris.

- Vehicle Washing

Outdoor vehicle washing has the potential to result in high loads of nutrients, metals, and hydrocarbons during dry weather conditions, as the detergent-rich water used to wash the grime off the vehicle enters the stormwater drainage system. The existing development does not include any designated vehicle washing areas, nor is it expected that any vehicle washing will take place on-site.

- Spill Prevention & Response

Sources of potential spill hazards include vehicle fluids, liquid fuels, pesticides, paints, solvents, and liquid cleaning products. The majority of the spill hazards would likely occur within the buildings and would not enter the stormwater drainage system. However, there are spill hazards from vehicle fluids or liquid fuels located outside of the buildings. These exterior spill hazards have the potential to enter the stormwater drainage system and are to be addressed as follows:

1. Spill hazards of pesticides, paints, and solvents shall be remediated using the Manufacturers' recommended spill cleanup protocol.
2. Vehicle fluids and liquid fuel spill shall be remediated according to the local and state regulations governing fuel spills.
3. The owner shall have the following equipment and materials on hand to address a spill clean-up: brooms, dust pans, mops, rags, gloves, absorptive material, sand, sawdust, plastic and metal trash containers.
4. All spills shall be cleaned up immediately after discovery.
5. Spills of toxic or hazardous material shall be reported, regardless of size, to the Massachusetts Department of Environmental Protection at (888) 304-1333.



6. Should a spill occur, the pollution prevention plan will be adjusted to include measures to prevent another spill of a similar nature. A description of the spill, along with the causes and cleanup measures will be included in the updated pollution prevention plan.

- Maintenance of Lawns, Gardens, and Other Landscaped Areas

It should be recognized that this is a general guideline towards achieving high quality and well-groomed landscaped areas. The grounds staff/landscape contractor must recognize the shortcomings of a general maintenance plan such as this, and modify and/or augment it based on weekly, monthly, and yearly observations. In order to assure the highest quality conditions, the staff must also recognize and appreciate the need to be aware of the constantly changing conditions of the landscaping and be able to respond to them on a proactive basis. No trees shall be planted over the drain lines or recharge area, and that only shallow rooted plants and shrubs will be allowed.

- Fertilizer

Maintenance practices should be aimed at reducing environmental, mechanical and pest stresses to promote healthy and vigorous growth. When necessary, pest outbreaks should be treated with the most sensitive control measure available. Synthetic chemical controls should be used only as a last resort to organic and biological control methods. Fertilizer, synthetic chemical controls and pest management applications (when necessary) shall be performed only by licensed applicators in accordance with the manufacturer's label instructions when environmental conditions are conducive to controlled product application.

Only slow-release organic fertilizers should be used in the planting and mulch areas to limit the amount of nutrients that could enter downstream resource areas. Fertilization of the planting and mulch areas will be performed within manufacturers labeling instructions and shall not exceed an NPK ration of 1:1:1 (i.e. Triple 10 fertilizer mix), considered a low nitrogen mixture. Fertilizers approved for the use under this O&M Plan are as follows:

Type:	LESCO® 28-0-12 (Lawn Fertilizer)
	MERIT® 0.2 Plus Turf Fertilizer
	MOMENTUM™ Force Weed & Feed

- Suggested Aeration Program

In-season aeration of lawn areas is good cultural practice, and is recommended whenever feasible. It should be accomplished with a solid thin tine aeration method to reduce disruption to the use of the area. The



depth of solid tine aeration is similar to core type, but should be performed when the soil is somewhat drier for a greater overall effect.

Depending on the intensity of use, it can be expected that all landscaped lawn areas will need aeration to reduce compaction at least once per year. The first operation should occur in late May following the spring season. Methods of reducing compaction will vary based on the nature of the compaction. Compaction on newly established landscaped areas is generally limited to the top 2-3" and can be alleviated using hollow core or thin tine aeration methods.

The spring aeration should consist of two passes at opposite directions with 1/4" hollow core tines penetrating 3-5" into the soil profile. Aeration should occur when the soil is moist but not saturated. The soil cores should be shattered in place and dragged or swept back into the turf to control thatch. If desired the cores may also be removed and the area top-dressed with sand or sandy loam. If the area drains on average too slowly, the topdressing should contain a higher percentage of sand. If it is draining on average too quickly, the top dressing should contain a higher percentage of soil and organic matter.

○ Landscape Maintenance Program Practices:

▪ Lawn

1. Mow a minimum of once a week in spring, to a height of 2" to 2 1/2" high. Mowing should be frequent enough so that no more than 1/3 of grass blade is removed at each mowing. The top growth supports the roots; the shorter the grass is cut, the less the roots will grow. Short cutting also dries out the soil and encourages weeds to germinate.
2. Mow approximately once every two weeks from July 1<sup>st</sup> to August 15<sup>th</sup> depending on lawn growth.
3. Mow on a ten-day cycle in fall, when growth is stimulated by cooler nights and increased moisture.
4. Do not remove grass clippings after mowing.
5. Keep mower blades sharp to prevent ragged cuts on grass leaves, which cause a brownish appearance and increase the chance for disease to enter a leaf.

▪ Shrubs

1. Mulch not more than 3" depth with shredded pine or fir bark.





2. Hand prune annually, immediately after blooming, to remove 1/3 of the above-ground biomass (older stems). Stem removals are to occur within 6" of the ground to open up shrub and maintain two-year wood (the blooming wood).
3. Hand-prune evergreen shrubs only as needed to remove dead and damaged wood and to maintain the naturalistic form of the shrub. Never mechanically shear evergreen shrubs.

- Trees

1. Provide aftercare of new tree plantings for the first three years.
2. Do not fertilize trees, it artificially stimulates them (unless tree health warrants).
3. Water once a week for the first year; twice a month for the second; once a month for the third year.
4. Prune trees on a four-year cycle.

- Invasive Species

1. Inform the Conservation Commission Agent prior to the removal of invasive species proposed either through hand work or through chemical removal.

- Storage and Use of Herbicides and Pesticides

Integrated Pest Management is the combination of all methods (of pest control) which may prevent, reduce, suppress, eliminate, or repel an insect population. The main requirements necessary to support any pest population are food, shelter and water, and any upset of the balance of these will assist in controlling a pest population. Scientific pest management is the knowledgeable use of all pest control methods (sanitation, mechanical, chemical) to benefit mankind's health, welfare, comfort, property and food. A Pest Management Professional (PMP) should be retained who is licensed with the Commonwealth of Massachusetts Executive Office of Energy and Environmental Affairs, Department of Agricultural Resources.

The site manager will be provided with approved bulletin before entering into or renewing an agreement to apply pesticides for the control of indoor household or structural pests, refer to 333 CMR 13.08.

Before beginning each application, the applicator must post a Department approved notice on all of the entrances to the treated room or area. The applicator must leave such notices posted after the application. The notice will be posted at conspicuous point(s) of access to the area treated. The location and number of



signs will be determined by the configuration of the area to be treated based on the applicator's best judgment. It is intended to give sufficient notice so that no one comes into an area being treated unaware that the applicator is working and pesticides are being applied. However, if the contracting entity does not want the signs posted, he/she may sign a Department approved waiver indicating this.

The applicator or employer will provide to any person upon their request the following information on previously conducted applications:

1. Name and phone number of pest control company;
  2. Date and time of the application;
  3. Name and license number of the applicator;
  4. Target pests; and
  5. Name and EPA Registration Number of pesticide products applied.
- Pet Waste Management  
The owner's landscape crew (or designee) shall remove any obvious pet waste that has been left behind by pet owners within the development. The pet waste shall be disposed of in accordance with local and state regulations.
  - Operations and Management of Septic Systems  
There are no proposed septic systems within the limits of the project.
  - Management of Deicing Chemicals and Snow  
Snow will be stockpiled on site until the accumulated snow becomes a hazard to the daily operations of the site. It will be the responsibility of the snow removal contractor to properly dispose of transported snow according to MassDEP, Bureau of Resource Protection – Snow Disposal Guideline #BRPG01-01, governing the proper disposal of snow. It will be the responsibility of the snow removal contractor to follow these guidelines and all applicable laws and regulations  
  
The owner's maintenance staff (or its designee) will be responsible for the clearing of the sidewalk and building entrances. The owner may be required to use a de-icing agent such as potassium chloride to maintain a safe walking surface. If used, the de-icing agent for the walkways and building entrances will be kept within the storage rooms located within the building. If used, de-icing agents will not be stored outside. The owner's maintenance staff will limit the application of sand.

### **Long-Term Maintenance Plan – Facilities Description**

A maintenance log will be kept (i.e. report) summarizing inspections, maintenance, and any corrective actions taken. The log will include the date on which each inspection or maintenance task was performed, a description of the inspection findings or maintenance completed, and the name of the inspector or maintenance personnel performing the task. If a maintenance task requires the clean-out of any sediments or debris, the location



where the sediment and debris was disposed after removal will be indicated. The log will be made accessible to department staff and a copy provided to the department upon request.

The following is a description of the Stormwater Management System for the project site.

#### Stormwater Collection System – On-Site:

The stormwater collection system is a series of inlets located at low points within the limits of the paved area. All of the proposed on-site catch basins incorporate a deep sump and hooded outlet. The catch basins are connected by a closed gravity pipe network that pass through proprietary separators prior to entering the pipe detention systems or gabion walls.

Structural Pretreatment BMPs: Regular maintenance of these BMPs is especially critical because they typically receive the highest concentration of suspended solids during the first flush of a storm event.

- **Deep Sump Catch Basin:**  
Deep sump catch basins, also known as oil and grease or hooded catch basins, are underground retention systems designed to remove trash, debris, and coarse sediment from stormwater runoff, and serve as temporary spill containment devices for floatables such as oils and greases.

#### Treatment BMPs:

- **Proprietary Separator:**  
A proprietary separator is a flow-through structure with a settling or separation unit to remove sediments and other pollutants. They typically use the power of swirling or flowing water to separate floatables and coarser sediments, are typically designed and manufactured by private businesses, and come in different sizes to accommodate different design storms and flow conditions.

#### Infiltration BMPs:

- **Dry Well:**  
Dry wells are small excavated pits, backfilled with aggregate, and used to infiltrate uncontaminated runoff from non-metal roofs or metal roofs located outside the Zone II or Interim Wellhead Protection Area of a public water supply and outside an industrial site. Do not use dry wells to infiltrate any runoff that could be significantly contaminated with sediment and other pollutants. Never use dry wells to infiltrate runoff from land uses with higher potential pollutant loads, including parking lot runoff.



#### Other BMPs:

- **Dry Detention Basin**

A dry detention basin is an impoundment or excavated basin for the short-term detention of stormwater runoff from a completed development that allows controlled release from the structure at downstream, pre-development flow rates. Conventional dry detention basins typically control peak runoff for 2-year and 10-year 24-hour storms. They are not specifically designed to provide extended dewatering times, wet pools, or groundwater recharge. Sometimes flows can be controlled using an outlet pipe of the appropriate size but this approach typically cannot control multiple design storms.

#### BMP Accessories:

- **Level Spreader (Gabion Wall):**

A level spreader receives concentrated flow from channels, outlet structures, or other conveyance structures, and converts it to sheet flow where it can disperse uniformly across a stable slope. A level spreader is not a pollutant reduction device. It improves the efficiency of other BMPs, such as vegetated swales, filter strips, or infiltration systems that depend on sheet flow to operate properly.

#### Other Maintenance Activity:

- **Street Sweeping** - Clear accumulations of winter sand in parking lots and along roadways at least once a year, preferably in the spring. Accumulations on pavement may be removed by pavement sweeping. Accumulations of sand along road shoulders may be removed by grading excess sand to the pavement edge and removing it manually or by a front-end loader.

#### **Inspection and Maintenance Frequency and Corrective Measures**

In accordance with MA DEP Stormwater Handbook: Volume 2, Chapter 2; the previously described BMPs will be inspected and the identified deficiencies will be corrected. Clean-out must include the removal and legal disposal of any accumulated sediments, trash, and debris. In any and all cases, operations, inspections, and maintenance activities shall utilize best practical measures to avoid and minimize impacts to wetland resource areas outside the footprint of the SMS.



**Supplemental Information**

- Long-Term Operation & Maintenance (O&M) Plan
- MASSDEP Snow Disposal Regulations
- CDS Maintenance Procedures
- Retain-It Owners Maintenance Manual



## OPERATION AND MAINTENANCE PLAN SCHEDULE

Date: 10-05-2021



Project: 2889-01

Project Address: Skyview Estates, Main Street, Leicester, MA

Responsible for O&M Plan: MKEP 770 LLC

Address: 265 Sunrise Highway, Suite 1368, Rockville Center, NY 11570

Phone: (646) 483-2517

*All information within table is derived from Massachusetts Stormwater Handbook: Volume 2, Chapter 2*

BMP CATEGORY	BMP OR MAINTENANCE ACTIVITY	SCHEDULE/FREQUENCY	NOTES	INSPECTION PERFORMED	
				DATE:	BY:
STRUCTURAL PRETREATMENT BMPs	DEEP SUMP CATCH BASIN	Four times per year (quarterly).	Inspect and clean catch basin units whenever the depth of deposits is greater than or equal to one half the depth from the bottom of the invert of the lowest pipe in the basin.		
	PROPRIETARY SEPARATORS	In accordance with manufacturers requirements, but no less than twice a year following installation and once a year thereafter.	Remove sediment and other trapped pollutants at frequency or level specified by manufacturer.		
INFILTRATION BMPs	DRY WELL	Inspect after every major storm in the first few months following construction. Thereafter, inspect annually.	Inspect dry wells. Measure the water depth in the observation well at 24- and 48-hour intervals after a storm. Calculate clearance rates by dividing the drop in water level (inches) by the time elapsed (hr.).		





## OPERATION AND MAINTENANCE PLAN SCHEDULE

Date: 10-05-2021



Project: 2889-01

Project Address: Skyview Estates, Main Street, Leicester, MA

Responsible for O&M Plan: MKEP 770 LLC

Address: 265 Sunrise Highway, Suite 1368, Rockville Center, NY 11570

Phone: (646) 483-2517

*All information within table is derived from Massachusetts Stormwater Handbook: Volume 2, Chapter 2*

BMP CATEGORY	BMP OR MAINTENANCE ACTIVITY	SCHEDULE/FREQUENCY	NOTES	INSPECTION PERFORMED	
				DATE:	BY:
OTHER BMPs	DRY DETENTION	Inspect basin operation at least once a year and after large storms to determine if the basin is meeting the expected detention times	Inspect detention pipes to ensure they are operating as designed. Check the outlet structures for accumulated sediment, trash, and debris and remove it. Remove sediment from the basin as needed.		
BMP ACCESSORIES	LEVEL SPREADERS	Inspect regularly, especially after large rainfall events.	Inspect level spreaders regularly, especially after large rainfall events. Note and repair any erosion or low spots in the spreader.		
	OUTLET STRUCTURES	Periodic cleaning of Outlet Control Structures as needed.	Clear trash and debris as necessary.		



## OPERATION AND MAINTENANCE PLAN SCHEDULE

Date: 10-05-2021



Project: 2889-01

Project Address: Skyview Estates, Main Street, Leicester, MA

Responsible for O&M Plan: MKEP 770 LLC

Address: 265 Sunrise Highway, Suite 1368, Rockville Center, NY 11570

Phone: (646) 483-2517

*All information within table is derived from Massachusetts Stormwater Handbook: Volume 2, Chapter 2*

BMP CATEGORY	BMP OR MAINTENANCE ACTIVITY	SCHEDULE/ FREQUENCY	NOTES	INSPECTION PERFORMED	
				DATE:	BY:
OTHER MAINTENANCE ACTIVITIES	SNOW STORAGE	Clear and remove snow to approved storage locations as necessary to ensure systems are working properly and are protected from meltwater pollutants.	Carefully select snow disposal sites before winter. Avoid dumping removed snow over catch basins, or in detention ponds, sediment forebays, rivers, wetlands, and flood plains. It is also prohibited to dump snow in the bioretention basins or gravel swales.		
	STREET SWEEPING	Clear accumulations of winter sand in parking lots and along roadways at least once a year, preferably in the spring.	Sweep, power broom or vacuum paved areas. Submit information that confirms that all street sweepings have been completed in accordance with state and local requirements		





Commonwealth of Massachusetts  
Executive Office of Energy & Environmental Affairs

## Department of Environmental Protection

One Winter Street Boston, MA 02108 • 617-292-5500

Charles D. Baker  
Governor

Karyn E. Polito  
Lieutenant Governor

Kathleen A. Theoharides  
Secretary

Martin Suuberg  
Commissioner

# Massachusetts Department of Environmental Protection Bureau of Water Resources Snow Disposal Guidance

**Effective Date:** December 11, 2020

**Applicability:** Applies to all federal, state, regional and local agencies, as well as to private businesses.

**Supersedes:** Bureau of Resource Protection (BRP) Snow Disposal Guideline No. BRPG97-1 issued December 12, 1997 and BRPG01-01 issued March 8, 2001; Bureau of Water Resources (BWR) snow disposal guidance issued December 21, 2015 and December 12, 2018.

**Approved by:** Kathleen Baskin, Assistant Commissioner, Bureau of Water Resources

**PURPOSE:** To provide guidelines to all government agencies and private businesses regarding snow disposal site selection, site preparation and maintenance, and emergency snow disposal options that are protective of wetlands, drinking water, and water bodies, and are acceptable to the Massachusetts Department of Environmental Protection (MassDEP), Bureau of Water Resources.

**APPLICABILITY:** These Guidelines are issued by MassDEP's Bureau of Water Resources on behalf of all Bureau Programs (including Drinking Water Supply, Wetlands and Waterways, Wastewater Management, and Watershed Planning and Permitting). They apply to all federal agencies, state agencies, state authorities, municipal agencies and private businesses disposing of snow in the Commonwealth of Massachusetts.

## INTRODUCTION

Finding a place to dispose of collected snow poses a challenge to municipalities and businesses as they clear roads, parking lots, bridges, and sidewalks. While MassDEP is aware of the threats to public safety caused by snow, collected snow that is contaminated with road salt, sand, litter, and automotive pollutants such as oil also threatens public health and the environment.

As snow melts, road salt, sand, litter, and other pollutants are transported into surface water or through the soil where they may eventually reach the groundwater. Road salt and other pollutants can contaminate water supplies and are toxic to aquatic life at certain levels. Sand washed into

This information is available in alternate format. Contact Michelle Waters-Ekanem, Director of Diversity/Civil Rights at 617-292-5751.

TTY# MassRelay Service 1-800-439-2370

MassDEP Website: [www.mass.gov/dep](http://www.mass.gov/dep)

Printed on Recycled Paper

waterbodies can create sand bars or fill in wetlands and ponds, impacting aquatic life, causing flooding, and affecting our use of these resources.

There are several steps that communities can take to minimize the impacts of snow disposal on public health and the environment. These steps will help communities avoid the costs of a contaminated water supply, degraded waterbodies, and flooding. Everything that occurs on the land has the potential to impact the Commonwealth's water resources. Given the authority of local government over the use of the land, municipal officials and staff have a critically important role to play in protecting our water resources.

The purpose of these guidelines is to help federal agencies, state agencies, state authorities, municipalities and businesses select, prepare, and maintain appropriate snow disposal sites before the snow begins to accumulate through the winter. Following these guidelines and obtaining the necessary approvals may also help municipalities in cases when seeking reimbursement for snow disposal costs from the Federal Emergency Management Agency is possible.

## **RECOMMENDED GUIDELINES**

These snow disposal guidelines address: (1) site selection; (2) site preparation and maintenance; and (3) emergency snow disposal.

### **1. SITE SELECTION**

The key to selecting effective snow disposal sites is to locate them adjacent to or on pervious surfaces in upland areas or upland locations on impervious surfaces away from water resources and drinking water wells. At these locations, the snow meltwater can filter into the soil, leaving behind sand and debris which can be removed in the spring. The following conditions should be followed:

- Within water supply Zone A and Zone II, avoid storage or disposal of snow and ice containing deicing chemicals that has been collected from streets located outside these zones. Municipalities may have a water supply protection land use control that prohibits the disposal of snow and ice containing deicing chemicals from outside the Zone A and Zone II, subject to the Massachusetts Drinking Water Regulations at 310 CMR 22.20C and 310 CMR 22.21(2).
- Avoid storage or disposal of snow or ice in Interim Wellhead Protection Areas (IWPA) of public water supply wells, and within 75 feet of a private well, where road salt may contaminate water supplies.
- Avoid dumping snow into any waterbody, including rivers, the ocean, reservoirs, ponds, or wetlands. In addition to water quality impacts and flooding, snow disposed of in open water can cause navigational hazards when it freezes into ice blocks.
- Avoid dumping snow on MassDEP-designated high and medium-yield aquifers where it may contaminate groundwater.
- Avoid dumping snow in sanitary landfills and gravel pits. Snow meltwater will create more contaminated leachate in landfills posing a greater risk to groundwater, and in gravel pits, there is little opportunity for pollutants to be filtered out of the meltwater because groundwater is close to the land surface.

- Avoid disposing of snow on top of storm drain catch basins or in stormwater drainage systems including detention basins, swales or ditches. Snow combined with sand and debris may block a stormwater drainage system, causing localized flooding. A high volume of sand, sediment, and litter released from melting snow also may be quickly transported through the system into surface water.

### *Recommended Site Selection Procedures*

It is important that the municipal Department of Public Works or Highway Department, Conservation Commission, and Board of Health work together to select appropriate snow disposal sites. The following steps should be taken:

- Estimate how much snow disposal capacity may be needed for the season so that an adequate number of disposal sites can be selected and prepared.
- Identify sites that could potentially be used for snow disposal, such as municipal open space (e.g., parking lots or parks).
- Select sites located in upland locations that are not likely to impact sensitive environmental resources first.
- If more storage space is still needed, prioritize the sites with the least environmental impact (using the site selection criteria, and local or MassGIS maps as a guide).

### *Snow Disposal Mapping Assistance*

MassDEP has an online mapping tool to assist in identifying possible locations to potentially dispose of snow. MassDEP encourages municipalities to use this tool to identify possible snow disposal options. The tool identifies wetland resource areas, public drinking water supplies and other sensitive locations where snow should not be disposed. The tool may be accessed through the Internet at the following web address:

<https://maps.env.state.ma.us/dep/arcgis/js/templates/PSF/>.

## **2. SITE PREPARATION AND MAINTENANCE**

In addition to carefully selecting disposal sites before the winter begins, it is important to prepare and maintain these sites to maximize their effectiveness. The following maintenance measures should be undertaken for all snow disposal sites:

- A silt fence or equivalent barrier should be placed securely on the downgradient side of the snow disposal site.
- Wherever possible maintain a 50-foot vegetated buffer between the disposal site and adjacent waterbodies to filter pollutants from the meltwater.
- Clear debris from the site prior to using the site for snow disposal.
- Clear debris from the site and properly dispose of it at the end of the snow season, and no later than May 15.

### 3. SNOW DISPOSAL APPROVALS

Proper snow disposal may be undertaken through one of the following approval procedures:

- Routine snow disposal – Minimal, if any, administrative review is required in these cases when upland and pervious snow disposal locations or upland locations on impervious surfaces that have functioning and maintained stormwater management systems have been identified, mapped, and used for snow disposal following ordinary snowfalls. Use of upland and pervious snow disposal sites avoids wetland resource areas and allows snow meltwater to recharge groundwater and will help filter pollutants, sand, and other debris. This process will address the majority of snow removal efforts until an entity exhausts all available upland snow disposal sites. The location and mapping of snow disposal sites will help facilitate each entity's routine snow management efforts.
- Emergency Certifications – If an entity demonstrates that there is no remaining capacity at upland snow disposal locations, local conservation commissions may issue an Emergency Certification under the Massachusetts Wetlands Protection regulations to authorize snow disposal in buffer zones to wetlands, certain open water areas, and certain wetland resource areas (i.e. within flood plains). Emergency Certifications can only be issued at the request of a public agency or by order of a public agency for the protection of the health or safety of citizens, and are limited to those activities necessary to abate the emergency. See 310 CMR 10.06(1)-(4). Use the following guidelines in these emergency situations:
  - Dispose of snow in open water with adequate flow and mixing to prevent ice dams from forming.
  - Do not dispose of snow in salt marshes, vegetated wetlands, certified vernal pools, shellfish beds, mudflats, drinking water reservoirs and their tributaries, Zone IIs or IWPA's of public water supply wells, Outstanding Resource Waters, or Areas of Critical Environmental Concern.
  - Do not dispose of snow where trucks may cause shoreline damage or erosion.
  - Consult with the municipal Conservation Commission to ensure that snow disposal in open water complies with local ordinances and bylaws.
- Severe Weather Emergency Declarations – In the event of a large-scale severe weather event, MassDEP may issue a broader Emergency Declaration under the Wetlands Protection Act which allows federal agencies, state agencies, state authorities, municipalities, and businesses greater flexibility in snow disposal practices. Emergency Declarations typically authorize greater snow disposal options while protecting especially sensitive resources such as public drinking water supplies, vernal pools, land containing shellfish, FEMA designated floodways, coastal dunes, and salt marsh. In the event of severe winter storm emergencies, the snow disposal site maps created by municipalities will enable MassDEP and the Massachusetts Emergency Management Agency (MEMA) in helping communities identify appropriate snow disposal locations.

If upland disposal sites have been exhausted, the Emergency Declaration issued by MassDEP allows for snow disposal near water bodies. In these situations, a buffer of at



least 50 feet, preferably vegetated, should still be maintained between the site and the waterbody. Furthermore, it is essential that the other guidelines for preparing and maintaining snow disposal sites be followed to minimize the threat to adjacent waterbodies.

Under extraordinary conditions, when all land-based snow disposal options are exhausted, the Emergency Declaration issued by MassDEP may allow disposal of snow in certain waterbodies under certain conditions. *A federal agency, state agency, state authority, municipality or business seeking to dispose of snow in a waterbody should take the following steps:*

- Call the emergency contact phone number [(888) 304-1133)] and notify the MEMA of the municipality's intent.
- MEMA will ask for some information about where the requested disposal will take place.
- MEMA will confirm that the disposal is consistent with MassDEP's Severe Weather Emergency Declaration and these guidelines and is therefore approved.

During declared statewide snow emergency events, MassDEP's website will also highlight the emergency contact phone number [(888) 304-1133)] for authorizations and inquiries. For further non-emergency information about this Guidance you may contact your MassDEP Regional Office Service Center:

**Northeast Regional Office, Wilmington, 978-694-3246**

**Southeast Regional Office, Lakeville, 508-946-2714**

**Central Regional Office, Worcester, 508-792-7650**

**Western Regional Office, Springfield, 413-755-2114**

# CDS Guide

## Operation, Design, Performance and Maintenance



## CDS®

Using patented continuous deflective separation technology, the CDS system screens, separates and traps debris, sediment, and oil and grease from stormwater runoff. The indirect screening capability of the system allows for 100% removal of floatables and neutrally buoyant material without blinding. Flow and screening controls physically separate captured solids, and minimize the re-suspension and release of previously trapped pollutants. Inline units can treat up to 6 cfs, and internally bypass flows in excess of 50 cfs (1416 L/s). Available precast or cast-in-place, offline units can treat flows from 1 to 300 cfs (28.3 to 8495 L/s). The pollutant removal capacity of the CDS system has been proven in lab and field testing.


## Operation Overview

Stormwater enters the diversion chamber where the diversion weir guides the flow into the unit's separation chamber and pollutants are removed from the flow. All flows up to the system's treatment design capacity enter the separation chamber and are treated.

Swirl concentration and screen deflection force floatables and solids to the center of the separation chamber where 100% of floatables and neutrally buoyant debris larger than the screen apertures are trapped.

Stormwater then moves through the separation screen, under the oil baffle and exits the system. The separation screen remains clog free due to continuous deflection.

During the flow events exceeding the treatment design capacity, the diversion weir bypasses excessive flows around the separation chamber, so captured pollutants are retained in the separation cylinder.

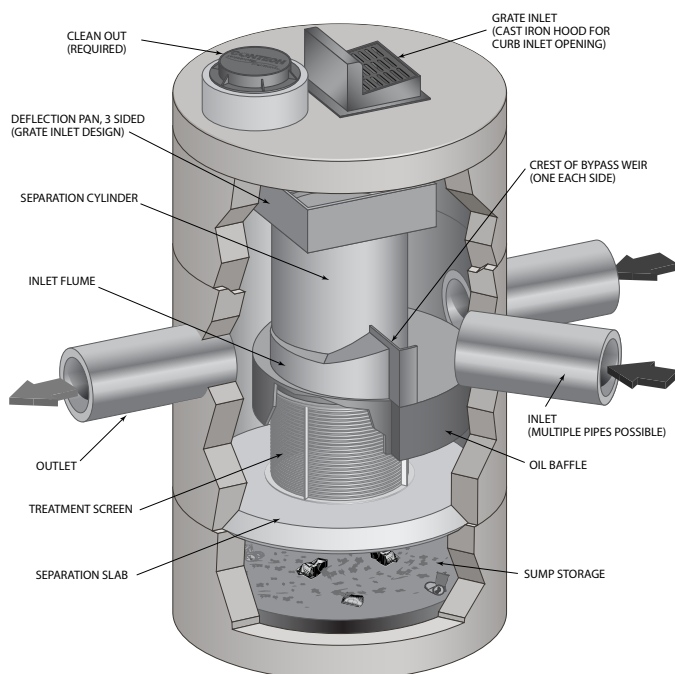

## Design Basics

There are three primary methods of sizing a CDS system. The Water Quality Flow Rate Method determines which model size provides the desired removal efficiency at a given flow rate for a defined particle size. The Rational Rainfall Method™ or the and Probabilistic Method is used when a specific removal efficiency of the net annual sediment load is required.

Typically in the United States, CDS systems are designed to achieve an 80% annual solids load reduction based on lab generated performance curves for a gradation with an average particle size (d50) of 125 microns (μm). For some regulatory environments, CDS systems can also be designed to achieve an 80% annual solids load reduction based on an average particle size (d50) of 75 microns (μm) or 50 microns (μm).

### Water Quality Flow Rate Method

In some cases, regulations require that a specific treatment rate, often referred to as the water quality design flow (WQQ), be treated. This WQQ represents the peak flow rate from either an event with a specific recurrence interval, e.g. the six-month storm, or a water quality depth, e.g. 1/2-inch (13 mm) of rainfall.

The CDS is designed to treat all flows up to the WQQ. At influent rates higher than the WQQ, the diversion weir will direct most flow exceeding the WQQ around the separation chamber. This allows removal efficiency to remain relatively constant in the separation chamber and eliminates the risk of washout during bypass flows regardless of influent flow rates.

Treatment flow rates are defined as the rate at which the CDS will remove a specific gradation of sediment at a specific removal efficiency. Therefore the treatment flow rate is variable, based on the gradation and removal efficiency specified by the design engineer.

### Rational Rainfall Method™

Differences in local climate, topography and scale make every site hydraulically unique. It is important to take these factors into consideration when estimating the long-term performance of any stormwater treatment system. The Rational Rainfall Method combines site-specific information with laboratory generated performance data, and local historical precipitation records to estimate removal efficiencies as accurately as possible.

Short duration rain gauge records from across the United States and Canada were analyzed to determine the percent of the total annual rainfall that fell at a range of intensities. US stations' depths were totaled every 15 minutes, or hourly, and recorded in 0.01-inch increments. Depths were recorded hourly with 1-mm resolution at Canadian stations. One trend was consistent at all sites; the vast majority of precipitation fell at low intensities and high intensity storms contributed relatively little to the total annual depth.

These intensities, along with the total drainage area and runoff coefficient for each specific site, are translated into flow rates using the Rational Rainfall Method. Since most sites are relatively small and highly impervious, the Rational Rainfall Method is appropriate. Based on the runoff flow rates calculated for each intensity, operating rates within a proposed CDS system are

determined. Performance efficiency curve determined from full scale laboratory tests on defined sediment PSDs is applied to calculate solids removal efficiency. The relative removal efficiency at each operating rate is added to produce a net annual pollutant removal efficiency estimate.

### Probabilistic Rational Method

The Probabilistic Rational Method is a sizing program Contech developed to estimate a net annual sediment load reduction for a particular CDS model based on site size, site runoff coefficient, regional rainfall intensity distribution, and anticipated pollutant characteristics.

The Probabilistic Method is an extension of the Rational Method used to estimate peak discharge rates generated by storm events of varying statistical return frequencies (e.g. 2-year storm event). Under the Rational Method, an adjustment factor is used to adjust the runoff coefficient estimated for the 10-year event, correlating a known hydrologic parameter with the target storm event. The rainfall intensities vary depending on the return frequency of the storm event under consideration. In general, these two frequency dependent parameters (rainfall intensity and runoff coefficient) increase as the return frequency increases while the drainage area remains constant.

These intensities, along with the total drainage area and runoff coefficient for each specific site, are translated into flow rates using the Rational Method. Since most sites are relatively small and highly impervious, the Rational Method is appropriate. Based on the runoff flow rates calculated for each intensity, operating rates within a proposed CDS are determined. Performance efficiency curve on defined sediment PSDs is applied to calculate solids removal efficiency. The relative removal efficiency at each operating rate is added to produce a net annual pollutant removal efficiency estimate.

### Treatment Flow Rate

The inlet throat area is sized to ensure that the WQQ passes through the separation chamber at a water surface elevation equal to the crest of the diversion weir. The diversion weir bypasses excessive flows around the separation chamber, thus preventing re-suspension or re-entrainment of previously captured particles.

### Hydraulic Capacity

The hydraulic capacity of a CDS system is determined by the length and height of the diversion weir and by the maximum allowable head in the system. Typical configurations allow hydraulic capacities of up to ten times the treatment flow rate. The crest of the diversion weir may be lowered and the inlet throat may be widened to increase the capacity of the system at a given water surface elevation. The unit is designed to meet project specific hydraulic requirements.

## Performance

### Full-Scale Laboratory Test Results

A full-scale CDS system (Model CDS2020-5B) was tested at the facility of University of Florida, Gainesville, FL. This CDS unit was evaluated under controlled laboratory conditions of influent flow rate and addition of sediment.

Two different gradations of silica sand material (UF Sediment & OK-110) were used in the CDS performance evaluation. The particle size distributions (PSDs) of the test materials were analyzed using standard method "Gradation ASTM D-422 "Standard Test Method for Particle-Size Analysis of Soils" by a certified laboratory.

UF Sediment is a mixture of three different products produced by the U.S. Silica Company: "Sil-Co-Sil 106", "#1 DRY" and "20/40 Oil Frac". Particle size distribution analysis shows that the UF Sediment has a very fine gradation ( $d_{50} = 20$  to  $30 \mu\text{m}$ ) covering a wide size range (Coefficient of Uniformity,  $C_u$  averaged at 10.6). In comparison with the hypothetical TSS gradation specified in the NJDEP (New Jersey Department of Environmental Protection) and NJCAT (New Jersey Corporation for Advanced Technology) protocol for lab testing, the UF Sediment covers a similar range of particle size but with a finer  $d_{50}$  ( $d_{50}$  for NJDEP is approximately  $50 \mu\text{m}$ ) (NJDEP, 2003).

The OK-110 silica sand is a commercial product of U.S. Silica Sand. The particle size distribution analysis of this material, also included in Figure 1, shows that 99.9% of the OK-110 sand is finer than 250 microns, with a mean particle size ( $d_{50}$ ) of 106 microns. The PSDs for the test material are shown in Figure 1.

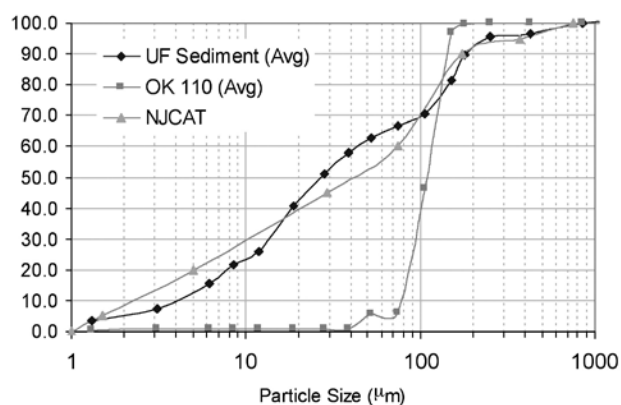


Figure 1. Particle size distributions

Tests were conducted to quantify the performance of a specific CDS unit (1.1 cfs (31.3-L/s) design capacity) at various flow rates, ranging from 1% up to 125% of the treatment design capacity of the unit, using the 2400 micron screen. All tests were conducted with controlled influent concentrations of approximately 200 mg/L. Effluent samples were taken at equal time intervals across the entire duration of each test run. These samples were then processed with a Dekaport Cone sample splitter to obtain representative sub-samples for Suspended Sediment Concentration (SSC) testing using ASTM D3977-97 "Standard Test Methods for Determining Sediment Concentration in Water Samples", and particle size distribution analysis.

## Results and Modeling

Based on the data from the University of Florida, a performance model was developed for the CDS system. A regression analysis was used to develop a fitting curve representative of the scattered data points at various design flow rates. This model, which demonstrated good agreement with the laboratory data, can then be used to predict CDS system performance with respect

to SSC removal for any particle size gradation, assuming the particles are inorganic sandy-silt. Figure 2 shows CDS predictive performance for two typical particle size gradations (NJCAT gradation and OK-110 sand) as a function of operating rate.

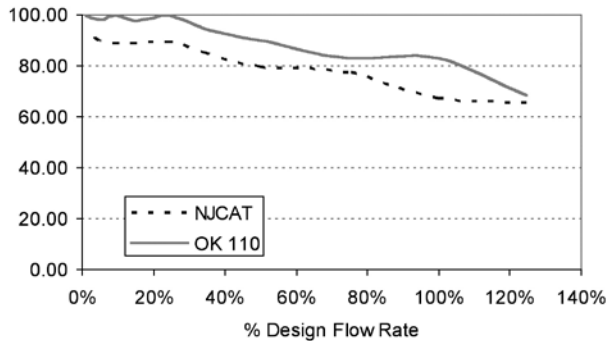


Figure 2. CDS stormwater treatment predictive performance for various particle gradations as a function of operating rate.

Many regulatory jurisdictions set a performance standard for hydrodynamic devices by stating that the devices shall be capable of achieving an 80% removal efficiency for particles having a mean particle size (d50) of 125 microns (e.g. Washington State Department of Ecology — WASDOE - 2008). The model can be used to calculate the expected performance of such a PSD (shown in Figure 3). The model indicates (Figure 4) that the CDS system with 2400 micron screen achieves approximately 80% removal at the design (100%) flow rate, for this particle size distribution (d50 = 125  $\mu\text{m}$ ).

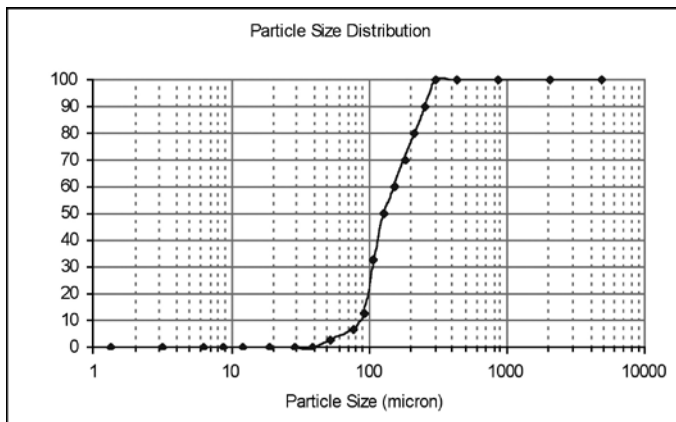


Figure 3. WASDOE PSD

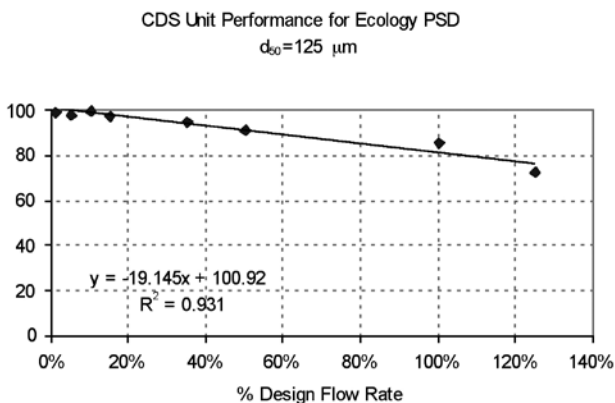


Figure 4. Modeled performance for WASDOE PSD.

## Maintenance

The CDS system should be inspected at regular intervals and maintained when necessary to ensure optimum performance. The rate at which the system collects pollutants will depend more heavily on site activities than the size of the unit. For example, unstable soils or heavy winter sanding will cause the grit chamber to fill more quickly but regular sweeping of paved surfaces will slow accumulation.

## Inspection

Inspection is the key to effective maintenance and is easily performed. Pollutant transport and deposition may vary from year to year and regular inspections will help ensure that the system is cleaned out at the appropriate time. At a minimum, inspections should be performed twice per year (e.g. spring and fall) however more frequent inspections may be necessary in climates where winter sanding operations may lead to rapid accumulations, or in equipment washdown areas. Installations should also be inspected more frequently where excessive amounts of trash are expected.

The visual inspection should ascertain that the system components are in working order and that there are no blockages or obstructions in the inlet and separation screen. The inspection should also quantify the accumulation of hydrocarbons, trash, and sediment in the system. Measuring pollutant accumulation can be done with a calibrated dipstick, tape measure or other measuring instrument. If absorbent material is used for enhanced removal of hydrocarbons, the level of discoloration of the sorbent material should also be identified





during inspection. It is useful and often required as part of an operating permit to keep a record of each inspection. A simple form for doing so is provided.

Access to the CDS unit is typically achieved through two manhole access covers. One opening allows for inspection and cleanout of the separation chamber (cylinder and screen) and isolated sump. The other allows for inspection and cleanout of sediment captured and retained outside the screen. For deep units, a single manhole access point would allow both sump cleanout and access outside the screen.

The CDS system should be cleaned when the level of sediment has reached 75% of capacity in the isolated sump or when an appreciable level of hydrocarbons and trash has accumulated. If absorbent material is used, it should be replaced when significant discoloration has occurred. Performance will not be impacted until 100% of the sump capacity is exceeded; however, it is recommended that the system be cleaned prior to that for easier removal of sediment. The level of sediment is easily determined by measuring from finished grade down to the top of the sediment pile. To avoid underestimating the level of sediment in the chamber, the measuring device must be lowered to the top of the sediment pile carefully. Particles at the top of the pile typically offer less resistance to the end of the rod than consolidated particles toward the bottom of the pile. Once this measurement is recorded, it should be compared to the as-built drawing for the unit to determine whether the height of the sediment pile off the bottom of the sump floor exceeds 75% of the total height of isolated sump.

## Cleaning

Cleaning of a CDS system should be done during dry weather conditions when no flow is entering the system. The use of a vacuum truck is generally the most effective and convenient method of removing pollutants from the system. Simply remove the manhole covers and insert the vacuum hose into the sump. The system should be completely drained down and the sump fully evacuated of sediment. The area outside the screen should also be cleaned out if pollutant build-up exists in this area.

In installations where the risk of petroleum spills is small, liquid contaminants may not accumulate as quickly as sediment. However, the system should be cleaned out immediately in the event of an oil or gasoline spill. Motor oil and other hydrocarbons that accumulate on a more routine basis should be removed when an appreciable layer has been captured. To remove these pollutants, it may be preferable to use absorbent pads since they are usually less expensive to dispose than the oil/water emulsion that may be created by vacuuming the oily layer. Trash and debris can be netted out to separate it from the other pollutants. The screen should be cleaned to ensure it is free of trash and debris.


Manhole covers should be securely seated following cleaning activities to prevent leakage of runoff into the system from above and also to ensure that proper safety precautions have been followed. Confined space entry procedures need to be followed if physical access is required. Disposal of all material removed from the CDS system should be done in accordance with local regulations. In many jurisdictions, disposal of the sediments may be handled in the same manner as the disposal of sediments removed from catch basins or deep sump manholes. Check your local regulations for specific requirements on disposal.



CDS Model	Diameter		Distance from Water Surface to Top of Sediment Pile		Sediment Storage Capacity	
	ft	m	ft	m	y <sup>3</sup>	m <sup>3</sup>
CDS1515	3	0.9	3.0	0.9	0.5	0.4
CDS2015	4	1.2	3.0	0.9	0.9	0.7
CDS2015	5	1.5	3.0	0.9	1.3	1.0
CDS2020	5	1.5	3.5	1.1	1.3	1.0
CDS2025	5	1.5	4.0	1.2	1.3	1.0
CDS3020	6	1.8	4.0	1.2	2.1	1.6
CDS3025	6	1.8	4.0	1.2	2.1	1.6
CDS3030	6	1.8	4.6	1.4	2.1	1.6
CDS3035	6	1.8	5.0	1.5	2.1	1.6
CDS4030	8	2.4	4.6	1.4	5.6	4.3
CDS4040	8	2.4	5.7	1.7	5.6	4.3
CDS4045	8	2.4	6.2	1.9	5.6	4.3
CDS5640	10	3.0	6.3	1.9	8.7	6.7
CDS5653	10	3.0	7.7	2.3	8.7	6.7
CDS5668	10	3.0	9.3	2.8	8.7	6.7
CDS5678	10	3.0	10.3	3.1	8.7	6.7

Table 1: CDS Maintenance Indicators and Sediment Storage Capacities

Note: To avoid underestimating the volume of sediment in the chamber, carefully lower the measuring device to the top of the sediment pile. Finer silty particles at the top of the pile may be more difficult to feel with a measuring stick. These finer particles typically offer less resistance to the end of the rod than larger particles toward the bottom of the pile.

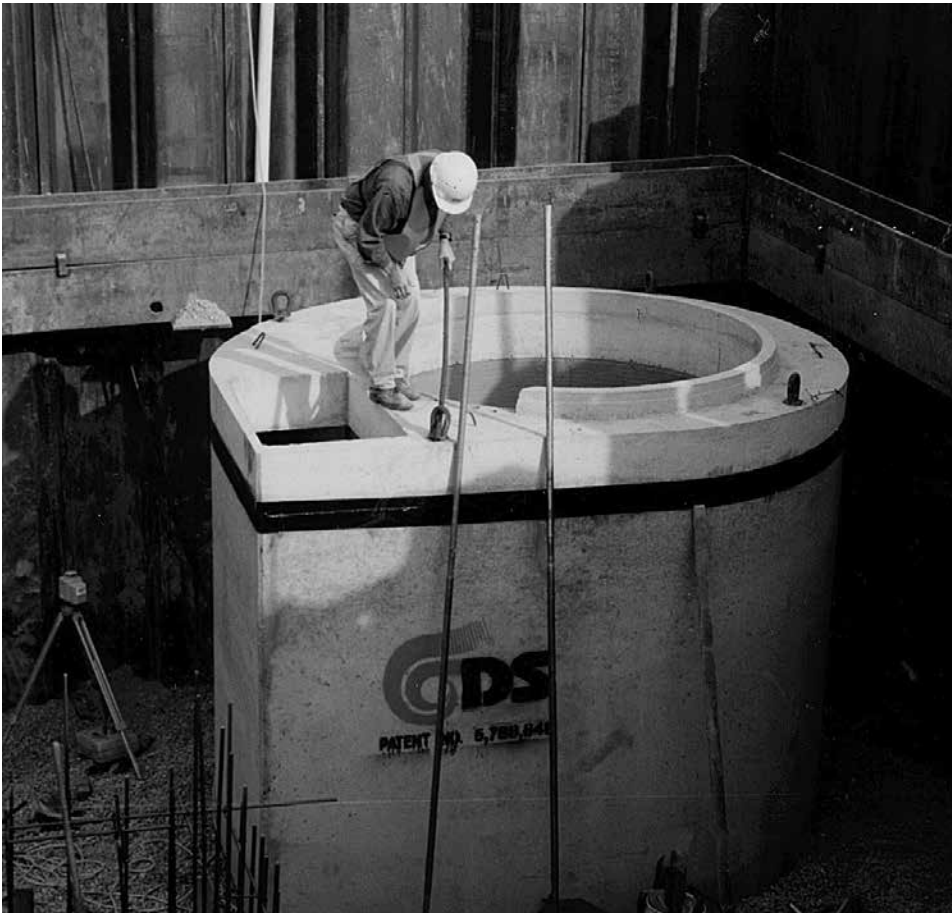

# CDS Inspection & Maintenance Log

CDS Model: \_\_\_\_\_ Location: \_\_\_\_\_

[illegible]

1. The water depth to sediment is determined by taking two measurements with a stadia rod: one measurement from the manhole opening to the top of the sediment pile and the other from the manhole opening to the water surface. If the difference between these measurements is less than the values listed in table 1 the system should be cleaned out. **Note: to avoid underestimating the volume of sediment in the chamber, the measuring device must be carefully lowered to the top of the sediment pile.**
2. For optimum performance, the system should be cleaned out when the floating hydrocarbon layer accumulates to an appreciable thickness. In the event of an oil spill, the system should be cleaned immediately.



## SUPPORT

- Drawings and specifications are available at [www.ContechES.com](http://www.ContechES.com).
- Site-specific design support is available from our engineers.



800-338-1122  
[www.ContechES.com](http://www.ContechES.com)

©2017 Contech Engineered Solutions LLC, a QUIKRETE Company

Contech Engineered Solutions provides site solutions for the civil engineering industry. Contech's portfolio includes bridges, drainage, sanitary sewer, earth stabilization and stormwater treatment products. For information on other Contech division offerings, visit [www.ContechES.com](http://www.ContechES.com) or call 800.338.1122

NOTHING IN THIS CATALOG SHOULD BE CONSTRUED AS A WARRANTY. APPLICATIONS SUGGESTED HEREIN ARE DESCRIBED ONLY TO HELP READERS MAKE THEIR OWN EVALUATIONS AND DECISIONS, AND ARE NEITHER GUARANTEES NOR WARRANTIES OF SUITABILITY FOR ANY APPLICATION. CONTECH MAKES NO WARRANTY WHATSOEVER, EXPRESS OR IMPLIED, RELATED TO THE APPLICATIONS, MATERIALS, COATINGS, OR PRODUCTS DISCUSSED HEREIN. ALL IMPLIED WARRANTIES OF MERCHANTABILITY AND ALL IMPLIED WARRANTIES OF FITNESS FOR ANY PARTICULAR PURPOSE ARE DISCLAIMED BY CONTECH. SEE CONTECH'S CONDITIONS OF SALE (AVAILABLE AT [WWW.CONTECHES.COM/COS](http://WWW.CONTECHES.COM/COS)) FOR MORE INFORMATION.

The product(s) described may be protected by one or more of the following US patents: 5,322,629; 5,624,576; 5,707,527; 5,759,415; 5,788,848; 5,985,157; 6,027,639; 6,350,374; 6,406,218; 6,641,720; 6,511,595; 6,649,048; 6,991,114; 6,998,038; 7,186,058; 7,296,692; 7,297,266; related foreign patents or other patents pending.





# **OWNERS MAINTENANCE MANUAL**

retain-it, LLC  
560 Salmon Brook Street  
Granby, CT 06035  
(860) 413-3050

retain-it ®

## **Owners Maintenance Manual**

### **Table of Contents**

Description

Engineering Design Specifications

Daily Operation and Long Term Maintenance

- System Operation

- Periodic Inspection

- Visual Inspection Guide

  - Internal Flow Evaluation

    - Low, Medium and High Flow

  - Pollution Storage Capacities

    - Oil and Grease

    - Sediments

    - Trash and Debris

- Standard Maintenance

- Emergency Spill Conditions

Sample Maintenance Log

## Description

retain-it<sup>®</sup> is a subsurface Storm Water Management system constructed of precast concrete structures. They are installed in a side by side configuration creating a continuous internal flow channel integrated throughout the system. Systems are constructed with designated inlet and outlet modules, some with multiple inlets and outlets depending on the site storm water system layout. Infiltration systems typically have an inlet and sidewalls/ base constructed on a stone infiltration blanket with geofabric installed at the native soil interface. Other systems incorporate outlet flow control devices. Detention systems are typically lined with a watertight membrane and have inlet and outlet control devices.

The retain-it<sup>®</sup> system can consist of multiple varying layouts, with no two the same. Given this, it should be noted that the operation and maintenance requirements are very similar regardless of the intended layout. It is important that the end user know the specific elements of each system so as to understand how best to optimize it's operation.

**Installation per Design:** Operation is simple to follow where the installation was performed in accordance with the design specifications, drawings and calculations. Specifics shall be identified in the design drawings. As-built drawings will benefit the locating of specific design modules where the system has been buried below a parking lot area. Optional access manholes or removable grates may be installed above every inlet/outlet pipe and at critical design elements designated by the design.

**Daily Operation and Long Term Maintenance:** In general, daily usage of the system is self sufficient and will operate without requiring any outside assistance, except for periodic inspection to verify optimal performance and maintenance for removal of collected pollutants. A longer term maintenance program should incorporate a more thorough inspection of the all elements of the system to verify proper operating condition. This is more important with the infiltration type of systems where the soil infiltration surface may become restricted due to fine particle build up. Long term maintenance should include provisions for cleaning and removal of collected solids, oils and debris from the system.

**System Operation:** The system operational function is initiated according to rainfall runoff flows entering the structure. Internally, the runoff flows in a set pattern or sequence throughout the module layout in accordance with the hydraulic design conditions. The flows primarily operate on system head derived from the changes in

elevation from the internal water surface and the outlet invert elevation. Some designs incorporate internal flow controls to satisfy hydraulic conditions that enhance water quality treatment or other intended purposes. Modified systems may incorporate a pump, but in general there are no mechanical apparatus required.

End user operations primarily consist of inspection and maintenance of the system over time.

**Periodic Inspection:** Important note - All storm water management systems react differently depending on the conditions that are characteristic to the contributing water shed. Variables such as storm intensity, runoff flow rates, site geology, surface stabilization and pollution load will affect the system operation. As does the inspection and maintenance frequency to ensure optimum effectiveness.

Inspections should be done periodically, with a greater number scheduled during the system start up and less frequently as the operator becomes familiar with the system performance characteristics. It is recommended that the end user keep records of the performance using the inspection log record sheet found in the back of this manual. These records shall identify the cycle of maintenance “system calibration” required for the specific applications based on the contributing water shed variables operating under “normal” conditions.

Please note that immediate maintenance may be required during “non-normal” events such as during adverse weather conditions or emergency fuel spills. See information on emergency spills in this manual.

Visual inspection of all assessable components shall be performed throughout the lifetime of the system. Access has been supplied at critical points to monitor hydraulic performance and removed pollutants buildup.

### **Standard Maintenance:**

After construction has been completed and all disturbed surfaces have been stabilized by means of vegetation, asphalt or concrete surfaces, and all drainage system components have been constructed and are free of construction debris and sediments; then the storm water management system can be considered in an operational status.

Periodic visual inspections will help to identify issues of concern. The usual indicators are signs of slow flows, backed up water, visible oil, trash and debris or an excessive amount of sediment in the storage area.

Normal operational flows can be observed to flow freely at the predicted design elevations, from the inlet to the outlet module, following a serpentine path thru the storage and attenuation modules. Note that some modules are designed to permanently

retain water where others may hold water and slowly release it over a typical 24 hour period. During a storm water event, the flows and water surface elevations will fluctuate from a low flow to a high flow/ storage status. The storage modules should fill during the event and drain down within a 24 hour period after the event has stopped. All pipes, orifices, weirs and standpipes should pass flows freely and at optimum capacity.

Standard maintenance is performed using a vacuum truck to suction the accumulated sediments, oils and greases and trash and debris from the system. Whereas an on-site maintenance staff can remove these items by hand, it is preferred that the vacuum truck be used as dictated by specific system conditions. When a specialized module designed to have a permanent water level is used, the vacuum truck should pump the liquid level down to inspect the below water elevation structures and sump storage areas.

Oils and greases can be handled by on-site staff by utilizing absorbent products that soak up the oils (and not) converting the oils from a liquid into a manageable solid form. These oil soaked absorbent materials should be disposed of in an approved manner.

Sediments, trash and debris shall be removed and disposed of in an approved manner.

Any indications of hazardous material, determined by visual inspection, testing, smell or abnormality, should be reported and handled per appropriate regulations.

## **Flow Conditions**

System operators should familiarize themselves with proper hydraulic flow condition indicators, acceptable depths of sedimentation, debris and trash build up, and concentrations of oils and greases.

*Hydraulic flow conditions* are those that are established by the design as either a flow/storage or as a water quality treatment function. Both have performance characteristics that can be visually identified so as to determine the effective and efficient operation of the system.

The engineering design drawings should note the various expected water surface level elevations that are achieved during different design storms within the various modules. Since it is difficult for a visual inspection to coincide with the exact time given water elevations are predicted, the following guidelines are given for evaluation.

## **Visual Inspection Guide:**

### Internal Flow Evaluation

Low flow: water should flow freely from the inlet to the outlet, travelling the intended attenuation path thru the system with the water surface elevation below the structure

beam height (12" deep), the system should drain completely 24 hours after a storm event,

Medium flow: the system should hold and maintain a water level during the 24 hour storm event and yet continually fill as the storm increases or drain downward as the event recedes. Flow within the system should occur freely from inlet to outlet only being restricted when a flow control structure has been integrally designed in place. Flow control devices may result in a water level backing up either temporarily or permanently; noting devices such as water quality modules may require a permanent water level to operate properly (see water quality treatment). Other system applications should drain completely 24 hours after a storm event.

High flow: the system should fill to the maximum design storm water level elevation (hydraulic grade line) per design. In most cases, that is the highest storage elevation available in the system, at the underside of the module top slab, or the invert of the overflow pipe. As the storm event recedes, the water level should begin to drain down via flow thru the system and discharge. The system should drain completely within 24 hours after a storm event.

## **Pollutant Storage Capacities**

### Oil and Grease

Oil and Grease Collection (with optional Oil water separator module specified) - Oil and grease accumulation is generally a function related to vehicle parking lot and drive areas, oil generating land uses or emergency spill conditions. It is important to maintain the system from accumulating excessive volumes of oils in that they may wash over into other sections of the system potentially clogging and reducing the infiltration capacity, blocking control devices and contaminating the overall system. The following standards apply.

Oil should not accumulate more than a visible sheen on the water surface in the oil water separation module only. A sheen is described as a fine, thin oil layer on the water surface identified by the glossy rainbow colors. A dipstick (dry wooden stick) can be used as a probe to determine the thickness of oil on the surface.

Accumulated oils could be associated with insufficient maintenance or a potential large volume oil resource. Any accumulation of oil should be promptly maintained by an experienced waste handler. Emergency spills such as those generated by an accidental spill shall be contained and removed immediately before the next storm event. Spills shall be handled in accordance with local environmental regulations. See spill and accumulated oil maintenance procedures.



## Sediments

Sediments (with optional primary grit module or sedimentation modules specified) - Sediments shall be periodically removed from the system as they accumulate within the designated storage modules. The inlet modules are generally equipped with a sediment storage sump located in the base of the inlet structure. Inspection should be performed after major storm events or a minimum of annually, unless a different inspection cycle has been determined to be sufficient. Inspection shall consist of using a probe to determine the presence of and depth of the accumulated solids. Access is via the 24" manhole.

Note that excessive volumes of sediments will reduce the performance and efficiency of the system. Regional accumulations of solids such as those associated with ice and snow, may result in large springtime volumes of sand and gravels used for traction and ice control.

## Trash and Debris

Trash and Debris (with optional trash and debris module specified) - Trash and debris accumulates in the inlet module in three forms; floating debris, neutrally buoyant, and heavy material. The floating debris is visible from the access manhole floating on the water surface in the form of but not limited to wood, paper, plastic, foam, bottles and cans. The neutrally buoyant material resides below the surface and combines with the natural flow regime of the system. It is hard to detect and can only be recognized when at a high concentration appears as a thickening of the water viscosity. Heavier material will simply settle to the sump base and combine with the sediments.

Note that trash and debris typically cause the most problems when they become lodged in a flow control device such as an outlet elbow, riser pipe, and orifice or weir structure. This can be detected visibly when the system is pumped down during maintenance. It can also be evaluated as a condition when flow is impeded and the water level backs up higher than the design elevations.

## **Emergency Spill Conditions (with optional emergency spill control module specified):**

Emergency spill conditions are defined as an excessive accumulation of hydrocarbons such as oil, gasoline, diesel fuel, transmission oil or antifreeze usually resulting from an accidental discharge. Excessive accumulation is described as any amount larger than a thin "sheen" visible on the water surface.

Care should be given in handling these types of fluids. The incident should be reported to the appropriate authorities and should be mitigated by a hazardous waste consultant approved for such matters.

retain-it ®

Maintenance Log

Storm Water Management System

Location:

ID #:

Date

Inspection Notes

Inspector

**Note the following conditions:**

Inlet Module

Outlet Module

Water Quality Module

Oil Elbow

Oil Accumulation

Sedimentation Accumulation

Trash and Debris Quantity

Flow Conditions

Flow Control Outlet Structure

Overflow Pipe






## SECTION 3.0 - EXHIBITS





## USGS Site Locus Map

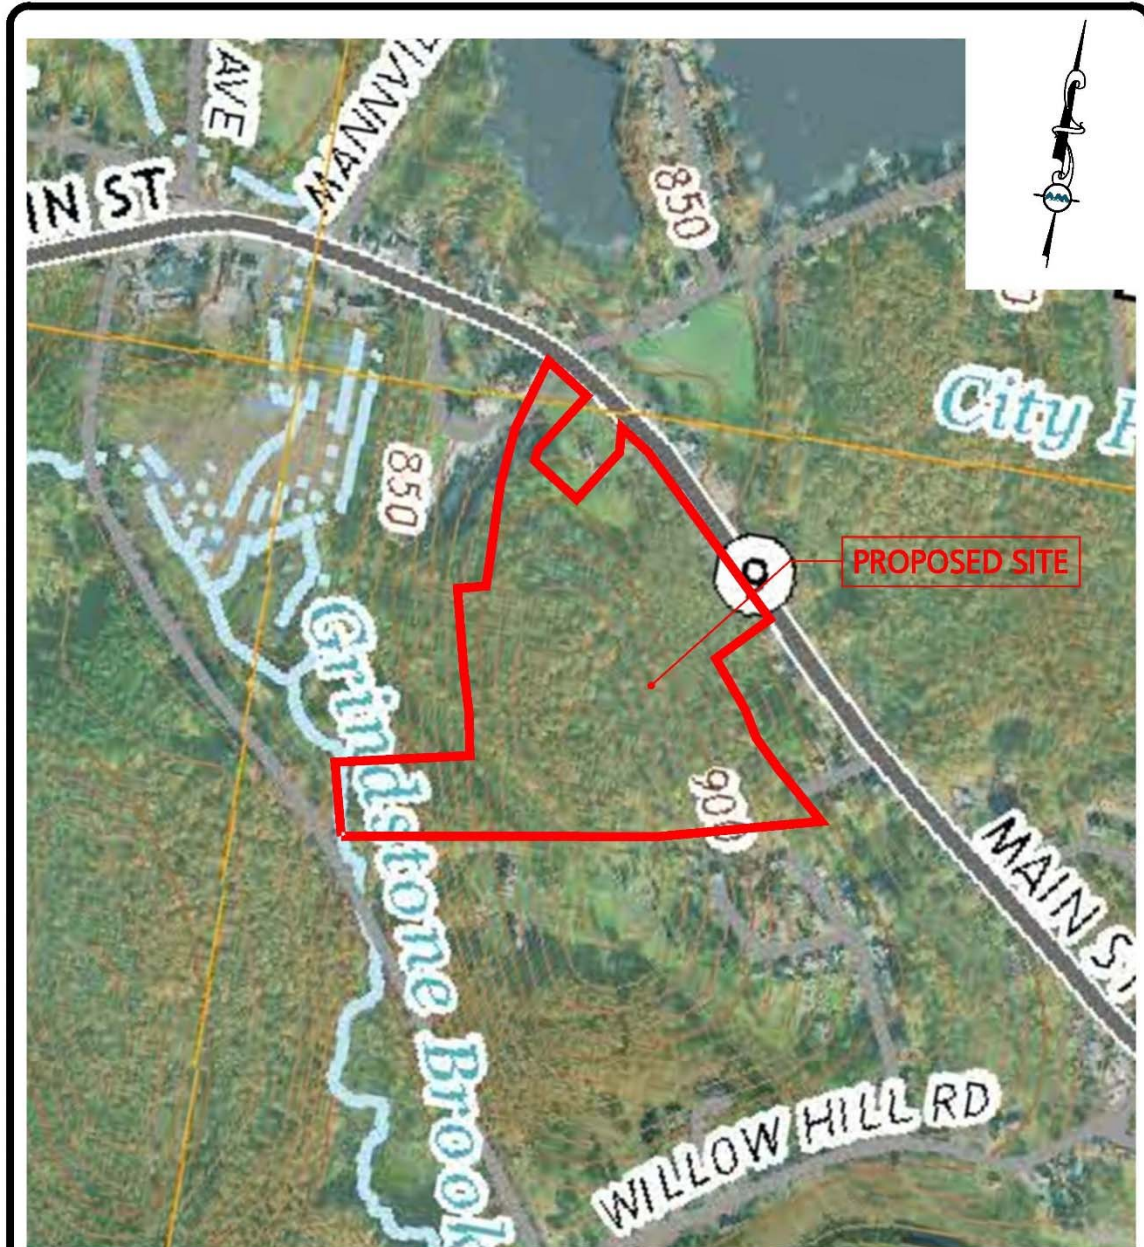

PREPARED BY:



**ALLEN & MAJOR  
ASSOCIATES, INC.**

civil engineering • land surveying environmental  
consulting • landscape architecture  
www.allenmajor.com  
100 COMMERCE WAY  
P.O. BOX 2118  
WOBURN MA 01888-0118  
TEL: (781) 935-6889  
FAX: (781) 935-2896

WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

PROJECT:

**SKYVIEW ESTATES  
MAIN STREET  
LEICESTER, MA**

Copyright © 2021 Allen & Major Associates, Inc.  
All Rights Reserved

**USGS SITE LOCUS MAP**

PROJECT NO. 2889-01 DATE: 07-16-2021

SCALE: 1"=500' DWG. NAME: EXHIBITS

DESIGNED BY: JG CHECKED BY: MAM


THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

**EX-1**





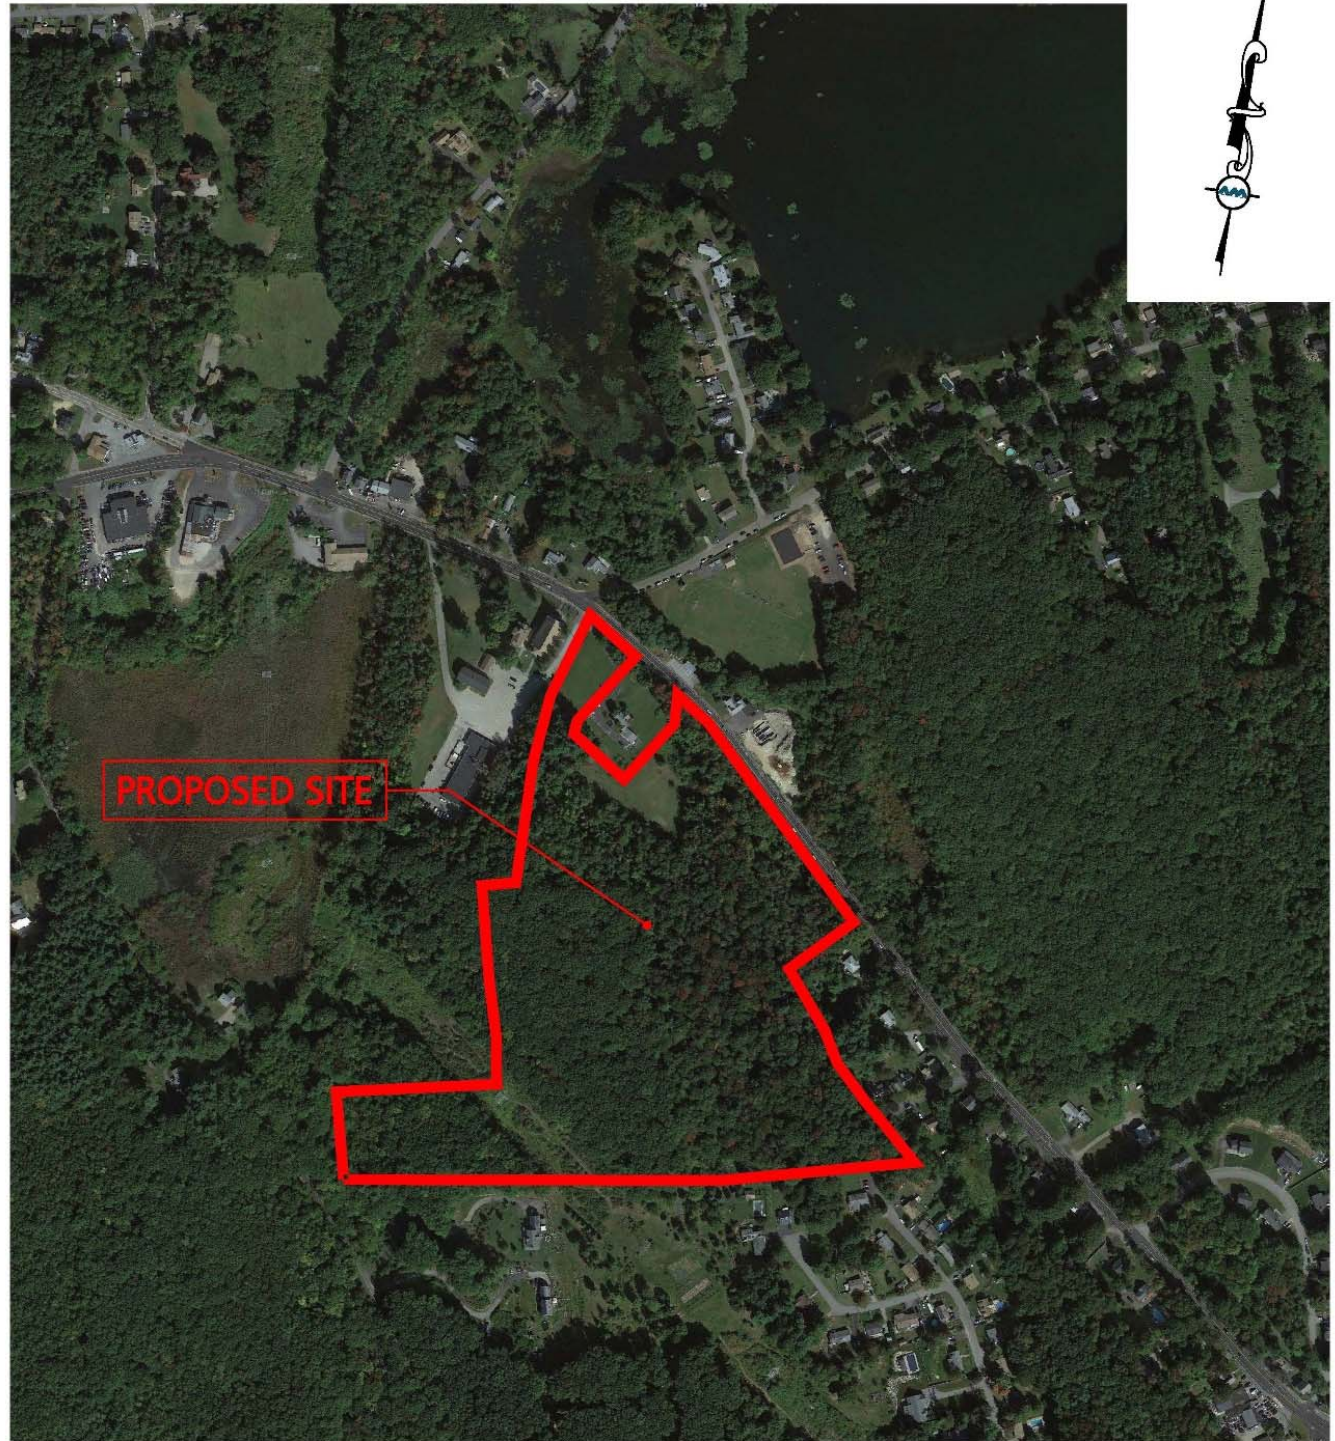

PREPARED BY:



**ALLEN & MAJOR  
ASSOCIATES, INC.**

civil engineering • land surveying environmental  
consulting • landscape architecture

www.allenmajor.com

100 COMMERCE WAY

P.O. BOX 2118

WOBURN MA 01888-0118

TEL: (781) 935-6889

FAX: (781) 935-2896

WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

PROJECT:

**SKYVIEW ESTATES  
MAIN STREET  
LEICESTER, MA**

Copyright © 2021 Allen & Major Associates, Inc.  
All Rights Reserved

**AERIAL PHOTO**

PROJECT NO. 2889-01 DATE: 07-16-2021

SCALE: 1" = 500' DWG. NAME: EXHIBITS

DESIGNED BY: JG CHECKED BY: MAM


THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

**EX-2**





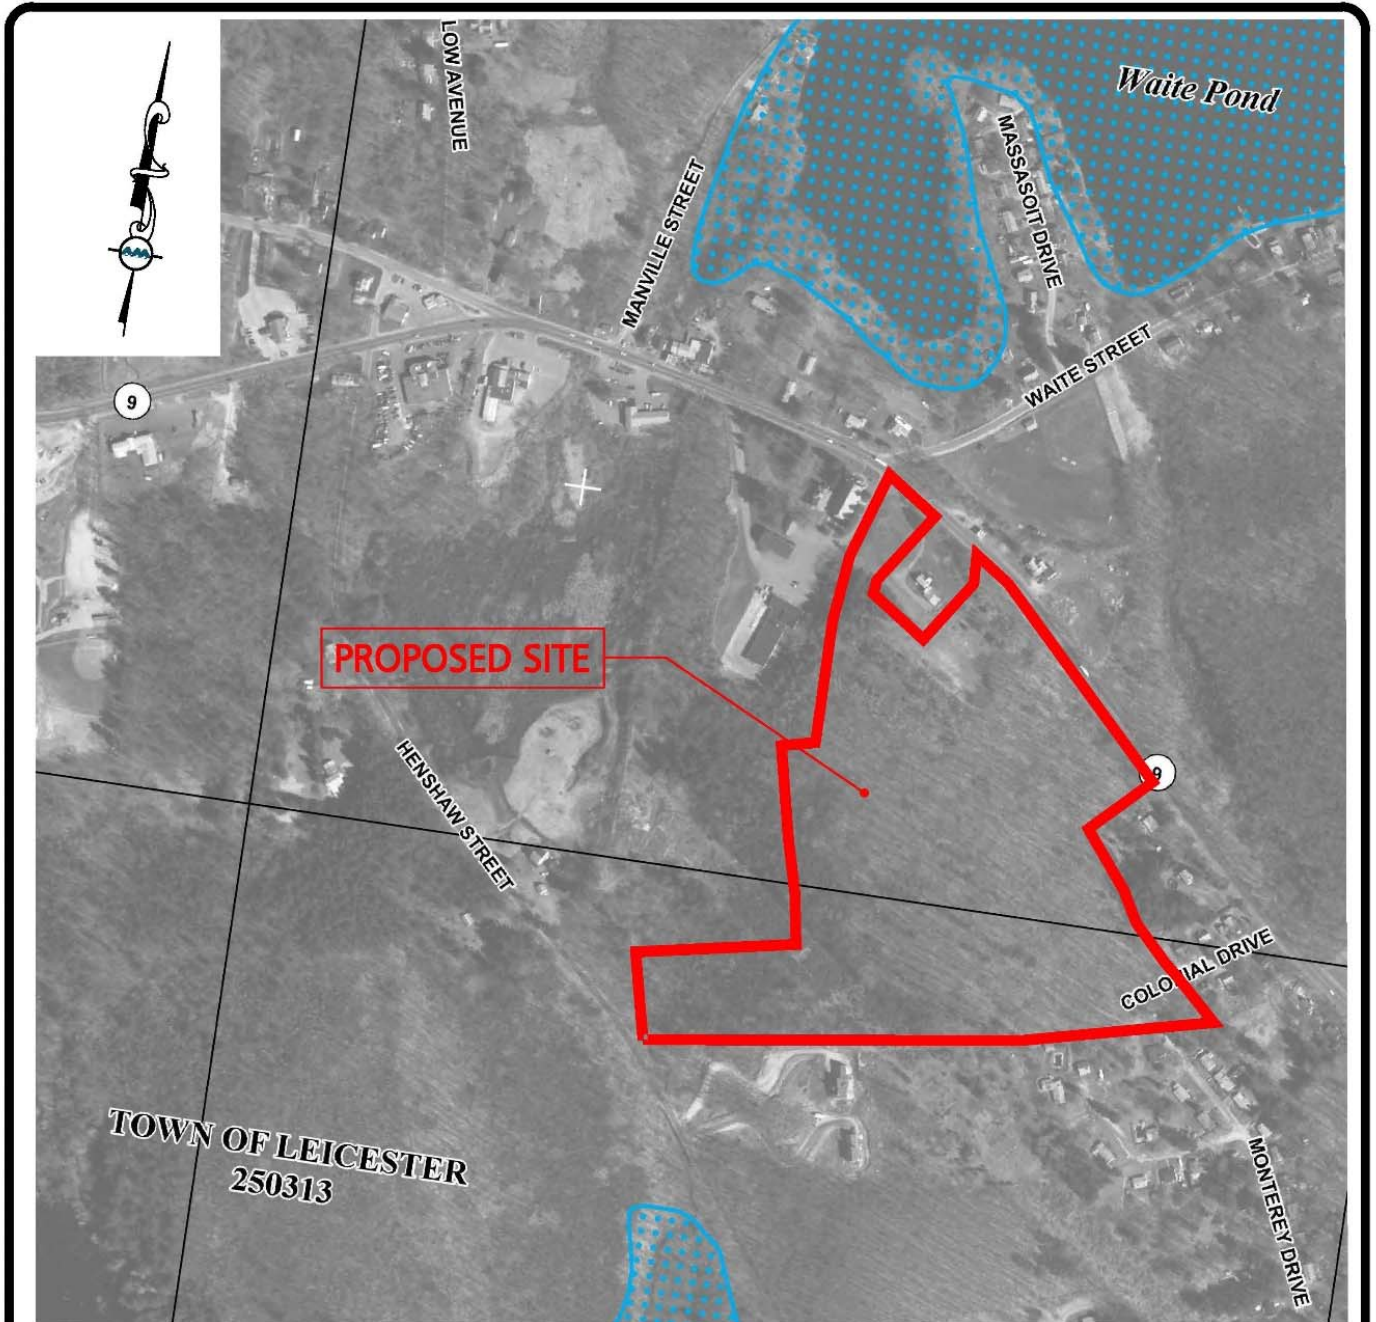

NOTES:

1. THE SITE IS LOCATED WITHIN ZONE X — AREAS DETERMINED TO BE OUTSIDE OF THE 0.2 % ANNUAL CHANCE FLOODPLAIN.
2. FEMA FIRM MAP WORCESTER COUNTY, MASSACHUSETTS #25027C0782E, PANEL 782 OF 1075

PREPARED BY:



**ALLEN & MAJOR  
ASSOCIATES, INC.**

civil engineering • land surveying environmental  
consulting • landscape architecture  
www.allenmajor.com  
100 COMMERCE WAY  
P.O. BOX 2118  
WOBURN MA 01888-0118  
TEL: (781) 935-6889  
FAX: (781) 935-2896

WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

PROJECT:

**SKYVIEW ESTATES  
MAIN STREET  
LEICESTER, MA**

Copyright © 2021 Allen & Major Associates, Inc.  
All Rights Reserved

**FEMA FIRM MAP**

PROJECT NO.	2889-01	DATE:	07-16-2021
SCALE:	1"=500'	DWG. NAME:	EXHIBITS
DESIGNED BY:	JG	CHECKED BY:	MAM

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

**EX-3**








## LEGEND

NHESP Priority Habitats of Rare Species



NHESP Estimated Habitats of Rare Wildlife

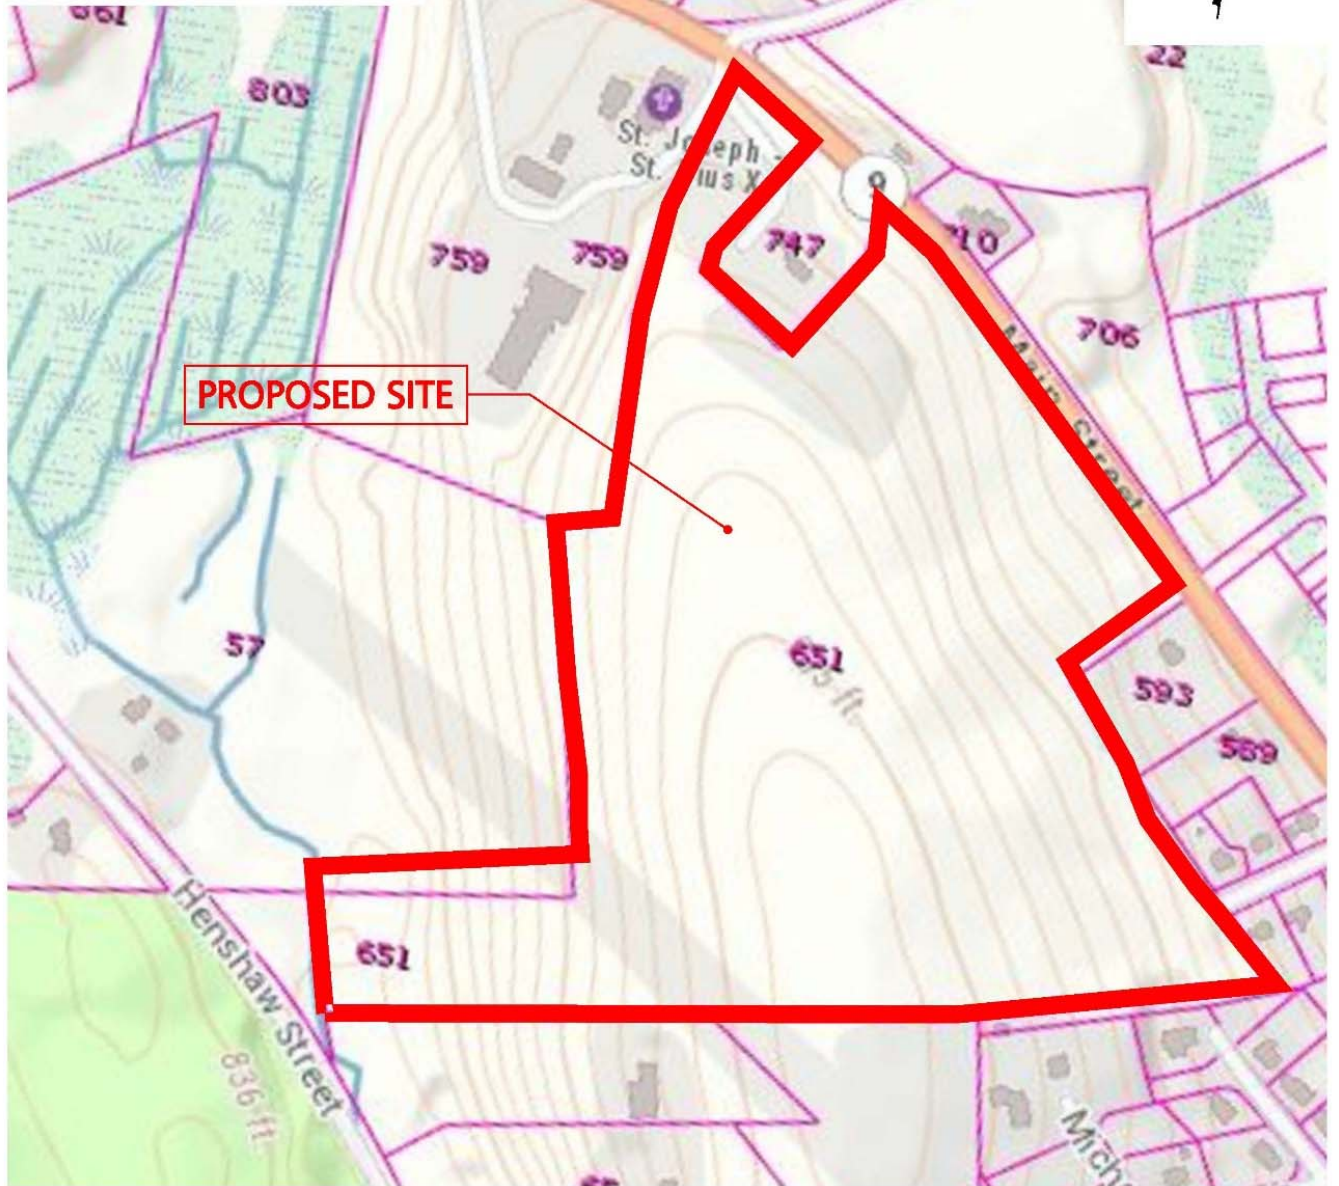

PREPARED BY:



**ALLEN & MAJOR  
ASSOCIATES, INC.**

civil engineering • land surveying environmental  
consulting • landscape architecture  
www.allenmajor.com  
100 COMMERCE WAY  
P.O. BOX 2118  
WOBURN MA 01888-0118  
TEL: (781) 935-6889  
FAX: (781) 935-2896

WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

PROJECT:

**SKYVIEW ESTATES  
MAIN STREET  
LEICESTER, MA**

Copyright © 2021 Allen & Major Associates, Inc.  
All Rights Reserved

## PRIORITY & ESTIMATED HABITATS

PROJECT NO.	2889-01	DATE:	07-16-2021
SCALE:	1"=300'	DWG. NAME:	EXHIBITS
DESIGNED BY:	JG	CHECKED BY:	MAM

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

**EX-4**








# LEGEND

NHESP Certified Vernal Pools



DEP Wetlands

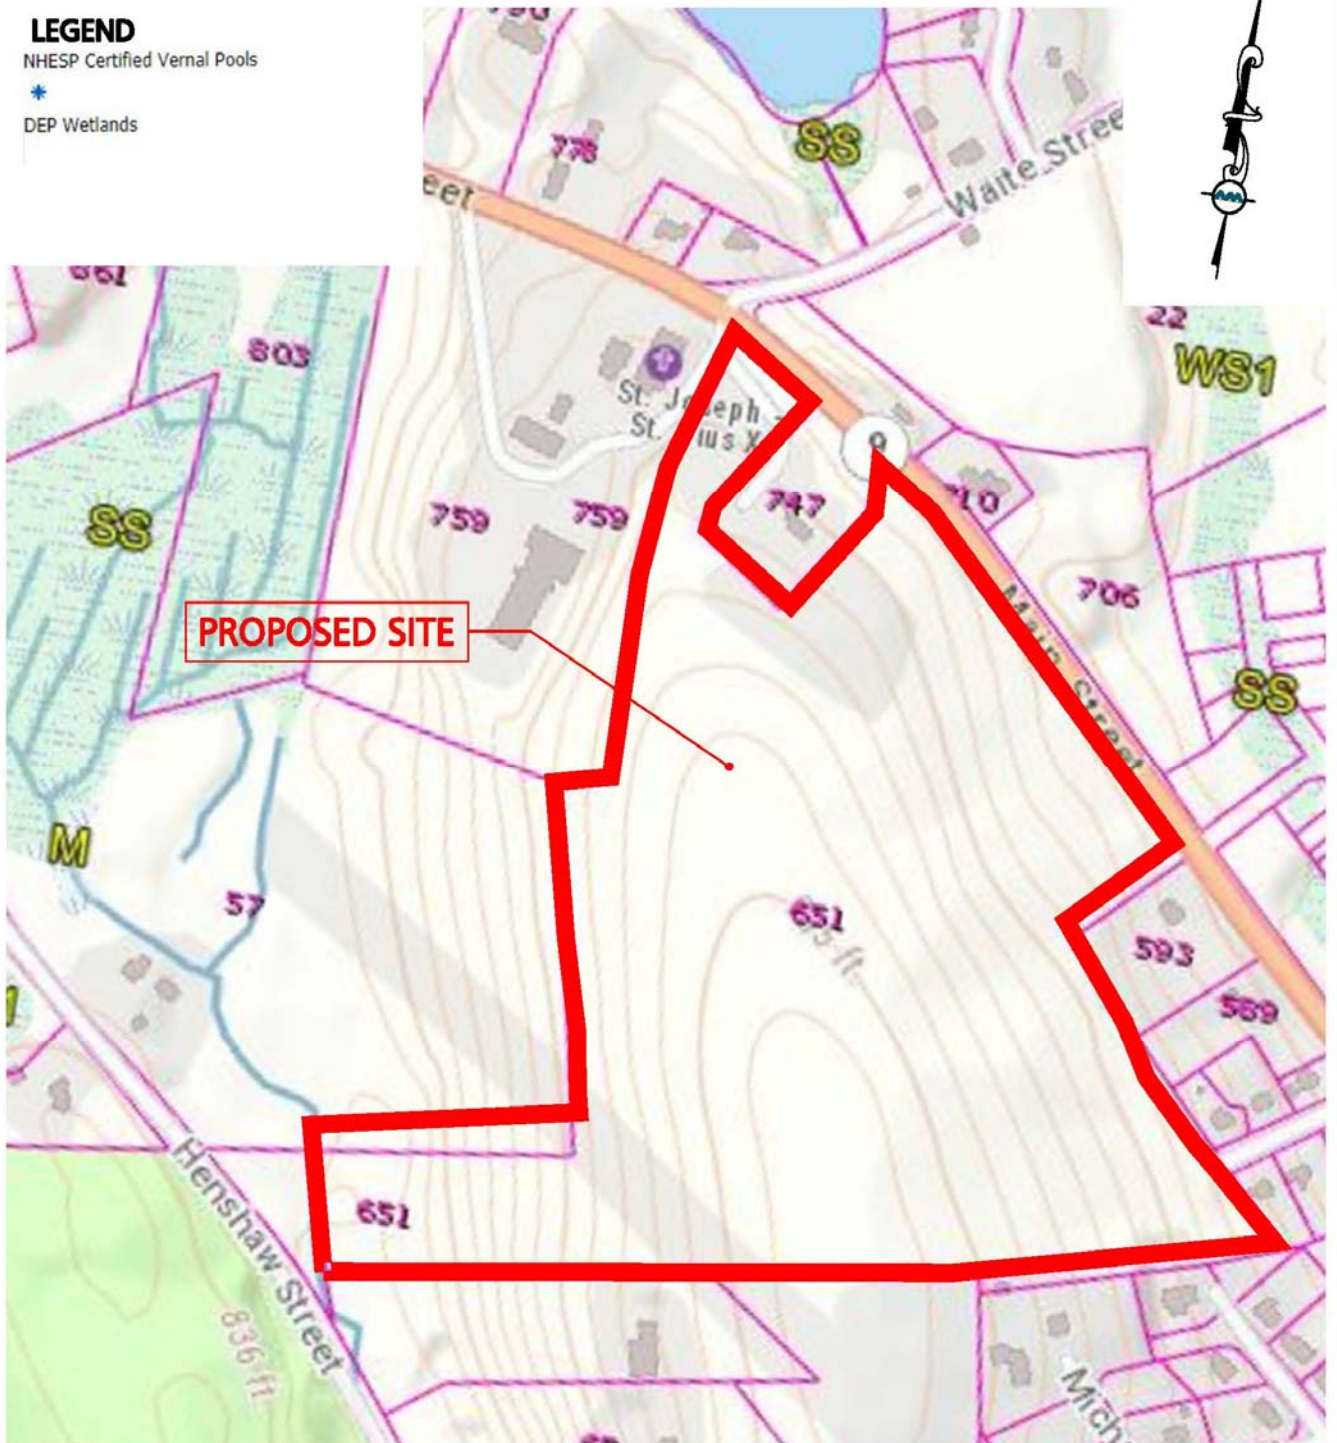

PREPARED BY:



**ALLEN & MAJOR  
ASSOCIATES, INC.**

civil engineering • land surveying environmental  
consulting • landscape architecture  
www.allenmajor.com  
100 COMMERCE WAY  
P.O. BOX 2118  
WOBURN MA 01888-0118  
TEL: (781) 935-6889  
FAX: (781) 935-2896

WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

PROJECT:

**SKYVIEW ESTATES  
MAIN STREET  
LEICESTER, MA**

Copyright © 2021 Allen & Major Associates, Inc.  
All Rights Reserved

## MA GIS WETLANDS MAP

PROJECT NO.	2889-01	DATE:	07-16-2021
SCALE:	1"=300'	DWG. NAME:	EXHIBITS
DESIGNED BY:	JG	CHECKED BY:	MAM

THIS DRAWING HAS BEEN PREPARED IN ELECTRONIC FORMAT. CLIENT/CLIENT'S REPRESENTATIVE OR CONSULTANT MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS ON MAGNETIC MEDIA FOR HIS/HER INFORMATION AND USE FOR SPECIFIC APPLICATION TO THIS PROJECT. DUE TO THE POTENTIAL THAT THE MAGNETIC INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE MAGNETIC MEDIA. PRINTED REPRESENTATIONS OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

SHEET No.

**EX-5**









## SECTION 4.0 - EXISTING DRAINAGE ANALYSIS




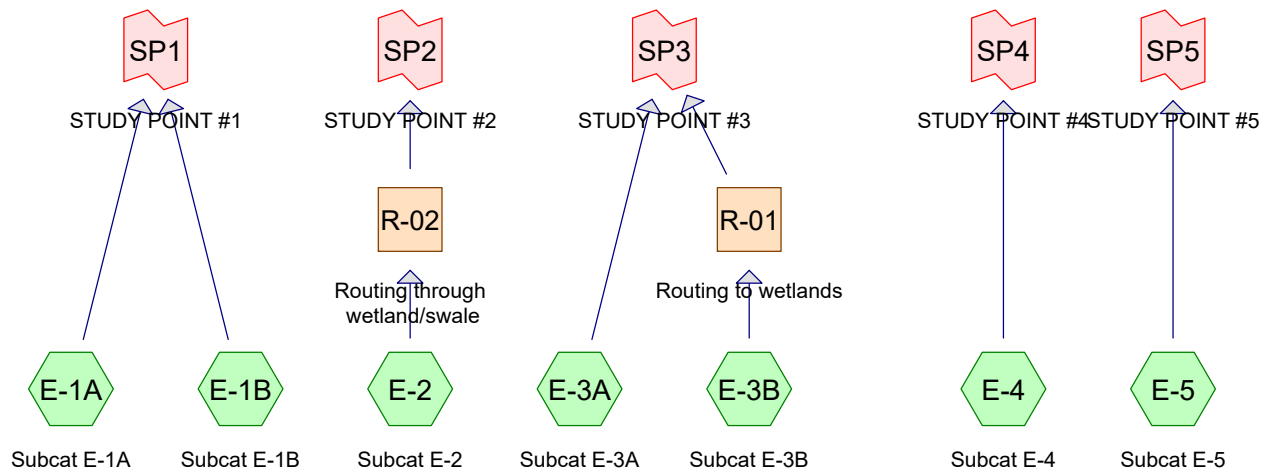

Subcat



Reach



Pond



Link

**Routing Diagram for 2889-01 - Existing HydroCAD**  
 Prepared by Allen & Major Associates, Inc., Printed 9/29/2021  
 HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

## 2889-01 - Existing HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Printed 9/29/2021

Page 2

### Rainfall Events Listing

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-year	Type III 24-hr		Default	24.00	1	3.23	2
2	10-year	Type III 24-hr		Default	24.00	1	4.85	2
3	25-year	Type III 24-hr		Default	24.00	1	6.12	2
4	50-year	Type III 24-hr		Default	24.00	1	7.30	2
5	100-year	Type III 24-hr		Default	24.00	1	8.72	2

## 2889-01 - Existing HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Printed 9/29/2021

Page 3

### Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.210	61	>75% Grass cover, Good, HSG B (E-1B, E-4)
1.474	74	>75% Grass cover, Good, HSG C (E-1A, E-1B, E-2, E-4, E-5)
2.164	65	Brush, Good, HSG C (E-2, E-3A, E-3B)
0.067	98	Paved parking, HSG B (E-1B, E-4)
0.002	98	Paved parking, HSG C (E-1B)
0.749	55	Woods, Good, HSG B (E-1A, E-1B)
24.519	70	Woods, Good, HSG C (E-1A, E-1B, E-2, E-3A, E-3B, E-4, E-5)
<b>29.185</b>	<b>69</b>	<b>TOTAL AREA</b>

## 2889-01 - Existing HydroCAD

Prepared by Allen & Major Associates, Inc.

Printed 9/29/2021

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Page 4

### Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
1.026	HSG B	E-1A, E-1B, E-4
28.159	HSG C	E-1A, E-1B, E-2, E-3A, E-3B, E-4, E-5
0.000	HSG D	
0.000	Other	
<b>29.185</b>		<b>TOTAL AREA</b>

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

Printed 9/29/2021

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Page 5

**Ground Covers (all nodes)**

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.210	1.474	0.000	0.000	1.684	>75% Grass cover, Good	E-1A, E-1B, E-2, E-4, E-5
0.000	0.000	2.164	0.000	0.000	2.164	Brush, Good	E-2, E-3A, E-3B
0.000	0.067	0.002	0.000	0.000	0.069	Paved parking	E-1B, E-4
0.000	0.749	24.519	0.000	0.000	25.268	Woods, Good	E-1A, E-1B, E-2, E-3A, E-3B, E-4, E-5
<b>0.000</b>	<b>1.026</b>	<b>28.159</b>	<b>0.000</b>	<b>0.000</b>	<b>29.185</b>	<b>TOTAL AREA</b>	

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 9/29/2021

Page 6

**Summary for Subcatchment E-1A: Subcat E-1A**

Runoff = 3.62 cfs @ 12.25 hrs, Volume= 0.399 af, Depth= 0.80"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (sf)	CN	Description
32,115	55	Woods, Good, HSG B
33,840	74	>75% Grass cover, Good, HSG C
196,179	70	Woods, Good, HSG C
262,134	69	Weighted Average
262,134		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0680	0.11		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
6.0	431	0.0570	1.19		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
0.8	126	0.1350	2.57		<b>Shallow Concentrated Flow, C-D</b> Short Grass Pasture Kv= 7.0 fps
1.4	192	0.2000	2.24		<b>Shallow Concentrated Flow, D-E</b> Woodland Kv= 5.0 fps
15.7	799	Total			

**Summary for Subcatchment E-1B: Subcat E-1B**

Runoff = 0.47 cfs @ 12.13 hrs, Volume= 0.040 af, Depth= 0.95"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (sf)	CN	Description
90	98	Paved parking, HSG C
2,609	98	Paved parking, HSG B
7,321	61	>75% Grass cover, Good, HSG B
506	55	Woods, Good, HSG B
0	70	Woods, Good, HSG C
11,330	74	>75% Grass cover, Good, HSG C
21,857	72	Weighted Average
19,157		87.65% Pervious Area
2,699		12.35% Impervious Area



**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 9/29/2021

Page 7

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			

**Summary for Subcatchment E-2: Subcat E-2**

Runoff = 5.58 cfs @ 12.42 hrs, Volume= 0.739 af, Depth= 0.85"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (sf)	CN	Description
18,004	65	Brush, Good, HSG C
1,039	74	>75% Grass cover, Good, HSG C
437,960	70	Woods, Good, HSG C
457,003	70	Weighted Average
457,003		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
21.2	50	0.0050	0.04		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
5.1	562	0.1370	1.85		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
26.3	612	Total			

**Summary for Subcatchment E-3A: Subcat E-3A**

Runoff = 3.00 cfs @ 12.31 hrs, Volume= 0.357 af, Depth= 0.80"  
 Routed to Link SP3 : STUDY POINT #3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
3.800	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.378	69	Weighted Average
5.378		100.00% Pervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 9/29/2021

Page 8

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
4.4	545	0.1700	2.06		<b>Shallow Concentrated Flow, D-E</b>
					Woodland Kv= 5.0 fps
19.2	890	Total			

**Summary for Subcatchment E-3B: Subcat E-3B**

Runoff = 2.70 cfs @ 12.23 hrs, Volume= 0.287 af, Depth= 0.85"  
 Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.172	65	Brush, Good, HSG C
3.902	70	Woods, Good, HSG C
4.074	70	Weighted Average
4.074		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.4	50	0.0380	0.09		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
5.4	517	0.1000	1.58		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
14.8	567	Total			

**Summary for Subcatchment E-4: Subcat E-4**

Runoff = 1.57 cfs @ 12.16 hrs, Volume= 0.144 af, Depth= 0.85"  
 Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.042	61	>75% Grass cover, Good, HSG B
0.007	98	Paved parking, HSG B
0.255	74	>75% Grass cover, Good, HSG C
1.744	70	Woods, Good, HSG C
2.049	70	Weighted Average
2.042		99.65% Pervious Area
0.007		0.35% Impervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 9/29/2021

Page 9

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0670	0.11		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
2.5	208	0.0770	1.39		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
10.0	258	Total			

**Summary for Subcatchment E-5: Subcat E-5**

Runoff = 0.46 cfs @ 12.26 hrs, Volume= 0.050 af, Depth= 0.90"  
 Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (sf)	CN	Description
6,877	74	>75% Grass cover, Good, HSG C
22,427	70	Woods, Good, HSG C
29,304	71	Weighted Average
29,304		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.2	50	0.0400	0.09		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
6.8	456	0.0500	1.12		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
0.5	62	0.0760	1.93		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
16.5	568	Total			

**Summary for Reach R-01: Routing to wetlands**

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 4.074 ac, 0.00% Impervious, Inflow Depth = 0.85" for 2-year event  
 Inflow = 2.70 cfs @ 12.23 hrs, Volume= 0.287 af  
 Outflow = 1.32 cfs @ 12.59 hrs, Volume= 0.287 af, Atten= 51%, Lag= 21.7 min  
 Routed to Link SP3 : STUDY POINT #3

## 2889-01 - Existing HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 9/29/2021

Page 10

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.33 fps, Min. Travel Time= 36.6 min

Avg. Velocity = 0.14 fps, Avg. Travel Time= 89.0 min

Peak Storage= 2,890 cf @ 12.59 hrs

Average Depth at Peak Storage= 0.24' , Surface Width= 28.73'


Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 50.0 '/' Top Width= 105.00'

Length= 722.0' Slope= 0.1087 '/'

Inlet Invert= 889.50', Outlet Invert= 811.00'

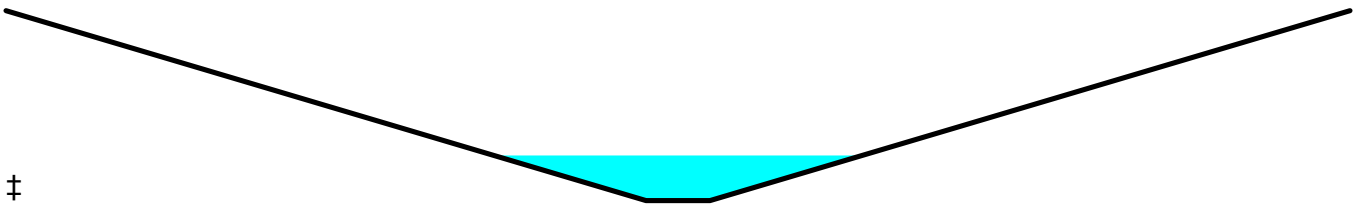

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

---

Inflow Area = 10.491 ac, 0.00% Impervious, Inflow Depth = 0.85" for 2-year event

Inflow = 5.58 cfs @ 12.42 hrs, Volume= 0.739 af

Outflow = 2.81 cfs @ 12.84 hrs, Volume= 0.738 af, Atten= 50%, Lag= 25.5 min

Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.26 fps, Min. Travel Time= 46.3 min

Avg. Velocity = 0.11 fps, Avg. Travel Time= 114.6 min

Peak Storage= 7,825 cf @ 12.84 hrs

Average Depth at Peak Storage= 0.55' , Surface Width= 28.52'


Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 24.55 cfs

10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 30.0 3.5 '/' Top Width= 60.25'

Length= 735.0' Slope= 0.0189 '/'

Inlet Invert= 877.70', Outlet Invert= 863.80'

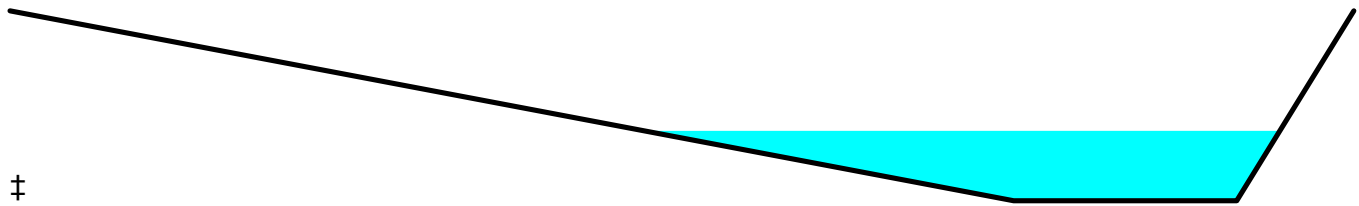**Summary for Link SP1: STUDY POINT #1**

Inflow Area = 6.520 ac, 0.95% Impervious, Inflow Depth = 0.81" for 2-year event  
Inflow = 3.95 cfs @ 12.24 hrs, Volume= 0.439 af  
Primary = 3.95 cfs @ 12.24 hrs, Volume= 0.439 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP2: STUDY POINT #2**

Inflow Area = 10.491 ac, 0.00% Impervious, Inflow Depth > 0.84" for 2-year event  
Inflow = 2.81 cfs @ 12.84 hrs, Volume= 0.738 af  
Primary = 2.81 cfs @ 12.84 hrs, Volume= 0.738 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP3: STUDY POINT #3**

Inflow Area = 9.452 ac, 0.00% Impervious, Inflow Depth > 0.82" for 2-year event  
Inflow = 3.94 cfs @ 12.35 hrs, Volume= 0.644 af  
Primary = 3.94 cfs @ 12.35 hrs, Volume= 0.644 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP4: STUDY POINT #4**

Inflow Area = 2.049 ac, 0.35% Impervious, Inflow Depth = 0.85" for 2-year event  
Inflow = 1.57 cfs @ 12.16 hrs, Volume= 0.144 af  
Primary = 1.57 cfs @ 12.16 hrs, Volume= 0.144 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP5: STUDY POINT #5**

Inflow Area = 0.673 ac, 0.00% Impervious, Inflow Depth = 0.90" for 2-year event  
Inflow = 0.46 cfs @ 12.26 hrs, Volume= 0.050 af  
Primary = 0.46 cfs @ 12.26 hrs, Volume= 0.050 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 9/29/2021

Page 12

**Summary for Subcatchment E-1A: Subcat E-1A**

Runoff = 9.32 cfs @ 12.23 hrs, Volume= 0.927 af, Depth= 1.85"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (sf)	CN	Description
32,115	55	Woods, Good, HSG B
33,840	74	>75% Grass cover, Good, HSG C
196,179	70	Woods, Good, HSG C
262,134	69	Weighted Average
262,134		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0680	0.11		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
6.0	431	0.0570	1.19		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
0.8	126	0.1350	2.57		<b>Shallow Concentrated Flow, C-D</b> Short Grass Pasture Kv= 7.0 fps
1.4	192	0.2000	2.24		<b>Shallow Concentrated Flow, D-E</b> Woodland Kv= 5.0 fps
15.7	799	Total			

**Summary for Subcatchment E-1B: Subcat E-1B**

Runoff = 1.10 cfs @ 12.12 hrs, Volume= 0.087 af, Depth= 2.08"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (sf)	CN	Description
90	98	Paved parking, HSG C
2,609	98	Paved parking, HSG B
7,321	61	>75% Grass cover, Good, HSG B
506	55	Woods, Good, HSG B
0	70	Woods, Good, HSG C
11,330	74	>75% Grass cover, Good, HSG C
21,857	72	Weighted Average
19,157		87.65% Pervious Area
2,699		12.35% Impervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 9/29/2021

Page 13

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			

**Summary for Subcatchment E-2: Subcat E-2**

Runoff = 13.83 cfs @ 12.39 hrs, Volume= 1.684 af, Depth= 1.93"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (sf)	CN	Description
18,004	65	Brush, Good, HSG C
1,039	74	>75% Grass cover, Good, HSG C
437,960	70	Woods, Good, HSG C
457,003	70	Weighted Average
457,003		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
21.2	50	0.0050	0.04		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
5.1	562	0.1370	1.85		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
26.3	612	Total			

**Summary for Subcatchment E-3A: Subcat E-3A**

Runoff = 7.71 cfs @ 12.28 hrs, Volume= 0.829 af, Depth= 1.85"  
 Routed to Link SP3 : STUDY POINT #3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
3.800	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.378	69	Weighted Average
5.378		100.00% Pervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 9/29/2021

Page 14

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
4.4	545	0.1700	2.06		<b>Shallow Concentrated Flow, D-E</b>
					Woodland Kv= 5.0 fps
19.2	890	Total			

**Summary for Subcatchment E-3B: Subcat E-3B**

Runoff = 6.79 cfs @ 12.22 hrs, Volume= 0.654 af, Depth= 1.93"  
 Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.172	65	Brush, Good, HSG C
3.902	70	Woods, Good, HSG C
4.074	70	Weighted Average
4.074		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.4	50	0.0380	0.09		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
5.4	517	0.1000	1.58		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
14.8	567	Total			

**Summary for Subcatchment E-4: Subcat E-4**

Runoff = 3.91 cfs @ 12.15 hrs, Volume= 0.329 af, Depth= 1.93"  
 Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.042	61	>75% Grass cover, Good, HSG B
0.007	98	Paved parking, HSG B
0.255	74	>75% Grass cover, Good, HSG C
1.744	70	Woods, Good, HSG C
2.049	70	Weighted Average
2.042		99.65% Pervious Area
0.007		0.35% Impervious Area



**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 9/29/2021

Page 15

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0670	0.11		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
2.5	208	0.0770	1.39		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
10.0	258	Total			

**Summary for Subcatchment E-5: Subcat E-5**

Runoff = 1.12 cfs @ 12.24 hrs, Volume= 0.112 af, Depth= 2.00"  
 Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (sf)	CN	Description
6,877	74	>75% Grass cover, Good, HSG C
22,427	70	Woods, Good, HSG C
29,304	71	Weighted Average
29,304		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.2	50	0.0400	0.09		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
6.8	456	0.0500	1.12		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
0.5	62	0.0760	1.93		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
16.5	568	Total			

**Summary for Reach R-01: Routing to wetlands**

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 4.074 ac, 0.00% Impervious, Inflow Depth = 1.93" for 10-year event  
 Inflow = 6.79 cfs @ 12.22 hrs, Volume= 0.654 af  
 Outflow = 3.84 cfs @ 12.49 hrs, Volume= 0.654 af, Atten= 43%, Lag= 16.6 min  
 Routed to Link SP3 : STUDY POINT #3

## 2889-01 - Existing HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 9/29/2021

Page 16

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.43 fps, Min. Travel Time= 27.9 min

Avg. Velocity = 0.16 fps, Avg. Travel Time= 76.2 min

Peak Storage= 6,423 cf @ 12.49 hrs

Average Depth at Peak Storage= 0.37' , Surface Width= 42.47'


Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 50.0 ' / ' Top Width= 105.00'

Length= 722.0' Slope= 0.1087 ' / '

Inlet Invert= 889.50', Outlet Invert= 811.00'

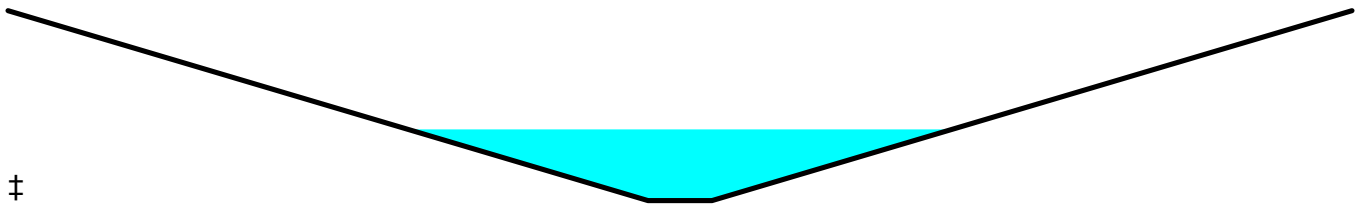

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 10.491 ac, 0.00% Impervious, Inflow Depth = 1.93" for 10-year event

Inflow = 13.83 cfs @ 12.39 hrs, Volume= 1.684 af

Outflow = 8.34 cfs @ 12.72 hrs, Volume= 1.682 af, Atten= 40%, Lag= 19.8 min

Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.35 fps, Min. Travel Time= 34.7 min

Avg. Velocity = 0.13 fps, Avg. Travel Time= 96.0 min

Peak Storage= 17,368 cf @ 12.72 hrs

Average Depth at Peak Storage= 0.93' , Surface Width= 41.03'


Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 24.55 cfs

10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 30.0 3.5 ' / ' Top Width= 60.25'

Length= 735.0' Slope= 0.0189 ' / '

Inlet Invert= 877.70', Outlet Invert= 863.80'

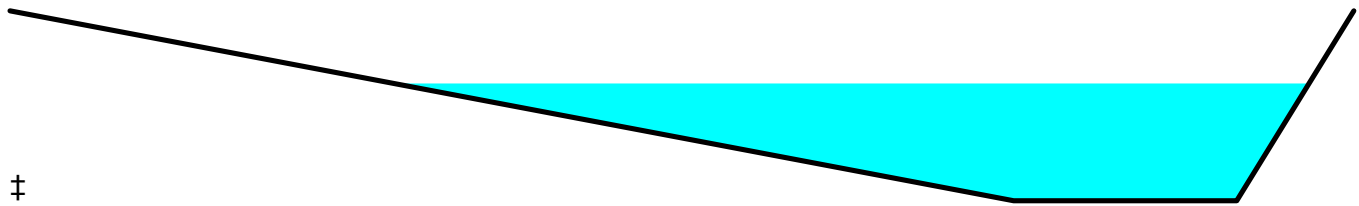**Summary for Link SP1: STUDY POINT #1**

Inflow Area = 6.520 ac, 0.95% Impervious, Inflow Depth = 1.87" for 10-year event  
Inflow = 10.15 cfs @ 12.22 hrs, Volume= 1.014 af  
Primary = 10.15 cfs @ 12.22 hrs, Volume= 1.014 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP2: STUDY POINT #2**

Inflow Area = 10.491 ac, 0.00% Impervious, Inflow Depth > 1.92" for 10-year event  
Inflow = 8.34 cfs @ 12.72 hrs, Volume= 1.682 af  
Primary = 8.34 cfs @ 12.72 hrs, Volume= 1.682 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP3: STUDY POINT #3**

Inflow Area = 9.452 ac, 0.00% Impervious, Inflow Depth = 1.88" for 10-year event  
Inflow = 10.91 cfs @ 12.32 hrs, Volume= 1.482 af  
Primary = 10.91 cfs @ 12.32 hrs, Volume= 1.482 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP4: STUDY POINT #4**

Inflow Area = 2.049 ac, 0.35% Impervious, Inflow Depth = 1.93" for 10-year event  
Inflow = 3.91 cfs @ 12.15 hrs, Volume= 0.329 af  
Primary = 3.91 cfs @ 12.15 hrs, Volume= 0.329 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP5: STUDY POINT #5**

Inflow Area = 0.673 ac, 0.00% Impervious, Inflow Depth = 2.00" for 10-year event  
Inflow = 1.12 cfs @ 12.24 hrs, Volume= 0.112 af  
Primary = 1.12 cfs @ 12.24 hrs, Volume= 0.112 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 9/29/2021

Page 18

**Summary for Subcatchment E-1A: Subcat E-1A**

Runoff = 14.52 cfs @ 12.22 hrs, Volume= 1.407 af, Depth= 2.81"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (sf)	CN	Description
32,115	55	Woods, Good, HSG B
33,840	74	>75% Grass cover, Good, HSG C
196,179	70	Woods, Good, HSG C
262,134	69	Weighted Average
262,134		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0680	0.11		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
6.0	431	0.0570	1.19		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
0.8	126	0.1350	2.57		<b>Shallow Concentrated Flow, C-D</b> Short Grass Pasture Kv= 7.0 fps
1.4	192	0.2000	2.24		<b>Shallow Concentrated Flow, D-E</b> Woodland Kv= 5.0 fps
15.7	799	Total			

**Summary for Subcatchment E-1B: Subcat E-1B**

Runoff = 1.66 cfs @ 12.12 hrs, Volume= 0.129 af, Depth= 3.09"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (sf)	CN	Description
90	98	Paved parking, HSG C
2,609	98	Paved parking, HSG B
7,321	61	>75% Grass cover, Good, HSG B
506	55	Woods, Good, HSG B
0	70	Woods, Good, HSG C
11,330	74	>75% Grass cover, Good, HSG C
21,857	72	Weighted Average
19,157		87.65% Pervious Area
2,699		12.35% Impervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 9/29/2021

Page 19

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			

**Summary for Subcatchment E-2: Subcat E-2**

Runoff = 21.23 cfs @ 12.37 hrs, Volume= 2.536 af, Depth= 2.90"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (sf)	CN	Description
18,004	65	Brush, Good, HSG C
1,039	74	>75% Grass cover, Good, HSG C
437,960	70	Woods, Good, HSG C
457,003	70	Weighted Average
457,003		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
21.2	50	0.0050	0.04		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
5.1	562	0.1370	1.85		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
26.3	612	Total			

**Summary for Subcatchment E-3A: Subcat E-3A**

Runoff = 11.99 cfs @ 12.27 hrs, Volume= 1.258 af, Depth= 2.81"  
 Routed to Link SP3 : STUDY POINT #3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
3.800	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.378	69	Weighted Average
5.378		100.00% Pervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 9/29/2021

Page 20

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
4.4	545	0.1700	2.06		<b>Shallow Concentrated Flow, D-E</b>
					Woodland Kv= 5.0 fps
19.2	890	Total			

**Summary for Subcatchment E-3B: Subcat E-3B**

Runoff = 10.42 cfs @ 12.21 hrs, Volume= 0.985 af, Depth= 2.90"  
 Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.172	65	Brush, Good, HSG C
3.902	70	Woods, Good, HSG C
4.074	70	Weighted Average
4.074		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.4	50	0.0380	0.09		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
5.4	517	0.1000	1.58		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
14.8	567	Total			

**Summary for Subcatchment E-4: Subcat E-4**

Runoff = 5.98 cfs @ 12.15 hrs, Volume= 0.495 af, Depth= 2.90"  
 Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.042	61	>75% Grass cover, Good, HSG B
0.007	98	Paved parking, HSG B
0.255	74	>75% Grass cover, Good, HSG C
1.744	70	Woods, Good, HSG C
2.049	70	Weighted Average
2.042		99.65% Pervious Area
0.007		0.35% Impervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 9/29/2021

Page 21

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0670	0.11		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
2.5	208	0.0770	1.39		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
10.0	258	Total			

**Summary for Subcatchment E-5: Subcat E-5**

Runoff = 1.70 cfs @ 12.23 hrs, Volume= 0.168 af, Depth= 3.00"  
 Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (sf)	CN	Description
6,877	74	>75% Grass cover, Good, HSG C
22,427	70	Woods, Good, HSG C
29,304	71	Weighted Average
29,304		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.2	50	0.0400	0.09		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
6.8	456	0.0500	1.12		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
0.5	62	0.0760	1.93		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
16.5	568	Total			

**Summary for Reach R-01: Routing to wetlands**

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 4.074 ac, 0.00% Impervious, Inflow Depth = 2.90" for 25-year event  
 Inflow = 10.42 cfs @ 12.21 hrs, Volume= 0.985 af  
 Outflow = 6.28 cfs @ 12.45 hrs, Volume= 0.985 af, Atten= 40%, Lag= 14.4 min  
 Routed to Link SP3 : STUDY POINT #3

## 2889-01 - Existing HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 9/29/2021

Page 22

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.49 fps, Min. Travel Time= 24.6 min

Avg. Velocity = 0.17 fps, Avg. Travel Time= 70.1 min

Peak Storage= 9,269 cf @ 12.45 hrs

Average Depth at Peak Storage= 0.46' , Surface Width= 50.92'


Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 50.0 '/' Top Width= 105.00'

Length= 722.0' Slope= 0.1087 '/'

Inlet Invert= 889.50', Outlet Invert= 811.00'

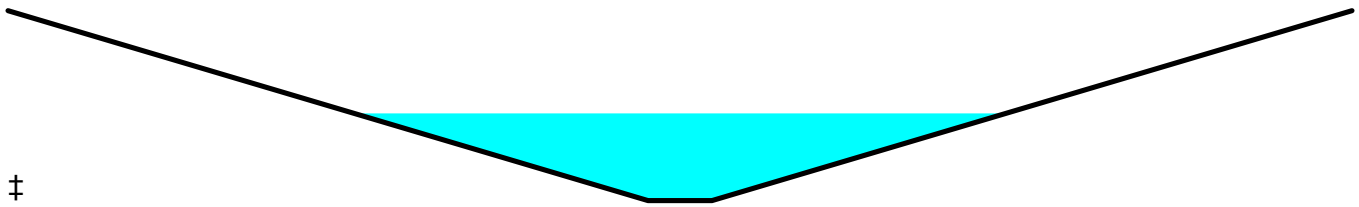

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

---

Inflow Area =	10.491 ac,	0.00% Impervious,	Inflow Depth = 2.90"	for 25-year event
Inflow =	21.23 cfs @ 12.37 hrs,	Volume=	2.536 af	
Outflow =	13.67 cfs @ 12.67 hrs,	Volume=	2.534 af,	Atten= 36%, Lag= 17.8 min

Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.40 fps, Min. Travel Time= 30.6 min

Avg. Velocity = 0.14 fps, Avg. Travel Time= 87.5 min

Peak Storage= 25,053 cf @ 12.67 hrs

Average Depth at Peak Storage= 1.16' , Surface Width= 48.82'

Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 24.55 cfs


10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 30.0 3.5 '/' Top Width= 60.25'

Length= 735.0' Slope= 0.0189 '/'

Inlet Invert= 877.70', Outlet Invert= 863.80'

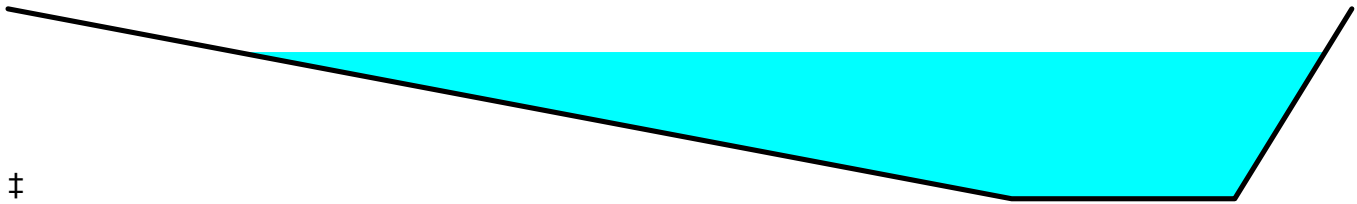

**Summary for Link SP1: STUDY POINT #1**

Inflow Area = 6.520 ac, 0.95% Impervious, Inflow Depth = 2.83" for 25-year event  
Inflow = 15.72 cfs @ 12.22 hrs, Volume= 1.537 af  
Primary = 15.72 cfs @ 12.22 hrs, Volume= 1.537 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP2: STUDY POINT #2**

Inflow Area = 10.491 ac, 0.00% Impervious, Inflow Depth > 2.90" for 25-year event  
Inflow = 13.67 cfs @ 12.67 hrs, Volume= 2.534 af  
Primary = 13.67 cfs @ 12.67 hrs, Volume= 2.534 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP3: STUDY POINT #3**

Inflow Area = 9.452 ac, 0.00% Impervious, Inflow Depth = 2.85" for 25-year event  
Inflow = 17.41 cfs @ 12.31 hrs, Volume= 2.243 af  
Primary = 17.41 cfs @ 12.31 hrs, Volume= 2.243 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP4: STUDY POINT #4**

Inflow Area = 2.049 ac, 0.35% Impervious, Inflow Depth = 2.90" for 25-year event  
Inflow = 5.98 cfs @ 12.15 hrs, Volume= 0.495 af  
Primary = 5.98 cfs @ 12.15 hrs, Volume= 0.495 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP5: STUDY POINT #5**

Inflow Area = 0.673 ac, 0.00% Impervious, Inflow Depth = 3.00" for 25-year event  
Inflow = 1.70 cfs @ 12.23 hrs, Volume= 0.168 af  
Primary = 1.70 cfs @ 12.23 hrs, Volume= 0.168 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 9/29/2021

Page 24

**Summary for Subcatchment E-1A: Subcat E-1A**

Runoff = 19.62 cfs @ 12.22 hrs, Volume= 1.886 af, Depth= 3.76"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (sf)	CN	Description
32,115	55	Woods, Good, HSG B
33,840	74	>75% Grass cover, Good, HSG C
196,179	70	Woods, Good, HSG C
262,134	69	Weighted Average
262,134		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0680	0.11		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
6.0	431	0.0570	1.19		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
0.8	126	0.1350	2.57		<b>Shallow Concentrated Flow, C-D</b> Short Grass Pasture Kv= 7.0 fps
1.4	192	0.2000	2.24		<b>Shallow Concentrated Flow, D-E</b> Woodland Kv= 5.0 fps
15.7	799	Total			

**Summary for Subcatchment E-1B: Subcat E-1B**

Runoff = 2.20 cfs @ 12.12 hrs, Volume= 0.171 af, Depth= 4.09"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (sf)	CN	Description
90	98	Paved parking, HSG C
2,609	98	Paved parking, HSG B
7,321	61	>75% Grass cover, Good, HSG B
506	55	Woods, Good, HSG B
0	70	Woods, Good, HSG C
11,330	74	>75% Grass cover, Good, HSG C
21,857	72	Weighted Average
19,157		87.65% Pervious Area
2,699		12.35% Impervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 9/29/2021

Page 25

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			

**Summary for Subcatchment E-2: Subcat E-2**

Runoff = 28.49 cfs @ 12.37 hrs, Volume= 3.383 af, Depth= 3.87"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (sf)	CN	Description
18,004	65	Brush, Good, HSG C
1,039	74	>75% Grass cover, Good, HSG C
437,960	70	Woods, Good, HSG C
457,003	70	Weighted Average
457,003		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
21.2	50	0.0050	0.04		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
5.1	562	0.1370	1.85		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
26.3	612	Total			

**Summary for Subcatchment E-3A: Subcat E-3A**

Runoff = 16.19 cfs @ 12.27 hrs, Volume= 1.686 af, Depth= 3.76"  
 Routed to Link SP3 : STUDY POINT #3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
3.800	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.378	69	Weighted Average
5.378		100.00% Pervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 9/29/2021

Page 26

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
4.4	545	0.1700	2.06		<b>Shallow Concentrated Flow, D-E</b>
					Woodland Kv= 5.0 fps
19.2	890	Total			

**Summary for Subcatchment E-3B: Subcat E-3B**

Runoff = 13.99 cfs @ 12.21 hrs, Volume= 1.314 af, Depth= 3.87"  
 Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.172	65	Brush, Good, HSG C
3.902	70	Woods, Good, HSG C
4.074	70	Weighted Average
4.074		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.4	50	0.0380	0.09		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
5.4	517	0.1000	1.58		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
14.8	567	Total			

**Summary for Subcatchment E-4: Subcat E-4**

Runoff = 8.02 cfs @ 12.15 hrs, Volume= 0.661 af, Depth= 3.87"  
 Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.042	61	>75% Grass cover, Good, HSG B
0.007	98	Paved parking, HSG B
0.255	74	>75% Grass cover, Good, HSG C
1.744	70	Woods, Good, HSG C
2.049	70	Weighted Average
2.042		99.65% Pervious Area
0.007		0.35% Impervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 9/29/2021

Page 27

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0670	0.11		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
2.5	208	0.0770	1.39		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
10.0	258	Total			

**Summary for Subcatchment E-5: Subcat E-5**

Runoff = 2.27 cfs @ 12.23 hrs, Volume= 0.223 af, Depth= 3.98"  
 Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (sf)	CN	Description
6,877	74	>75% Grass cover, Good, HSG C
22,427	70	Woods, Good, HSG C
29,304	71	Weighted Average
29,304		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.2	50	0.0400	0.09		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
6.8	456	0.0500	1.12		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
0.5	62	0.0760	1.93		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
16.5	568	Total			

**Summary for Reach R-01: Routing to wetlands**

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 4.074 ac, 0.00% Impervious, Inflow Depth = 3.87" for 50-year event  
 Inflow = 13.99 cfs @ 12.21 hrs, Volume= 1.314 af  
 Outflow = 8.76 cfs @ 12.42 hrs, Volume= 1.314 af, Atten= 37%, Lag= 13.0 min  
 Routed to Link SP3 : STUDY POINT #3

## 2889-01 - Existing HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 9/29/2021

Page 28

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.53 fps, Min. Travel Time= 22.7 min

Avg. Velocity = 0.18 fps, Avg. Travel Time= 66.0 min

Peak Storage= 11,895 cf @ 12.42 hrs

Average Depth at Peak Storage= 0.53' , Surface Width= 57.62'


Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 50.0 ' / ' Top Width= 105.00'

Length= 722.0' Slope= 0.1087 ' / '

Inlet Invert= 889.50', Outlet Invert= 811.00'

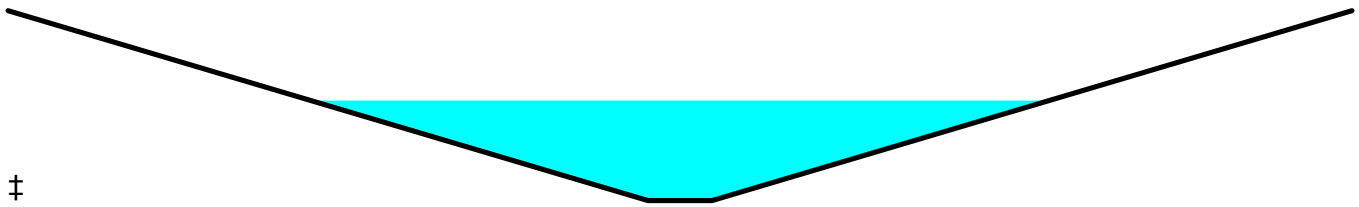

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

[55] Hint: Peak inflow is 116% of Manning's capacity

Inflow Area = 10.491 ac, 0.00% Impervious, Inflow Depth = 3.87" for 50-year event

Inflow = 28.49 cfs @ 12.37 hrs, Volume= 3.383 af

Outflow = 19.08 cfs @ 12.65 hrs, Volume= 3.381 af, Atten= 33%, Lag= 16.6 min

Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.44 fps, Min. Travel Time= 28.0 min

Avg. Velocity = 0.15 fps, Avg. Travel Time= 82.0 min

Peak Storage= 32,102 cf @ 12.65 hrs

Average Depth at Peak Storage= 1.34' , Surface Width= 55.01'


Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 24.55 cfs

10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 30.0 3.5 ' / ' Top Width= 60.25'

Length= 735.0' Slope= 0.0189 ' / '

Inlet Invert= 877.70', Outlet Invert= 863.80'

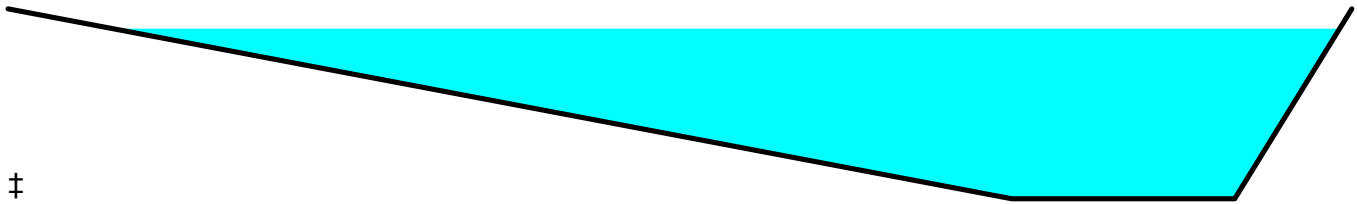**Summary for Link SP1: STUDY POINT #1**

Inflow Area = 6.520 ac, 0.95% Impervious, Inflow Depth = 3.79" for 50-year event  
Inflow = 21.20 cfs @ 12.21 hrs, Volume= 2.057 af  
Primary = 21.20 cfs @ 12.21 hrs, Volume= 2.057 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP2: STUDY POINT #2**

Inflow Area = 10.491 ac, 0.00% Impervious, Inflow Depth > 3.87" for 50-year event  
Inflow = 19.08 cfs @ 12.65 hrs, Volume= 3.381 af  
Primary = 19.08 cfs @ 12.65 hrs, Volume= 3.381 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP3: STUDY POINT #3**

Inflow Area = 9.452 ac, 0.00% Impervious, Inflow Depth = 3.81" for 50-year event  
Inflow = 23.93 cfs @ 12.30 hrs, Volume= 2.999 af  
Primary = 23.93 cfs @ 12.30 hrs, Volume= 2.999 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP4: STUDY POINT #4**

Inflow Area = 2.049 ac, 0.35% Impervious, Inflow Depth = 3.87" for 50-year event  
Inflow = 8.02 cfs @ 12.15 hrs, Volume= 0.661 af  
Primary = 8.02 cfs @ 12.15 hrs, Volume= 0.661 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP5: STUDY POINT #5**

Inflow Area = 0.673 ac, 0.00% Impervious, Inflow Depth = 3.98" for 50-year event  
Inflow = 2.27 cfs @ 12.23 hrs, Volume= 0.223 af  
Primary = 2.27 cfs @ 12.23 hrs, Volume= 0.223 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 9/29/2021

Page 30

**Summary for Subcatchment E-1A: Subcat E-1A**

Runoff = 25.97 cfs @ 12.22 hrs, Volume= 2.491 af, Depth= 4.97"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (sf)	CN	Description
32,115	55	Woods, Good, HSG B
33,840	74	>75% Grass cover, Good, HSG C
196,179	70	Woods, Good, HSG C
262,134	69	Weighted Average
262,134		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0680	0.11		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
6.0	431	0.0570	1.19		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
0.8	126	0.1350	2.57		<b>Shallow Concentrated Flow, C-D</b> Short Grass Pasture Kv= 7.0 fps
1.4	192	0.2000	2.24		<b>Shallow Concentrated Flow, D-E</b> Woodland Kv= 5.0 fps
15.7	799	Total			

**Summary for Subcatchment E-1B: Subcat E-1B**

Runoff = 2.86 cfs @ 12.12 hrs, Volume= 0.223 af, Depth= 5.33"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (sf)	CN	Description
90	98	Paved parking, HSG C
2,609	98	Paved parking, HSG B
7,321	61	>75% Grass cover, Good, HSG B
506	55	Woods, Good, HSG B
0	70	Woods, Good, HSG C
11,330	74	>75% Grass cover, Good, HSG C
21,857	72	Weighted Average
19,157		87.65% Pervious Area
2,699		12.35% Impervious Area



**2889-01 - Existing HydroCAD**

Type III 24-hr 100-year Rainfall=8.72"

Prepared by Allen &amp; Major Associates, Inc.

Printed 9/29/2021

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Page 31

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			

**Summary for Subcatchment E-2: Subcat E-2**

Runoff = 37.51 cfs @ 12.36 hrs, Volume= 4.449 af, Depth= 5.09"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (sf)	CN	Description
18,004	65	Brush, Good, HSG C
1,039	74	>75% Grass cover, Good, HSG C
437,960	70	Woods, Good, HSG C
457,003	70	Weighted Average
457,003		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
21.2	50	0.0050	0.04		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
5.1	562	0.1370	1.85		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
26.3	612	Total			

**Summary for Subcatchment E-3A: Subcat E-3A**

Runoff = 21.44 cfs @ 12.27 hrs, Volume= 2.226 af, Depth= 4.97"  
 Routed to Link SP3 : STUDY POINT #3

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
3.800	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.378	69	Weighted Average
5.378		100.00% Pervious Area

**2889-01 - Existing HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 9/29/2021

Page 32

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b> Short Grass Pasture Kv= 7.0 fps
4.4	545	0.1700	2.06		<b>Shallow Concentrated Flow, D-E</b> Woodland Kv= 5.0 fps
19.2	890	Total			

**Summary for Subcatchment E-3B: Subcat E-3B**

Runoff = 18.41 cfs @ 12.21 hrs, Volume= 1.728 af, Depth= 5.09"  
 Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.172	65	Brush, Good, HSG C
3.902	70	Woods, Good, HSG C
4.074	70	Weighted Average
4.074		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.4	50	0.0380	0.09		<b>Sheet Flow, A-B</b> Woods: Light underbrush n= 0.400 P2= 3.28"
5.4	517	0.1000	1.58		<b>Shallow Concentrated Flow, B-C</b> Woodland Kv= 5.0 fps
14.8	567	Total			

**Summary for Subcatchment E-4: Subcat E-4**

Runoff = 10.55 cfs @ 12.14 hrs, Volume= 0.869 af, Depth= 5.09"  
 Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.042	61	>75% Grass cover, Good, HSG B
0.007	98	Paved parking, HSG B
0.255	74	>75% Grass cover, Good, HSG C
1.744	70	Woods, Good, HSG C
2.049	70	Weighted Average
2.042		99.65% Pervious Area
0.007		0.35% Impervious Area

**2889-01 - Existing HydroCAD**

Type III 24-hr 100-year Rainfall=8.72"

Prepared by Allen &amp; Major Associates, Inc.

Printed 9/29/2021

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Page 33

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0670	0.11		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
2.5	208	0.0770	1.39		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
10.0	258	Total			

**Summary for Subcatchment E-5: Subcat E-5**

Runoff = 2.98 cfs @ 12.23 hrs, Volume= 0.292 af, Depth= 5.21"  
 Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (sf)	CN	Description
6,877	74	>75% Grass cover, Good, HSG C
22,427	70	Woods, Good, HSG C
29,304	71	Weighted Average
29,304		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.2	50	0.0400	0.09		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
6.8	456	0.0500	1.12		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
0.5	62	0.0760	1.93		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
16.5	568	Total			

**Summary for Reach R-01: Routing to wetlands**

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 4.074 ac, 0.00% Impervious, Inflow Depth = 5.09" for 100-year event  
 Inflow = 18.41 cfs @ 12.21 hrs, Volume= 1.728 af  
 Outflow = 11.93 cfs @ 12.41 hrs, Volume= 1.728 af, Atten= 35%, Lag= 12.0 min  
 Routed to Link SP3 : STUDY POINT #3

## 2889-01 - Existing HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 9/29/2021

Page 34

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.57 fps, Min. Travel Time= 20.9 min

Avg. Velocity = 0.19 fps, Avg. Travel Time= 62.3 min

Peak Storage= 14,989 cf @ 12.41 hrs

Average Depth at Peak Storage= 0.60' , Surface Width= 64.63'


Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 50.0 '/' Top Width= 105.00'

Length= 722.0' Slope= 0.1087 '/'

Inlet Invert= 889.50', Outlet Invert= 811.00'

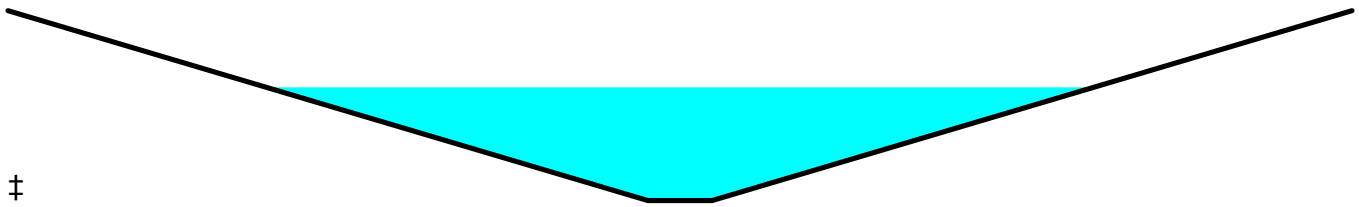

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

[91] Warning: Storage range exceeded by 0.04'

[55] Hint: Peak inflow is 153% of Manning's capacity

Inflow Area = 10.491 ac, 0.00% Impervious, Inflow Depth = 5.09" for 100-year event

Inflow = 37.51 cfs @ 12.36 hrs, Volume= 4.449 af

Outflow = 25.99 cfs @ 12.62 hrs, Volume= 4.447 af, Atten= 31%, Lag= 15.4 min

Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Max. Velocity= 0.47 fps, Min. Travel Time= 25.9 min

Avg. Velocity = 0.16 fps, Avg. Travel Time= 77.0 min

Peak Storage= 40,416 cf @ 12.62 hrs

Average Depth at Peak Storage= 1.54' , Surface Width= 61.53'

Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 24.55 cfs

10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush

Side Slope Z-value= 30.0 3.5 '/' Top Width= 60.25'

Length= 735.0' Slope= 0.0189 '/'

Inlet Invert= 877.70', Outlet Invert= 863.80'

## 2889-01 - Existing HydroCAD


Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02947 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 9/29/2021

Page 35

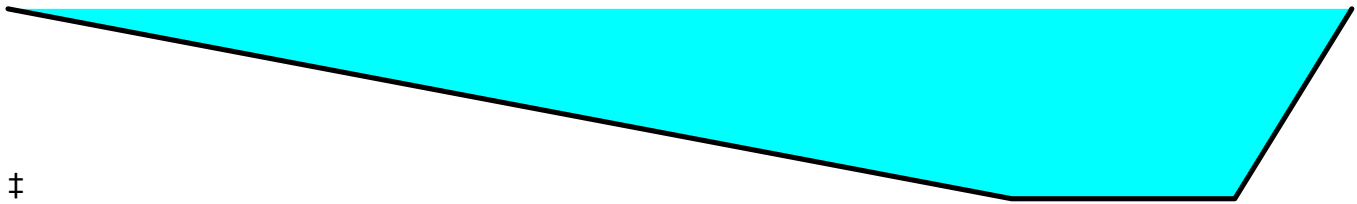

### Summary for Link SP1: STUDY POINT #1

Inflow Area = 6.520 ac, 0.95% Impervious, Inflow Depth = 5.00" for 100-year event  
Inflow = 28.02 cfs @ 12.21 hrs, Volume= 2.714 af  
Primary = 28.02 cfs @ 12.21 hrs, Volume= 2.714 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP2: STUDY POINT #2

Inflow Area = 10.491 ac, 0.00% Impervious, Inflow Depth > 5.09" for 100-year event  
Inflow = 25.99 cfs @ 12.62 hrs, Volume= 4.447 af  
Primary = 25.99 cfs @ 12.62 hrs, Volume= 4.447 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP3: STUDY POINT #3

Inflow Area = 9.452 ac, 0.00% Impervious, Inflow Depth = 5.02" for 100-year event  
Inflow = 32.17 cfs @ 12.30 hrs, Volume= 3.954 af  
Primary = 32.17 cfs @ 12.30 hrs, Volume= 3.954 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP4: STUDY POINT #4

Inflow Area = 2.049 ac, 0.35% Impervious, Inflow Depth = 5.09" for 100-year event  
Inflow = 10.55 cfs @ 12.14 hrs, Volume= 0.869 af  
Primary = 10.55 cfs @ 12.14 hrs, Volume= 0.869 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP5: STUDY POINT #5

Inflow Area = 0.673 ac, 0.00% Impervious, Inflow Depth = 5.21" for 100-year event  
Inflow = 2.98 cfs @ 12.23 hrs, Volume= 0.292 af  
Primary = 2.98 cfs @ 12.23 hrs, Volume= 0.292 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs



## Existing Watershed Plan



R:\PROJECTS\2889-01\CIVIL\DRAWINGS\CURRENT\G-2889-01\_WATERSHED-EXISTING.DWG



REV	DATE	DESCRIPTION

APPLICANT:  
MKEP 770 LLC  
265 SUNRISE HIGHWAY, SUITE 1368  
ROCKVILLE CENTER, NY 11570

PROJECT:  
SKYVIEW ESTATES  
RESIDENTIAL DEVELOPMENT  
MAIN STREET  
LEICESTER, MA

PROJECT NO. 2889-01 DATE: 10-05-21

SCALE: 1" = 80' DWG.: C288901\_Watershed-Existing

DESIGNED BY: SM CHECKED BY: MAM

PREPARED BY:

**ALLEN & MAJOR ASSOCIATES, INC.**  
civil engineering • land surveying  
environmental consulting • landscape architecture  
www.allenmajor.com  
100 COMMERCE WAY, SUITE 5  
WOBURN MA 01801  
TEL: (781) 935-6889  
FAX: (781) 935-2896

WOBURN, MA • LAKEVILLE, MA • MANCHESTER, NH

THIS DRAWING HAS BEEN PREPARED IN DIGITAL FORMAT. CLIENT/CUSTOMER'S REPRESENTATIVE OR CONSULTANTS MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS FOR HIS/HER INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT. DUE TO THE POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE DIGITAL MEDIA. PRINTED REPRESENTATIONS OR PORTABLE DOCUMENT FORMAT OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.

DRAWING TITLE: EXISTING WATERSHED PLAN SHEET No. WS-1

Copyright © 2021 Allen & Major Associates, Inc.  
All Rights Reserved










## SECTION 5.0 - PROPOSED DRAINAGE ANALYSIS



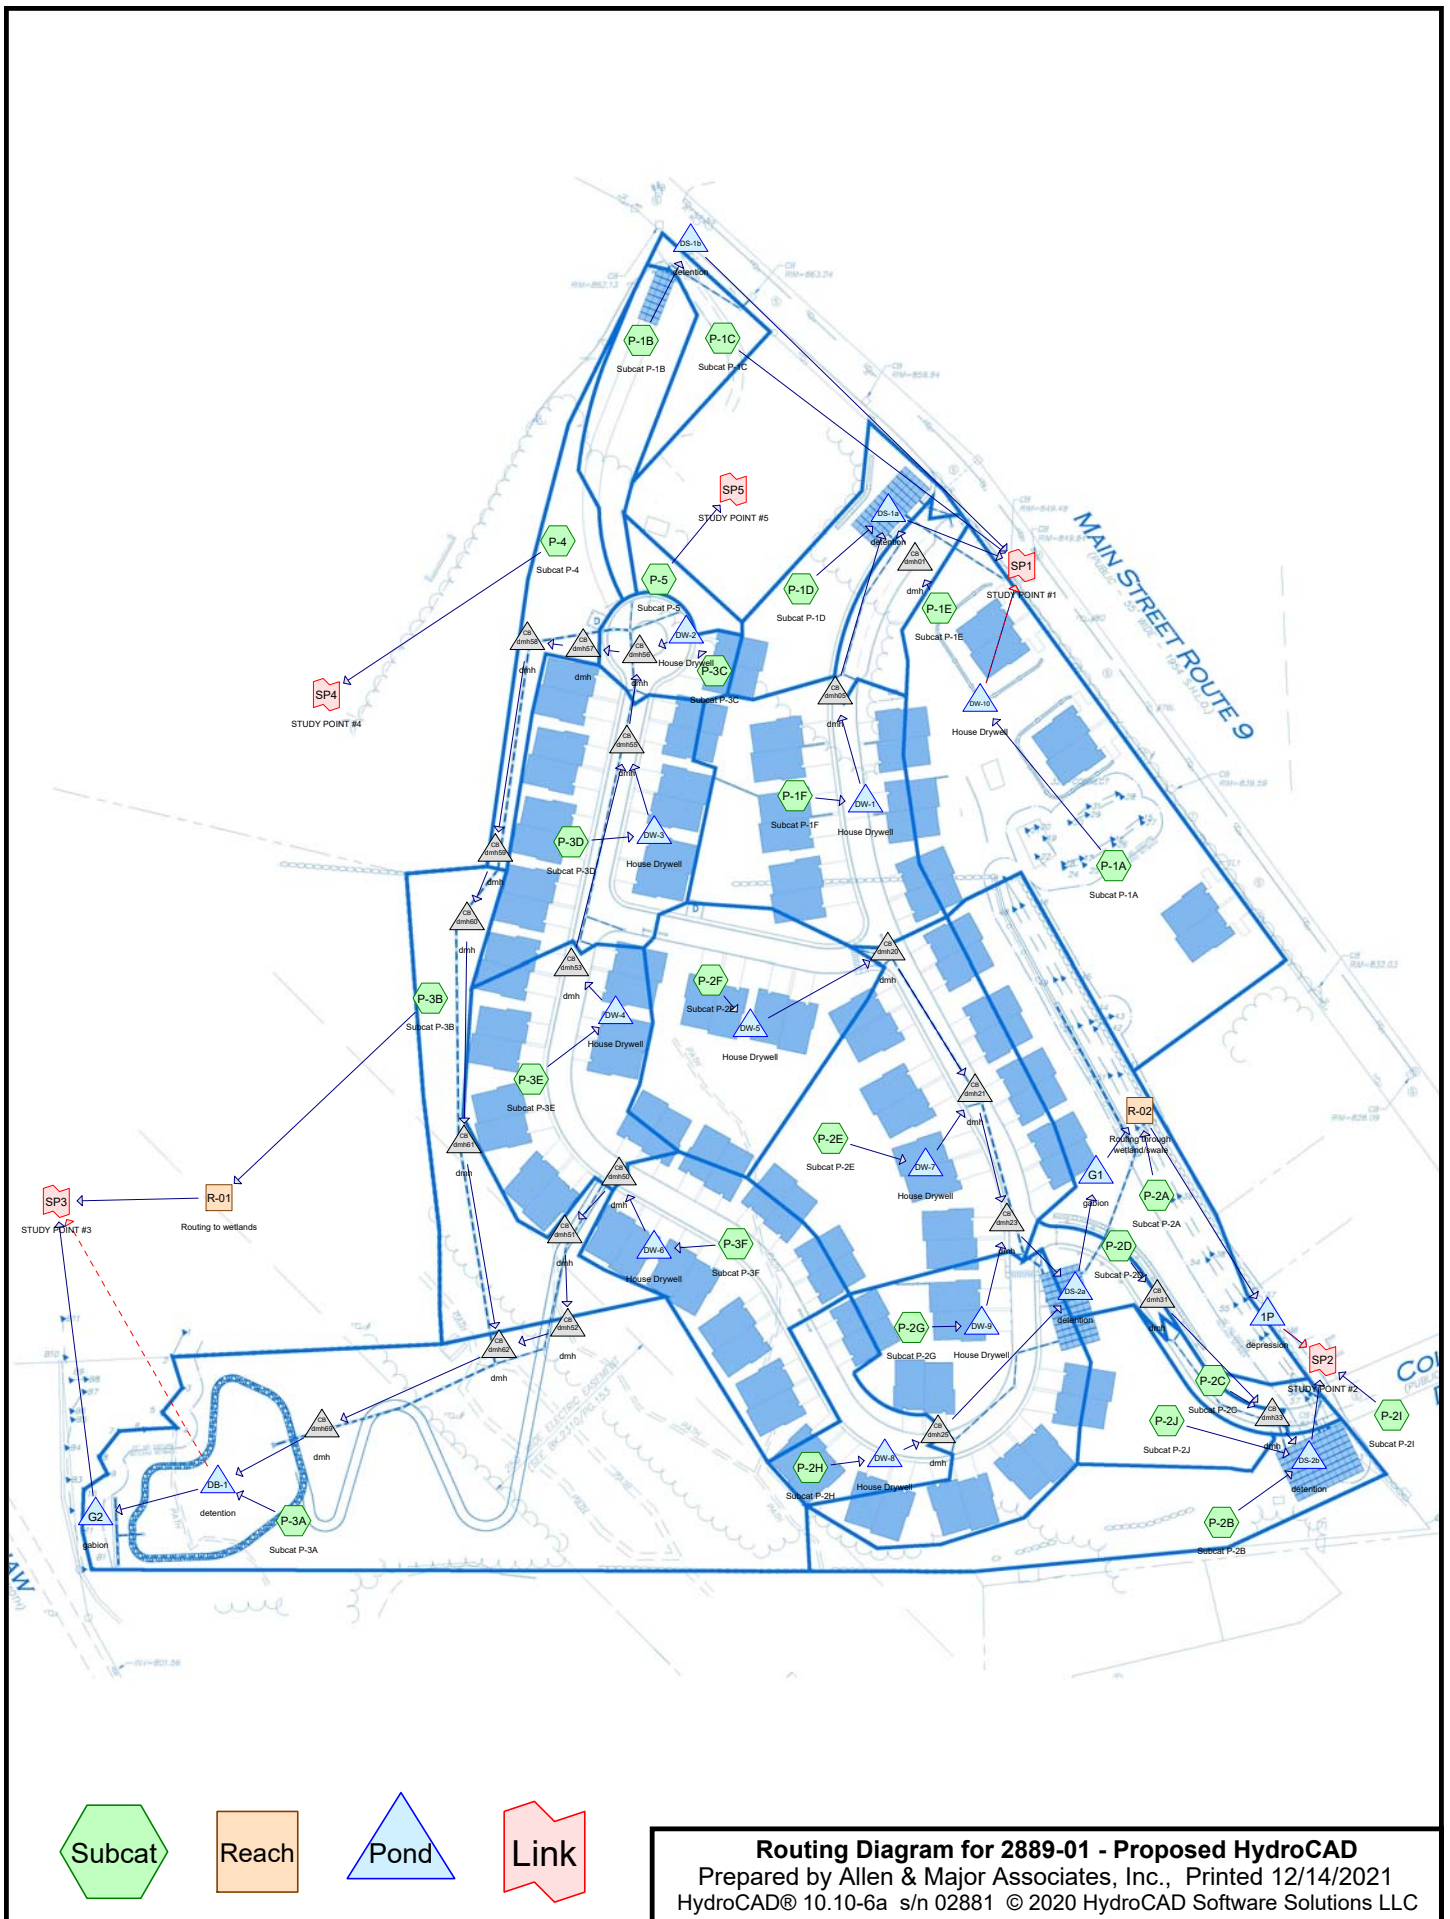

## 2889-01 - Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Printed 12/14/2021

Page 2

### Rainfall Events Listing

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-year	Type III 24-hr		Default	24.00	1	3.23	2
2	10-year	Type III 24-hr		Default	24.00	1	4.85	2
3	25-year	Type III 24-hr		Default	24.00	1	6.12	2
4	50-year	Type III 24-hr		Default	24.00	1	7.30	2
5	100-year	Type III 24-hr		Default	24.00	1	8.72	2

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Printed 12/14/2021

Page 3

**Area Listing (all nodes)**

Area (acres)	CN	Description (subcatchment-numbers)
0.516	61	>75% Grass cover, Good, HSG B (P-1A, P-1B, P-1C, P-1D, P-1E, P-4)
13.673	74	>75% Grass cover, Good, HSG C (P-1A, P-1B, P-1C, P-1D, P-1E, P-1F, P-2A, P-2B, P-2C, P-2D, P-2E, P-2F, P-2G, P-2H, P-2I, P-2J, P-3A, P-3B, P-3C, P-3D, P-3E, P-3F, P-4, P-5)
2.065	65	Brush, Good, HSG C (P-2B, P-2G, P-3A, P-3B)
0.283	98	Paved parking, HSG B (P-1A, P-1B, P-1C, P-1D, P-1E)
4.348	98	Paved parking, HSG C (P-1A, P-1B, P-1C, P-1D, P-1E, P-1F, P-2C, P-2D, P-2E, P-2F, P-2G, P-2H, P-2I, P-3C, P-3D, P-3E, P-3F, P-4)
0.059	98	Roofs, HSG B (P-1A)
4.864	98	Roofs, HSG C (P-1A, P-1D, P-1F, P-2A, P-2E, P-2F, P-2G, P-2H, P-2J, P-3B, P-3C, P-3D, P-3E, P-3F)
0.168	55	Woods, Good, HSG B (P-1A)
3.209	70	Woods, Good, HSG C (P-1A, P-1B, P-2A, P-2B, P-2J, P-3A, P-3B, P-4, P-5)
<b>29.185</b>	<b>80</b>	<b>TOTAL AREA</b>

## 2889-01 - Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Printed 12/14/2021

Page 4

### Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
1.026	HSG B	P-1A, P-1B, P-1C, P-1D, P-1E, P-4
28.159	HSG C	P-1A, P-1B, P-1C, P-1D, P-1E, P-1F, P-2A, P-2B, P-2C, P-2D, P-2E, P-2F, P-2G, P-2H, P-2I, P-2J, P-3A, P-3B, P-3C, P-3D, P-3E, P-3F, P-4, P-5
0.000	HSG D	
0.000	Other	
<b>29.185</b>		<b>TOTAL AREA</b>

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

Printed 12/14/2021

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Page 5

**Ground Covers (all nodes)**

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.516	13.673	0.000	0.000	14.189	>75% Grass cover, Good	P-1A, P-1B, P-1C, P-1D, P-1E, P-1F, P-2A, P-2B, P-2C, P-2D, P-2E, P-2F, P-2G, P-2H, P-2I, P-2J, P-3A, P-3B, P-3C, P-3D, P-3E, P-3F, P-4, P-5
0.000	0.000	2.065	0.000	0.000	2.065	Brush, Good	P-2B, P-2G, P-3A, P-3B
0.000	0.283	4.348	0.000	0.000	4.631	Paved parking	P-1A, P-1B, P-1C, P-1D, P-1E, P-1F, P-2C, P-2D, P-2E, P-2F, P-2G, P-2H, P-2I, P-3C, P-3D, P-3E, P-3F, P-4
0.000	0.059	4.864	0.000	0.000	4.923	Roofs	P-1A, P-1D, P-1F, P-2A, P-2E, P-2F, P-2G, P-2H, P-2J, P-3B, P-3C, P-3D, P-3E, P-3F
0.000	0.168	3.209	0.000	0.000	3.376	Woods, Good	P-1A, P-1B, P-2A, P-2B, P-2J, P-3A, P-3B, P-4, P-5
<b>0.000</b>	<b>1.026</b>	<b>28.159</b>	<b>0.000</b>	<b>0.000</b>	<b>29.185</b>	<b>TOTAL AREA</b>	

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Printed 12/14/2021

Page 6

**Pipe Listing (all nodes)**

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Width (inches)	Diam/Height (inches)	Inside-Fill (inches)
1	1P	859.00	858.73	27.0	0.0100	0.013	0.0	24.0	0.0
2	DB-1	811.00	810.30	32.0	0.0219	0.013	0.0	18.0	0.0
3	dmh01	849.34	849.22	12.0	0.0100	0.013	0.0	12.0	0.0
4	dmh05	868.52	865.12	97.0	0.0351	0.013	0.0	15.0	0.0
5	dmh20	902.74	900.30	205.0	0.0119	0.013	0.0	15.0	0.0
6	dmh21	899.55	897.65	190.0	0.0100	0.013	0.0	24.0	0.0
7	dmh23	897.55	897.20	27.0	0.0130	0.013	0.0	30.0	0.0
8	dmh25	922.60	915.84	97.0	0.0697	0.013	0.0	12.0	0.0
9	dmh31	875.76	868.05	96.0	0.0803	0.013	0.0	12.0	0.0
10	dmh33	859.71	859.36	27.0	0.0130	0.013	0.0	15.0	0.0
11	dmh50	927.65	919.50	102.0	0.0799	0.013	0.0	15.0	0.0
12	dmh51	919.40	909.50	127.0	0.0780	0.013	0.0	15.0	0.0
13	dmh52	892.52	887.55	62.0	0.0802	0.013	0.0	15.0	0.0
14	dmh53	916.46	916.16	31.0	0.0097	0.013	0.0	18.0	0.0
15	dmh55	905.32	903.80	72.0	0.0211	0.013	0.0	24.0	0.0
16	dmh56	901.21	901.02	20.0	0.0095	0.013	0.0	24.0	0.0
17	dmh57	900.92	896.30	97.0	0.0476	0.013	0.0	24.0	0.0
18	dmh58	896.20	893.43	278.0	0.0100	0.013	0.0	30.0	0.0
19	dmh59	893.33	892.50	82.0	0.0101	0.013	0.0	30.0	0.0
20	dmh60	892.40	889.43	258.0	0.0115	0.013	0.0	30.0	0.0
21	dmh61	889.33	886.55	278.0	0.0100	0.013	0.0	30.0	0.0
22	dmh62	886.45	884.91	62.0	0.0248	0.013	0.0	30.0	0.0
23	dmh69	812.48	811.50	29.0	0.0338	0.013	0.0	30.0	0.0
24	DS-1a	847.90	846.36	129.0	0.0119	0.013	0.0	15.0	0.0
25	DS-1b	859.20	858.10	100.0	0.0110	0.013	0.0	12.0	0.0
26	DS-2a	892.00	890.52	46.0	0.0322	0.013	0.0	24.0	0.0
27	DS-2b	858.90	858.44	30.0	0.0153	0.013	0.0	12.0	0.0
28	DW-1	2.50	2.40	10.0	0.0100	0.010	0.0	4.0	0.0
29	DW-10	3.00	3.00	10.0	0.0000	0.010	0.0	4.0	0.0
30	DW-2	2.50	2.40	10.0	0.0100	0.010	0.0	4.0	0.0
31	DW-3	2.50	2.40	10.0	0.0100	0.010	0.0	4.0	0.0
32	DW-4	2.50	2.40	10.0	0.0100	0.010	0.0	4.0	0.0
33	DW-5	2.50	2.40	10.0	0.0100	0.010	0.0	4.0	0.0
34	DW-6	2.50	2.40	10.0	0.0100	0.010	0.0	4.0	0.0
35	DW-7	2.50	2.40	10.0	0.0100	0.010	0.0	4.0	0.0
36	DW-8	2.50	2.40	10.0	0.0100	0.010	0.0	4.0	0.0
37	DW-9	2.50	2.40	10.0	0.0100	0.010	0.0	4.0	0.0



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 7

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points  
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>SubcatchmentP-1A: Subcat P-1A</b>	Runoff Area=3.168 ac 18.24% Impervious Runoff Depth=1.11" Flow Length=782' Tc=13.3 min CN=75 Runoff=3.10 cfs 0.294 af
<b>SubcatchmentP-1B: Subcat P-1B</b>	Runoff Area=24,871 sf 23.27% Impervious Runoff Depth=1.30" Flow Length=315' Tc=8.2 min CN=78 Runoff=0.78 cfs 0.062 af
<b>SubcatchmentP-1C: Subcat P-1C</b>	Runoff Area=0.337 ac 20.77% Impervious Runoff Depth=1.11" Tc=6.0 min CN=75 Runoff=0.42 cfs 0.031 af
<b>SubcatchmentP-1D: Subcat P-1D</b>	Runoff Area=31,162 sf 19.39% Impervious Runoff Depth=1.23" Tc=6.0 min CN=77 Runoff=0.99 cfs 0.074 af
<b>SubcatchmentP-1E: Subcat P-1E</b>	Runoff Area=0.382 ac 53.49% Impervious Runoff Depth=1.78" Tc=6.0 min CN=85 Runoff=0.78 cfs 0.057 af
<b>SubcatchmentP-1F: Subcat P-1F</b>	Runoff Area=1.697 ac 56.34% Impervious Runoff Depth=2.02" Tc=6.0 min CN=88 Runoff=3.93 cfs 0.286 af
<b>SubcatchmentP-2A: Subcat P-2A</b>	Runoff Area=1.773 ac 10.14% Impervious Runoff Depth=1.11" Tc=6.0 min CN=75 Runoff=2.19 cfs 0.165 af
<b>SubcatchmentP-2B: Subcat P-2B</b>	Runoff Area=1.201 ac 0.00% Impervious Runoff Depth=0.85" Tc=6.0 min CN=70 Runoff=1.05 cfs 0.085 af
<b>SubcatchmentP-2C: Subcat P-2C</b>	Runoff Area=0.137 ac 62.40% Impervious Runoff Depth=2.11" Tc=6.0 min CN=89 Runoff=0.33 cfs 0.024 af
<b>SubcatchmentP-2D: Subcat P-2D</b>	Runoff Area=0.260 ac 40.58% Impervious Runoff Depth=1.71" Tc=6.0 min CN=84 Runoff=0.51 cfs 0.037 af
<b>SubcatchmentP-2E: Subcat P-2E</b>	Runoff Area=2.354 ac 54.62% Impervious Runoff Depth=1.94" Tc=6.0 min CN=87 Runoff=5.24 cfs 0.381 af
<b>SubcatchmentP-2F: Subcat P-2F</b>	Runoff Area=1.509 ac 43.37% Impervious Runoff Depth=1.71" Tc=6.0 min CN=84 Runoff=2.96 cfs 0.215 af
<b>SubcatchmentP-2G: Subcat P-2G</b>	Runoff Area=1.688 ac 56.40% Impervious Runoff Depth=2.02" Tc=6.0 min CN=88 Runoff=3.91 cfs 0.285 af
<b>SubcatchmentP-2H: Subcat P-2H</b>	Runoff Area=0.601 ac 77.35% Impervious Runoff Depth=2.47" Tc=6.0 min CN=93 Runoff=1.65 cfs 0.124 af
<b>SubcatchmentP-2I: Subcat P-2I</b>	Runoff Area=0.127 ac 22.66% Impervious Runoff Depth=1.36" Tc=6.0 min CN=79 Runoff=0.20 cfs 0.014 af
<b>SubcatchmentP-2J: Subcat P-2J</b>	Runoff Area=0.619 ac 7.73% Impervious Runoff Depth=1.17" Tc=6.0 min CN=76 Runoff=0.81 cfs 0.060 af
<b>SubcatchmentP-3A: Subcat P-3A</b>	Runoff Area=5.023 ac 0.00% Impervious Runoff Depth=0.85" Flow Length=644' Tc=16.1 min CN=70 Runoff=3.24 cfs 0.354 af
<b>SubcatchmentP-3B: Subcat P-3B</b>	Runoff Area=1.351 ac 0.01% Impervious Runoff Depth=0.95" Tc=6.0 min CN=72 Runoff=1.37 cfs 0.107 af
<b>SubcatchmentP-3C: Subcat P-3C</b>	Runoff Area=0.375 ac 77.23% Impervious Runoff Depth=2.47" Tc=6.0 min CN=93 Runoff=1.03 cfs 0.077 af
<b>SubcatchmentP-3D: Subcat P-3D</b>	Runoff Area=1.657 ac 78.20% Impervious Runoff Depth=2.47" Tc=6.0 min CN=93 Runoff=4.55 cfs 0.342 af
<b>SubcatchmentP-3E: Subcat P-3E</b>	Runoff Area=1.417 ac 70.76% Impervious Runoff Depth=2.29" Tc=6.0 min CN=91 Runoff=3.65 cfs 0.270 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 8

**Subcatchment P-3F: Subcat P-3F**Runoff Area=1.406 ac 72.39% Impervious Runoff Depth=2.29"  
Tc=6.0 min CN=91 Runoff=3.62 cfs 0.268 af**Subcatchment P-4: Subcat P-4**Runoff Area=28,663 sf 9.82% Impervious Runoff Depth=1.11"  
Tc=6.0 min CN=75 Runoff=0.81 cfs 0.061 af**Subcatchment P-5: Subcat P-5**Runoff Area=6,874 sf 0.00% Impervious Runoff Depth=1.00"  
Tc=6.0 min CN=73 Runoff=0.17 cfs 0.013 af**Reach R-01: Routing to wetlands**Avg. Flow Depth=0.15' Max Vel=0.25 fps Inflow=1.37 cfs 0.107 af  
n=0.400 L=722.0' S=0.1087 ' Capacity=43.77 cfs Outflow=0.44 cfs 0.107 af**Reach R-02: Routing through wetland/swale**Avg. Flow Depth=0.41' Max Vel=0.24 fps Inflow=3.05 cfs 0.896 af  
n=0.400 L=525.0' S=0.0223 ' Capacity=26.65 cfs Outflow=1.72 cfs 0.895 af**Pond 1P: depression**Peak Elev=862.19' Storage=68 cf Inflow=1.72 cfs 0.895 af  
Primary=1.72 cfs 0.895 af Secondary=0.00 cfs 0.000 af Outflow=1.72 cfs 0.895 af**Pond DB-1: detention**Peak Elev=812.00' Storage=16,353 cf Inflow=13.90 cfs 0.920 af  
Primary=2.82 cfs 0.902 af Secondary=0.00 cfs 0.000 af Outflow=2.82 cfs 0.902 af**Pond dmh01: dmh**Peak Elev=849.85' Inflow=0.78 cfs 0.057 af  
12.0" Round Culvert n=0.013 L=12.0' S=0.0100 ' Outflow=0.78 cfs 0.057 af**Pond dmh05: dmh**Peak Elev=869.56' Inflow=3.78 cfs 0.169 af  
15.0" Round Culvert n=0.013 L=97.0' S=0.0351 ' Outflow=3.78 cfs 0.169 af**Pond dmh20: dmh**Peak Elev=903.60' Inflow=2.82 cfs 0.181 af  
15.0" Round Culvert n=0.013 L=205.0' S=0.0119 ' Outflow=2.82 cfs 0.181 af**Pond dmh21: dmh**Peak Elev=900.80' Inflow=7.80 cfs 0.428 af  
24.0" Round Culvert n=0.013 L=190.0' S=0.0100 ' Outflow=7.80 cfs 0.428 af**Pond dmh23: dmh**Peak Elev=899.09' Inflow=11.52 cfs 0.628 af  
30.0" Round Culvert n=0.013 L=27.0' S=0.0130 ' Outflow=11.52 cfs 0.628 af**Pond dmh25: dmh**Peak Elev=923.28' Inflow=1.58 cfs 0.106 af  
12.0" Round Culvert n=0.013 L=97.0' S=0.0697 ' Outflow=1.58 cfs 0.106 af**Pond dmh31: dmh**Peak Elev=876.12' Inflow=0.51 cfs 0.037 af  
12.0" Round Culvert n=0.013 L=96.0' S=0.0803 ' Outflow=0.51 cfs 0.037 af**Pond dmh33: dmh**Peak Elev=860.14' Inflow=0.84 cfs 0.061 af  
15.0" Round Culvert n=0.013 L=27.0' S=0.0130 ' Outflow=0.84 cfs 0.061 af**Pond dmh50: dmh**Peak Elev=928.58' Inflow=3.22 cfs 0.120 af  
15.0" Round Culvert n=0.013 L=102.0' S=0.0799 ' Outflow=3.22 cfs 0.120 af**Pond dmh51: dmh**Peak Elev=920.33' Inflow=3.22 cfs 0.120 af  
15.0" Round Culvert n=0.013 L=127.0' S=0.0780 ' Outflow=3.22 cfs 0.120 af**Pond dmh52: dmh**Peak Elev=893.45' Inflow=3.22 cfs 0.120 af  
15.0" Round Culvert n=0.013 L=62.0' S=0.0802 ' Outflow=3.22 cfs 0.120 af**Pond dmh53: dmh**Peak Elev=917.43' Inflow=3.48 cfs 0.184 af  
18.0" Round Culvert n=0.013 L=31.0' S=0.0097 ' Outflow=3.48 cfs 0.184 af**Pond dmh55: dmh**Peak Elev=906.56' Inflow=7.80 cfs 0.386 af  
24.0" Round Culvert n=0.013 L=72.0' S=0.0211 ' Outflow=7.80 cfs 0.386 af**Pond dmh56: dmh**Peak Elev=902.77' Inflow=8.78 cfs 0.446 af  
24.0" Round Culvert n=0.013 L=20.0' S=0.0095 ' Outflow=8.78 cfs 0.446 af**Pond dmh57: dmh**Peak Elev=902.26' Inflow=8.78 cfs 0.446 af  
24.0" Round Culvert n=0.013 L=97.0' S=0.0476 ' Outflow=8.78 cfs 0.446 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 9

<b>Pond dmh58: dmh</b>	Peak Elev=897.41' Inflow=8.78 cfs 0.446 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=8.78 cfs 0.446 af
<b>Pond dmh59: dmh</b>	Peak Elev=894.58' Inflow=8.78 cfs 0.446 af 30.0" Round Culvert n=0.013 L=82.0' S=0.0101 '/' Outflow=8.78 cfs 0.446 af
<b>Pond dmh60: dmh</b>	Peak Elev=893.61' Inflow=8.78 cfs 0.446 af 30.0" Round Culvert n=0.013 L=258.0' S=0.0115 '/' Outflow=8.78 cfs 0.446 af
<b>Pond dmh61: dmh</b>	Peak Elev=890.54' Inflow=8.78 cfs 0.446 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=8.78 cfs 0.446 af
<b>Pond dmh62: dmh</b>	Peak Elev=887.85' Inflow=11.41 cfs 0.566 af 30.0" Round Culvert n=0.013 L=62.0' S=0.0248 '/' Outflow=11.41 cfs 0.566 af
<b>Pond dmh69: dmh</b>	Peak Elev=813.88' Inflow=11.41 cfs 0.566 af 30.0" Round Culvert n=0.013 L=29.0' S=0.0338 '/' Outflow=11.41 cfs 0.566 af
<b>Pond DS-1a: detention</b>	Peak Elev=849.45' Storage=5,812 cf Inflow=5.51 cfs 0.299 af Outflow=0.56 cfs 0.299 af
<b>Pond DS-1b: detention</b>	Peak Elev=859.78' Storage=778 cf Inflow=0.78 cfs 0.062 af Outflow=0.27 cfs 0.061 af
<b>Pond DS-2a: detention</b>	Peak Elev=895.17' Storage=15,254 cf Inflow=13.10 cfs 0.734 af Outflow=1.46 cfs 0.732 af
<b>Pond DS-2b: detention</b>	Peak Elev=859.68' Storage=3,401 cf Inflow=2.70 cfs 0.206 af Outflow=0.64 cfs 0.180 af
<b>Pond DW-1: House Drywell</b>	Peak Elev=3.50' Storage=0.063 af Inflow=3.93 cfs 0.286 af Discarded=0.05 cfs 0.091 af Primary=3.78 cfs 0.169 af Outflow=3.82 cfs 0.260 af
<b>Pond DW-10: House Drywell</b>	Peak Elev=3.50' Storage=0.027 af Inflow=3.10 cfs 0.294 af Discarded=0.02 cfs 0.036 af Primary=0.19 cfs 0.116 af Secondary=2.85 cfs 0.132 af Outflow=3.05 cfs 0.283 af
<b>Pond DW-2: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=1.03 cfs 0.077 af Discarded=0.01 cfs 0.014 af Primary=0.98 cfs 0.060 af Outflow=0.99 cfs 0.074 af
<b>Pond DW-3: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=4.55 cfs 0.342 af Discarded=0.05 cfs 0.109 af Primary=4.32 cfs 0.203 af Outflow=4.37 cfs 0.311 af
<b>Pond DW-4: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=3.65 cfs 0.270 af Discarded=0.03 cfs 0.067 af Primary=3.48 cfs 0.184 af Outflow=3.51 cfs 0.251 af
<b>Pond DW-5: House Drywell</b>	Peak Elev=3.50' Storage=0.018 af Inflow=2.96 cfs 0.215 af Discarded=0.01 cfs 0.026 af Primary=2.82 cfs 0.181 af Outflow=2.84 cfs 0.207 af
<b>Pond DW-6: House Drywell</b>	Peak Elev=3.50' Storage=0.081 af Inflow=3.62 cfs 0.268 af Discarded=0.06 cfs 0.117 af Primary=3.22 cfs 0.120 af Outflow=3.28 cfs 0.236 af
<b>Pond DW-7: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=5.24 cfs 0.381 af Discarded=0.05 cfs 0.104 af Primary=4.98 cfs 0.247 af Outflow=5.03 cfs 0.350 af
<b>Pond DW-8: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=1.65 cfs 0.124 af Discarded=0.01 cfs 0.014 af Primary=1.58 cfs 0.106 af Outflow=1.59 cfs 0.120 af
<b>Pond DW-9: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=3.91 cfs 0.285 af Discarded=0.03 cfs 0.066 af Primary=3.72 cfs 0.200 af Outflow=3.75 cfs 0.266 af
<b>Pond G1: gabion</b>	Peak Elev=877.54' Storage=3 cf Inflow=1.46 cfs 0.732 af Outflow=1.46 cfs 0.732 af
<b>Pond G2: gabion</b>	Peak Elev=810.41' Storage=5 cf Inflow=2.82 cfs 0.902 af Outflow=2.82 cfs 0.902 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 10

**Link SP1: STUDY POINT #1**Inflow=3.95 cfs 0.639 af  
Primary=3.95 cfs 0.639 af**Link SP2: STUDY POINT #2**Inflow=2.32 cfs 1.090 af  
Primary=2.32 cfs 1.090 af**Link SP3: STUDY POINT #3**Inflow=3.23 cfs 1.009 af  
Primary=3.23 cfs 1.009 af**Link SP4: STUDY POINT #4**Inflow=0.81 cfs 0.061 af  
Primary=0.81 cfs 0.061 af**Link SP5: STUDY POINT #5**Inflow=0.17 cfs 0.013 af  
Primary=0.17 cfs 0.013 af**Total Runoff Area = 29.185 ac   Runoff Volume = 3.685 af   Average Runoff Depth = 1.52"**  
**67.26% Pervious = 19.630 ac   32.74% Impervious = 9.555 ac**

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 11

**Summary for Subcatchment P-1A: Subcat P-1A**

Runoff = 3.10 cfs @ 12.20 hrs, Volume= 0.294 af, Depth= 1.11"  
 Routed to Pond DW-10 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.059	98	Roofs, HSG B
0.085	98	Paved parking, HSG B
0.168	55	Woods, Good, HSG B
0.183	61	>75% Grass cover, Good, HSG B
1.273	74	>75% Grass cover, Good, HSG C
0.966	70	Woods, Good, HSG C
0.044	98	Paved parking, HSG C
0.390	98	Roofs, HSG C
3.168	75	Weighted Average
2.590		81.76% Pervious Area
0.578		18.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.8	55	0.1670	0.09		<b>Sheet Flow,</b> Woods: Dense underbrush n= 0.800 P2= 3.28"
1.1	105	0.0500	1.57		<b>Shallow Concentrated Flow,</b> Short Grass Pasture Kv= 7.0 fps
2.4	622	0.0280	4.24	4.11	<b>Trap/Vee/Rect Channel Flow,</b> Bot.W=1.00' D=0.25' Z= 3.0 & 20.0 ' Top.W=6.75' n= 0.016 Asphalt, rough
13.3	782	Total			

**Summary for Subcatchment P-1B: Subcat P-1B**

Runoff = 0.78 cfs @ 12.12 hrs, Volume= 0.062 af, Depth= 1.30"  
 Routed to Pond DS-1b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (sf)	CN	Description
4,342	98	Paved parking, HSG C
1,445	98	Paved parking, HSG B
3,282	61	>75% Grass cover, Good, HSG B
13,797	74	>75% Grass cover, Good, HSG C
2,004	70	Woods, Good, HSG C
24,871	78	Weighted Average
19,083		76.73% Pervious Area
5,787		23.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 12

**Summary for Subcatchment P-1C: Subcat P-1C**

Runoff = 0.42 cfs @ 12.10 hrs, Volume= 0.031 af, Depth= 1.11"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.002	98	Paved parking, HSG C
0.068	98	Paved parking, HSG B
0.111	61	>75% Grass cover, Good, HSG B
0.156	74	>75% Grass cover, Good, HSG C
0.337	75	Weighted Average
0.267		79.23% Pervious Area
0.070		20.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-1D: Subcat P-1D**

Runoff = 0.99 cfs @ 12.10 hrs, Volume= 0.074 af, Depth= 1.23"  
 Routed to Pond DS-1a : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (sf)	CN	Description
4,574	61	>75% Grass cover, Good, HSG B
2,625	98	Paved parking, HSG B
2,222	98	Roofs, HSG C
1,194	98	Paved parking, HSG C
20,546	74	>75% Grass cover, Good, HSG C
31,162	77	Weighted Average
25,121		80.61% Pervious Area
6,042		19.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-1E: Subcat P-1E**

Runoff = 0.78 cfs @ 12.09 hrs, Volume= 0.057 af, Depth= 1.78"  
 Routed to Pond dmh01 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.040	61	>75% Grass cover, Good, HSG B
0.037	98	Paved parking, HSG B
0.168	98	Paved parking, HSG C
0.138	74	>75% Grass cover, Good, HSG C
0.382	85	Weighted Average
0.178		46.51% Pervious Area
0.204		53.49% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 13

**Summary for Subcatchment P-1F: Subcat P-1F**

Runoff = 3.93 cfs @ 12.09 hrs, Volume= 0.286 af, Depth= 2.02"  
 Routed to Pond DW-1 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.741	74	>75% Grass cover, Good, HSG C
0.492	98	Roofs, HSG C
0.464	98	Paved parking, HSG C
1.697	88	Weighted Average
0.741		43.66% Pervious Area
0.956		56.34% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2A: Subcat P-2A**

Runoff = 2.19 cfs @ 12.10 hrs, Volume= 0.165 af, Depth= 1.11"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.180	98	Roofs, HSG C
0.428	70	Woods, Good, HSG C
1.165	74	>75% Grass cover, Good, HSG C
1.773	75	Weighted Average
1.593		89.86% Pervious Area
0.180		10.14% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2B: Subcat P-2B**

Runoff = 1.05 cfs @ 12.10 hrs, Volume= 0.085 af, Depth= 0.85"  
 Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.522	74	>75% Grass cover, Good, HSG C
0.365	70	Woods, Good, HSG C
0.314	65	Brush, Good, HSG C
1.201	70	Weighted Average
1.201		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 14

**Summary for Subcatchment P-2C: Subcat P-2C**

Runoff = 0.33 cfs @ 12.09 hrs, Volume= 0.024 af, Depth= 2.11"  
 Routed to Pond dmh33 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.085	98	Paved parking, HSG C
0.051	74	>75% Grass cover, Good, HSG C
0.137	89	Weighted Average
0.051		37.60% Pervious Area
0.085		62.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 Min

**Summary for Subcatchment P-2D: Subcat P-2D**

Runoff = 0.51 cfs @ 12.09 hrs, Volume= 0.037 af, Depth= 1.71"  
 Routed to Pond dmh31 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.106	98	Paved parking, HSG C
0.155	74	>75% Grass cover, Good, HSG C
0.260	84	Weighted Average
0.155		59.42% Pervious Area
0.106		40.58% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2E: Subcat P-2E**

Runoff = 5.24 cfs @ 12.09 hrs, Volume= 0.381 af, Depth= 1.94"  
 Routed to Pond DW-7 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
1.068	74	>75% Grass cover, Good, HSG C
0.691	98	Roofs, HSG C
0.595	98	Paved parking, HSG C
2.354	87	Weighted Average
1.068		45.38% Pervious Area
1.286		54.62% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2F: Subcat P-2F**

Runoff = 2.96 cfs @ 12.09 hrs, Volume= 0.215 af, Depth= 1.71"  
 Routed to Pond DW-5 : House Drywell



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 15

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.854	74	>75% Grass cover, Good, HSG C
0.370	98	Roofs, HSG C
0.284	98	Paved parking, HSG C
1.509	84	Weighted Average
0.854		56.63% Pervious Area
0.654		43.37% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2G: Subcat P-2G**

Runoff = 3.91 cfs @ 12.09 hrs, Volume= 0.285 af, Depth= 2.02"  
 Routed to Pond DW-9 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.736	74	>75% Grass cover, Good, HSG C
0.000	65	Brush, Good, HSG C
0.588	98	Roofs, HSG C
0.364	98	Paved parking, HSG C
1.688	88	Weighted Average
0.736		43.60% Pervious Area
0.952		56.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2H: Subcat P-2H**

Runoff = 1.65 cfs @ 12.09 hrs, Volume= 0.124 af, Depth= 2.47"  
 Routed to Pond DW-8 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.136	74	>75% Grass cover, Good, HSG C
0.160	98	Roofs, HSG C
0.304	98	Paved parking, HSG C
0.601	93	Weighted Average
0.136		22.65% Pervious Area
0.465		77.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2I: Subcat P-2I**

Runoff = 0.20 cfs @ 12.10 hrs, Volume= 0.014 af, Depth= 1.36"  
 Routed to Link SP2 : STUDY POINT #2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 16

Area (ac)	CN	Description
0.098	74	>75% Grass cover, Good, HSG C
0.029	98	Paved parking, HSG C
0.127	79	Weighted Average
0.098		77.34% Pervious Area
0.029		22.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, TR-55 Min</b>

**Summary for Subcatchment P-2J: Subcat P-2J**

Runoff = 0.81 cfs @ 12.10 hrs, Volume= 0.060 af, Depth= 1.17"  
Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.016	70	Woods, Good, HSG C
0.048	98	Roofs, HSG C
0.556	74	>75% Grass cover, Good, HSG C
0.619	76	Weighted Average
0.571		92.27% Pervious Area
0.048		7.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

**Summary for Subcatchment P-3A: Subcat P-3A**

Runoff = 3.24 cfs @ 12.25 hrs, Volume= 0.354 af, Depth= 0.85"  
Routed to Pond DB-1 : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
2.599	74	>75% Grass cover, Good, HSG C
0.847	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.023	70	Weighted Average
5.023		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
1.3	299	0.3000	3.83		<b>Shallow Concentrated Flow, D-E</b>
					Short Grass Pasture Kv= 7.0 fps
16.1	644	Total			

**Summary for Subcatchment P-3B: Subcat P-3B**

Runoff = 1.37 cfs @ 12.10 hrs, Volume= 0.107 af, Depth= 0.95"  
Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.23"

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 17

Area (ac)	CN	Description
0.000	98	Roofs, HSG C
0.172	65	Brush, Good, HSG C
0.274	70	Woods, Good, HSG C
0.905	74	>75% Grass cover, Good, HSG C
1.351	72	Weighted Average
1.351		99.99% Pervious Area
0.000		0.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry,</b>

### Summary for Subcatchment P-3C: Subcat P-3C

Runoff = 1.03 cfs @ 12.09 hrs, Volume= 0.077 af, Depth= 2.47"  
 Routed to Pond DW-2 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.085	74	>75% Grass cover, Good, HSG C
0.051	98	Roofs, HSG C
0.239	98	Paved parking, HSG C
0.375	93	Weighted Average
0.085		22.77% Pervious Area
0.290		77.23% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

### Summary for Subcatchment P-3D: Subcat P-3D

Runoff = 4.55 cfs @ 12.09 hrs, Volume= 0.342 af, Depth= 2.47"  
 Routed to Pond DW-3 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.361	74	>75% Grass cover, Good, HSG C
0.725	98	Roofs, HSG C
0.571	98	Paved parking, HSG C
1.657	93	Weighted Average
0.361		21.80% Pervious Area
1.295		78.20% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr-55 min</b>

### Summary for Subcatchment P-3E: Subcat P-3E

Runoff = 3.65 cfs @ 12.09 hrs, Volume= 0.270 af, Depth= 2.29"  
 Routed to Pond DW-4 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-year Rainfall=3.23"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 18

Area (ac)	CN	Description
0.414	74	>75% Grass cover, Good, HSG C
0.552	98	Roofs, HSG C
0.451	98	Paved parking, HSG C
1.417	91	Weighted Average
0.414		29.24% Pervious Area
1.003		70.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-3F: Subcat P-3F**

Runoff = 3.62 cfs @ 12.09 hrs, Volume= 0.268 af, Depth= 2.29"  
Routed to Pond DW-6 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.23"

Area (ac)	CN	Description
0.388	74	>75% Grass cover, Good, HSG C
0.565	98	Roofs, HSG C
0.452	98	Paved parking, HSG C
1.406	91	Weighted Average
0.388		27.61% Pervious Area
1.018		72.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-4: Subcat P-4**

Runoff = 0.81 cfs @ 12.10 hrs, Volume= 0.061 af, Depth= 1.11"  
Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.23"

Area (sf)	CN	Description
56	61	>75% Grass cover, Good, HSG B
16,537	74	>75% Grass cover, Good, HSG C
9,257	70	Woods, Good, HSG C
2,814	98	Paved parking, HSG C
28,663	75	Weighted Average
25,849		90.18% Pervious Area
2,814		9.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-5: Subcat P-5**

Runoff = 0.17 cfs @ 12.10 hrs, Volume= 0.013 af, Depth= 1.00"  
Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Type III 24-hr 2-year Rainfall=3.23"

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 19

Area (sf)	CN	Description
2,401	70	Woods, Good, HSG C
4,473	74	>75% Grass cover, Good, HSG C
6,874	73	Weighted Average
6,874		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					<b>Direct Entry, TR-55 Min.</b>
5.0	0	Total, Increased to minimum Tc = 6.0 min			

### Summary for Reach R-01: Routing to wetlands

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.


This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 1.351 ac, 0.01% Impervious, Inflow Depth = 0.95" for 2-year event  
Inflow = 1.37 cfs @ 12.10 hrs, Volume= 0.107 af  
Outflow = 0.44 cfs @ 12.48 hrs, Volume= 0.107 af, Atten= 68%, Lag= 22.7 min  
Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Max. Velocity= 0.25 fps, Min. Travel Time= 48.4 min  
Avg. Velocity = 0.11 fps, Avg. Travel Time= 112.8 min

Peak Storage= 1,288 cf @ 12.48 hrs  
Average Depth at Peak Storage= 0.15', Surface Width= 19.53'  
Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush  
Side Slope Z-value= 50.0 '/' Top Width= 105.00'  
Length= 722.0' Slope= 0.1087 '/  
Inlet Invert= 889.50', Outlet Invert= 811.00'

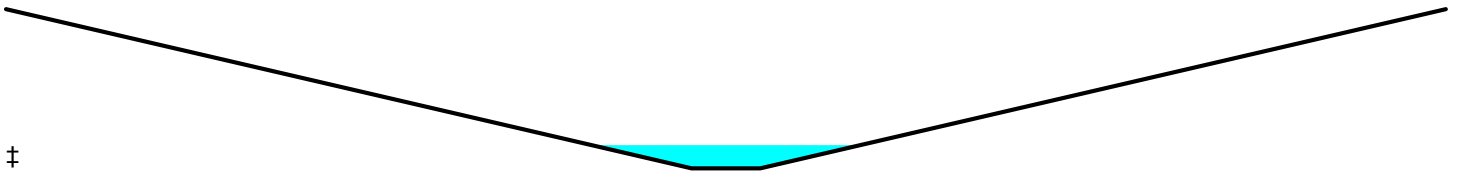

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth > 1.36" for 2-year event  
Inflow = 3.05 cfs @ 12.11 hrs, Volume= 0.896 af  
Outflow = 1.72 cfs @ 13.00 hrs, Volume= 0.895 af, Atten= 44%, Lag= 53.0 min  
Routed to Pond 1P : depression

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Max. Velocity= 0.24 fps, Min. Travel Time= 35.7 min  
Avg. Velocity = 0.12 fps, Avg. Travel Time= 74.4 min

Peak Storage= 3,692 cf @ 13.00 hrs  
Average Depth at Peak Storage= 0.41', Surface Width= 23.90'  
Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 26.65 cfs

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.


HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 20

10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush  
 Side Slope Z-value= 30.0 3.5 '/' Top Width= 60.25'  
 Length= 525.0' Slope= 0.0223 '/'  
 Inlet Invert= 875.70', Outlet Invert= 864.00'

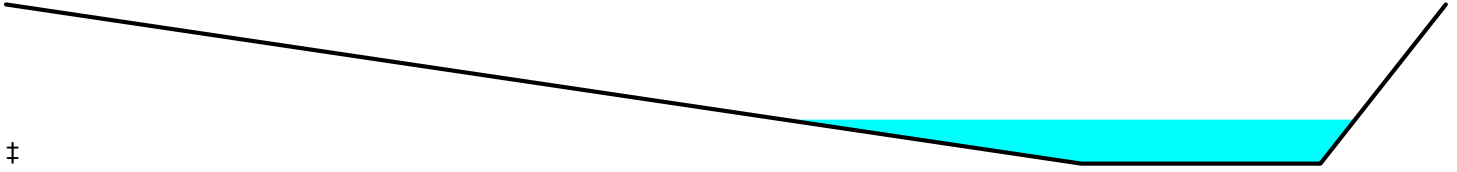**Summary for Pond 1P: depression**

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth > 1.35" for 2-year event  
 Inflow = 1.72 cfs @ 13.00 hrs, Volume= 0.895 af  
 Outflow = 1.72 cfs @ 13.00 hrs, Volume= 0.895 af, Atten= 0%, Lag= 0.5 min  
 Primary = 1.72 cfs @ 13.00 hrs, Volume= 0.895 af  
 Routed to Link SP2 : STUDY POINT #2  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 862.19' @ 13.00 hrs Surf.Area= 372 sf Storage= 68 cf  
 Flood Elev= 864.00' Surf.Area= 837 sf Storage= 1,133 cf

Plug-Flow detention time= 0.8 min calculated for 0.895 af (100% of inflow)  
 Center-of-Mass det. time= 0.8 min ( 977.8 - 977.0 )

Volume	Invert	Avail.Storage	Storage Description		
#1	862.00'	1,133 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
862.00	334	74.0	0	0	334
864.00	837	119.0	1,133	1,133	1,052

Device	Routing	Invert	Outlet Devices
#1	Primary	859.00'	<b>24.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.00' / 858.73' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	862.00'	<b>24.0" Horiz. beehive</b> C= 0.600 Limited to weir flow at low heads
#3	Secondary	863.30'	<b>10.0' long x 5.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

**Primary OutFlow** Max=1.72 cfs @ 13.00 hrs HW=862.19' TW=0.00' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 1.72 cfs of 22.39 cfs potential flow)

↑ **2=beehive** (Weir Controls 1.72 cfs @ 1.43 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=862.00' TW=0.00' (Dynamic Tailwater)

↑ **3=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

**Summary for Pond DB-1: detention**

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth = 1.12" for 2-year event  
 Inflow = 13.90 cfs @ 12.15 hrs, Volume= 0.920 af  
 Outflow = 2.82 cfs @ 12.69 hrs, Volume= 0.902 af, Atten= 80%, Lag= 32.4 min  
 Primary = 2.82 cfs @ 12.69 hrs, Volume= 0.902 af  
 Routed to Pond G2 : gabion  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Link SP3 : STUDY POINT #3

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 21

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 812.00' @ 12.69 hrs Surf.Area= 17,296 sf Storage= 16,353 cf  
 Flood Elev= 816.00' Surf.Area= 24,900 sf Storage= 100,504 cf

Plug-Flow detention time= 126.4 min calculated for 0.902 af (98% of inflow)  
 Center-of-Mass det. time= 115.7 min ( 944.0 - 828.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	811.00'	100,504 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
811.00	15,556	576.0	0	0	15,556
812.00	17,303	594.0	16,422	16,422	17,331
813.00	19,115	613.0	18,201	34,623	19,253
814.00	20,984	632.0	20,042	54,665	21,236
815.00	22,910	651.0	21,940	76,605	23,279
816.00	24,900	670.0	23,898	100,504	25,383

Device	Routing	Invert	Outlet Devices
#1	Primary	811.00'	<b>18.0" Round Culvert</b> L= 32.0' Ke= 0.500 Inlet / Outlet Invert= 811.00' / 810.30' S= 0.0219 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf
#2	Device 1	811.00'	<b>8.0" Vert. (2) 8" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	811.90'	<b>12.0" Vert. (2) 12" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	813.20'	<b>24.0" x 24.0" Horiz. 24" Top of Structure</b> C= 0.600 Limited to weir flow at low heads
#5	Secondary	814.40'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.43 2.54 2.70 2.69 2.68 2.68 2.66 2.64 2.64 2.64 2.65 2.65 2.66 2.66 2.68 2.70 2.74

**Primary OutFlow** Max=2.82 cfs @ 12.69 hrs HW=812.00' TW=810.41' (Dynamic Tailwater)

1=Culvert (Passes 2.82 cfs of 4.23 cfs potential flow)  
 2=(2) 8" Orifice (2yr) (Orifice Controls 2.74 cfs @ 3.92 fps)  
 3=(2) 12" Orifice (10yr) (Orifice Controls 0.08 cfs @ 1.05 fps)  
 4=24" Top of Structure ( Controls 0.00 cfs)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=811.00' TW=0.00' (Dynamic Tailwater)

5=Broad-Crested Rectangular Weir( Controls 0.00 cfs)

**Summary for Pond dmh01: dmh**

Inflow Area = 0.382 ac, 53.49% Impervious, Inflow Depth = 1.78" for 2-year event  
 Inflow = 0.78 cfs @ 12.09 hrs, Volume= 0.057 af  
 Outflow = 0.78 cfs @ 12.09 hrs, Volume= 0.057 af, Atten= 0%, Lag= 0.0 min  
 Primary = 0.78 cfs @ 12.09 hrs, Volume= 0.057 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 849.85' @ 12.09 hrs  
 Flood Elev= 855.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	849.34'	<b>12.0" Round Culvert</b> L= 12.0' Ke= 0.500 Inlet / Outlet Invert= 849.34' / 849.22' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.77 cfs @ 12.09 hrs HW=849.84' TW=848.42' (Dynamic Tailwater)

1=Culvert (Barrel Controls 0.77 cfs @ 2.82 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 22

**Summary for Pond dmh05: dmh**

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 1.19" for 2-year event  
 Inflow = 3.78 cfs @ 12.12 hrs, Volume= 0.169 af  
 Outflow = 3.78 cfs @ 12.12 hrs, Volume= 0.169 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.78 cfs @ 12.12 hrs, Volume= 0.169 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 869.56' @ 12.12 hrs  
 Flood Elev= 883.10'

Device	Routing	Invert	Outlet Devices
#1	Primary	868.52'	<b>15.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 868.52' / 865.12' S= 0.0351 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=3.61 cfs @ 12.12 hrs HW=869.53' TW=848.53' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 3.61 cfs @ 3.41 fps)

**Summary for Pond dmh20: dmh**

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 1.44" for 2-year event  
 Inflow = 2.82 cfs @ 12.12 hrs, Volume= 0.181 af  
 Outflow = 2.82 cfs @ 12.12 hrs, Volume= 0.181 af, Atten= 0%, Lag= 0.0 min  
 Primary = 2.82 cfs @ 12.12 hrs, Volume= 0.181 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 903.60' @ 12.12 hrs  
 Flood Elev= 907.61'

Device	Routing	Invert	Outlet Devices
#1	Primary	902.74'	<b>15.0" Round Culvert</b> L= 205.0' Ke= 0.500 Inlet / Outlet Invert= 902.74' / 900.30' S= 0.0119 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=2.74 cfs @ 12.12 hrs HW=903.58' TW=900.78' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 2.74 cfs @ 3.12 fps)

**Summary for Pond dmh21: dmh**

Inflow Area = 3.863 ac, 50.23% Impervious, Inflow Depth = 1.33" for 2-year event  
 Inflow = 7.80 cfs @ 12.12 hrs, Volume= 0.428 af  
 Outflow = 7.80 cfs @ 12.12 hrs, Volume= 0.428 af, Atten= 0%, Lag= 0.0 min  
 Primary = 7.80 cfs @ 12.12 hrs, Volume= 0.428 af  
 Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 900.80' @ 12.12 hrs  
 Flood Elev= 905.24'

Device	Routing	Invert	Outlet Devices
#1	Primary	899.55'	<b>24.0" Round Culvert</b> L= 190.0' Ke= 0.500 Inlet / Outlet Invert= 899.55' / 897.65' S= 0.0100 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=7.42 cfs @ 12.12 hrs HW=900.78' TW=899.07' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 7.42 cfs @ 5.23 fps)



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 23

**Summary for Pond dmh23: dmh**

Inflow Area = 5.551 ac, 52.10% Impervious, Inflow Depth = 1.36" for 2-year event  
 Inflow = 11.52 cfs @ 12.12 hrs, Volume= 0.628 af  
 Outflow = 11.52 cfs @ 12.12 hrs, Volume= 0.628 af, Atten= 0%, Lag= 0.0 min  
 Primary = 11.52 cfs @ 12.12 hrs, Volume= 0.628 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 899.09' @ 12.12 hrs  
 Flood Elev= 910.71'

Device	Routing	Invert	Outlet Devices
#1	Primary	897.55'	<b>30.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 897.55' / 897.20' S= 0.0130 ' /' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=11.20 cfs @ 12.12 hrs HW=899.07' TW=893.32' (Dynamic Tailwater)  
**1=Culvert** (Barrel Controls 11.20 cfs @ 5.15 fps)

**Summary for Pond dmh25: dmh**

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 2.11" for 2-year event  
 Inflow = 1.58 cfs @ 12.11 hrs, Volume= 0.106 af  
 Outflow = 1.58 cfs @ 12.11 hrs, Volume= 0.106 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.58 cfs @ 12.11 hrs, Volume= 0.106 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 923.28' @ 12.11 hrs  
 Flood Elev= 930.54'

Device	Routing	Invert	Outlet Devices
#1	Primary	922.60'	<b>12.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 922.60' / 915.84' S= 0.0697 ' /' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.54 cfs @ 12.11 hrs HW=923.27' TW=893.29' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 1.54 cfs @ 2.78 fps)

**Summary for Pond dmh31: dmh**

Inflow Area = 0.260 ac, 40.58% Impervious, Inflow Depth = 1.71" for 2-year event  
 Inflow = 0.51 cfs @ 12.09 hrs, Volume= 0.037 af  
 Outflow = 0.51 cfs @ 12.09 hrs, Volume= 0.037 af, Atten= 0%, Lag= 0.0 min  
 Primary = 0.51 cfs @ 12.09 hrs, Volume= 0.037 af  
 Routed to Pond dmh33 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 876.12' @ 12.09 hrs  
 Flood Elev= 885.77'

Device	Routing	Invert	Outlet Devices
#1	Primary	875.76'	<b>12.0" Round Culvert</b> L= 96.0' Ke= 0.500 Inlet / Outlet Invert= 875.76' / 868.05' S= 0.0803 ' /' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.50 cfs @ 12.09 hrs HW=876.11' TW=860.14' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 0.50 cfs @ 2.02 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 24

**Summary for Pond dmh33: dmh**

Inflow Area = 0.397 ac, 48.09% Impervious, Inflow Depth = 1.85" for 2-year event  
 Inflow = 0.84 cfs @ 12.09 hrs, Volume= 0.061 af  
 Outflow = 0.84 cfs @ 12.09 hrs, Volume= 0.061 af, Atten= 0%, Lag= 0.0 min  
 Primary = 0.84 cfs @ 12.09 hrs, Volume= 0.061 af  
 Routed to Pond DS-2b : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 860.14' @ 12.09 hrs  
 Flood Elev= 864.98'

Device	Routing	Invert	Outlet Devices
#1	Primary	859.71'	<b>15.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.71' / 859.36' S= 0.0130 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.82 cfs @ 12.09 hrs HW=860.14' TW=859.37' (Dynamic Tailwater)  
**1=Culvert** (Barrel Controls 0.82 cfs @ 3.28 fps)

**Summary for Pond dmh50: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 1.02" for 2-year event  
 Inflow = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af  
 Outflow = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af  
 Routed to Pond dmh51 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 928.58' @ 12.16 hrs  
 Flood Elev= 933.94'

Device	Routing	Invert	Outlet Devices
#1	Primary	927.65'	<b>15.0" Round Culvert</b> L= 102.0' Ke= 0.500 Inlet / Outlet Invert= 927.65' / 919.50' S= 0.0799 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=3.05 cfs @ 12.16 hrs HW=928.55' TW=920.30' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 3.05 cfs @ 3.23 fps)

**Summary for Pond dmh51: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 1.02" for 2-year event  
 Inflow = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af  
 Outflow = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af  
 Routed to Pond dmh52 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 920.33' @ 12.16 hrs  
 Flood Elev= 924.04'

Device	Routing	Invert	Outlet Devices
#1	Primary	919.40'	<b>15.0" Round Culvert</b> L= 127.0' Ke= 0.500 Inlet / Outlet Invert= 919.40' / 909.50' S= 0.0780 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=3.05 cfs @ 12.16 hrs HW=920.30' TW=893.42' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 3.05 cfs @ 3.23 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 25

**Summary for Pond dmh52: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 1.02" for 2-year event  
 Inflow = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af  
 Outflow = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 893.45' @ 12.16 hrs  
 Flood Elev= 914.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.52'	<b>15.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 892.52' / 887.55' S= 0.0802 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=3.05 cfs @ 12.16 hrs HW=893.42' TW=887.81' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 3.05 cfs @ 3.23 fps)

**Summary for Pond dmh53: dmh**

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 1.56" for 2-year event  
 Inflow = 3.48 cfs @ 12.11 hrs, Volume= 0.184 af  
 Outflow = 3.48 cfs @ 12.11 hrs, Volume= 0.184 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.48 cfs @ 12.11 hrs, Volume= 0.184 af  
 Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 917.43' @ 12.11 hrs  
 Flood Elev= 921.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	916.46'	<b>18.0" Round Culvert</b> L= 31.0' Ke= 0.500 Inlet / Outlet Invert= 916.46' / 916.16' S= 0.0097 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=3.39 cfs @ 12.11 hrs HW=917.41' TW=906.55' (Dynamic Tailwater)  
**1=Culvert** (Barrel Controls 3.39 cfs @ 4.07 fps)

**Summary for Pond dmh55: dmh**

Inflow Area = 3.074 ac, 74.77% Impervious, Inflow Depth = 1.51" for 2-year event  
 Inflow = 7.80 cfs @ 12.11 hrs, Volume= 0.386 af  
 Outflow = 7.80 cfs @ 12.11 hrs, Volume= 0.386 af, Atten= 0%, Lag= 0.0 min  
 Primary = 7.80 cfs @ 12.11 hrs, Volume= 0.386 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 906.56' @ 12.11 hrs  
 Flood Elev= 911.86'

Device	Routing	Invert	Outlet Devices
#1	Primary	905.32'	<b>24.0" Round Culvert</b> L= 72.0' Ke= 0.500 Inlet / Outlet Invert= 905.32' / 903.80' S= 0.0211 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=7.61 cfs @ 12.11 hrs HW=906.55' TW=902.75' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 7.61 cfs @ 3.77 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 26

**Summary for Pond dmh56: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 1.55" for 2-year event  
 Inflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Outflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Routed to Pond dmh57 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 902.77' @ 12.13 hrs  
 Flood Elev= 908.47'

Device	Routing	Invert	Outlet Devices
#1	Primary	901.21'	<b>24.0" Round Culvert</b> L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 901.21' / 901.02' S= 0.0095 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=8.24 cfs @ 12.11 hrs HW=902.75' TW=902.24' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 8.24 cfs @ 4.38 fps)

**Summary for Pond dmh57: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 1.55" for 2-year event  
 Inflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Outflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Routed to Pond dmh58 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 902.26' @ 12.11 hrs  
 Flood Elev= 908.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	900.92'	<b>24.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 900.92' / 896.30' S= 0.0476 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=8.57 cfs @ 12.11 hrs HW=902.24' TW=897.39' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 8.57 cfs @ 3.91 fps)

**Summary for Pond dmh58: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 1.55" for 2-year event  
 Inflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Outflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Routed to Pond dmh59 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 897.41' @ 12.11 hrs  
 Flood Elev= 901.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	896.20'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 896.20' / 893.43' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=8.57 cfs @ 12.11 hrs HW=897.39' TW=894.56' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 8.57 cfs @ 3.72 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 27

**Summary for Pond dmh59: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 1.55" for 2-year event  
 Inflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Outflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Routed to Pond dmh60 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 894.58' @ 12.12 hrs  
 Flood Elev= 909.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	893.33'	<b>30.0" Round Culvert</b> L= 82.0' Ke= 0.500 Inlet / Outlet Invert= 893.33' / 892.50' S= 0.0101 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=8.20 cfs @ 12.11 hrs HW=894.56' TW=893.59' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 8.20 cfs @ 4.99 fps)

**Summary for Pond dmh60: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 1.55" for 2-year event  
 Inflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Outflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Routed to Pond dmh61 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 893.61' @ 12.11 hrs  
 Flood Elev= 901.96'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.40'	<b>30.0" Round Culvert</b> L= 258.0' Ke= 0.500 Inlet / Outlet Invert= 892.40' / 889.43' S= 0.0115 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=8.57 cfs @ 12.11 hrs HW=893.59' TW=890.52' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 8.57 cfs @ 3.72 fps)

**Summary for Pond dmh61: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 1.55" for 2-year event  
 Inflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Outflow = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.78 cfs @ 12.11 hrs, Volume= 0.446 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 890.54' @ 12.11 hrs  
 Flood Elev= 898.16'

Device	Routing	Invert	Outlet Devices
#1	Primary	889.33'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 889.33' / 886.55' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=8.57 cfs @ 12.11 hrs HW=890.52' TW=887.79' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 8.57 cfs @ 3.72 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 28

**Summary for Pond dmh62: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 1.40" for 2-year event  
 Inflow = 11.41 cfs @ 12.14 hrs, Volume= 0.566 af  
 Outflow = 11.41 cfs @ 12.14 hrs, Volume= 0.566 af, Atten= 0%, Lag= 0.0 min  
 Primary = 11.41 cfs @ 12.14 hrs, Volume= 0.566 af  
 Routed to Pond dmh69 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 887.85' @ 12.14 hrs  
 Flood Elev= 902.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	886.45'	<b>30.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 886.45' / 884.91' S= 0.0248 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=11.10 cfs @ 12.14 hrs HW=887.83' TW=813.86' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 11.10 cfs @ 4.00 fps)

**Summary for Pond dmh69: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 1.40" for 2-year event  
 Inflow = 11.41 cfs @ 12.14 hrs, Volume= 0.566 af  
 Outflow = 11.41 cfs @ 12.14 hrs, Volume= 0.566 af, Atten= 0%, Lag= 0.0 min  
 Primary = 11.41 cfs @ 12.14 hrs, Volume= 0.566 af  
 Routed to Pond DB-1 : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 813.88' @ 12.14 hrs  
 Flood Elev= 818.02'

Device	Routing	Invert	Outlet Devices
#1	Primary	812.48'	<b>30.0" Round Culvert</b> L= 29.0' Ke= 0.500 Inlet / Outlet Invert= 812.48' / 811.50' S= 0.0338 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=11.10 cfs @ 12.14 hrs HW=813.86' TW=811.44' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 11.10 cfs @ 4.00 fps)

**Summary for Pond DS-1a: detention**

Inflow Area = 2.795 ac, 46.49% Impervious, Inflow Depth = 1.28" for 2-year event  
 Inflow = 5.51 cfs @ 12.11 hrs, Volume= 0.299 af  
 Outflow = 0.56 cfs @ 12.96 hrs, Volume= 0.299 af, Atten= 90%, Lag= 51.1 min  
 Primary = 0.56 cfs @ 12.96 hrs, Volume= 0.299 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 849.45' @ 12.96 hrs Surf.Area= 4,480 sf Storage= 5,812 cf  
 Flood Elev= 853.00' Surf.Area= 4,505 sf Storage= 19,995 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)  
 Center-of-Mass det. time= 124.7 min ( 944.2 - 819.5 )

Volume	Invert	Avail. Storage	Storage Description
#1A	848.00'	0 cf	<b>112.00'W x 40.00'L x 5.67'H Field A</b> 25,387 cf Overall - 25,387 cf Embedded = 0 cf
#2A	848.00'	19,995 cf	<b>retain_it retain_it 5.0' x 70</b> Inside #1 Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 14 Rows adjusted for 394.8 cf perimeter wall
#3	853.00'	56 cf	<b>4.00'D x 4.45'H CB-9</b>
#4	853.00'	38 cf	<b>4.00'D x 3.00'H CB-8</b>
		20,088 cf	Total Available Storage

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 29

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	847.90'	<b>15.0" Round Culvert</b> L= 129.0' Ke= 0.500 Inlet / Outlet Invert= 847.90' / 846.36' S= 0.0119 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	847.90'	<b>3.0" Vert. 3" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	849.50'	<b>7.0" Vert. 7" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	851.30'	<b>6.0" Vert. 6" Orifice (25yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	851.90'	<b>8.0" Vert. 8" Orifice (50yr) X 3.00</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	852.80'	<b>4.0' long Overflow Weir</b> 2 End Contraction(s) 4.0' Crest Height

**Primary OutFlow** Max=0.56 cfs @ 12.96 hrs HW=849.45' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 0.56 cfs of 5.69 cfs potential flow)
- 2=3" Orifice (2yr) (Orifice Controls 0.56 cfs @ 5.75 fps)
- 3=7" Orifice (10yr) ( Controls 0.00 cfs)
- 4=6" Orifice (25yr) ( Controls 0.00 cfs)
- 5=8" Orifice (50yr) ( Controls 0.00 cfs)
- 6=Overflow Weir ( Controls 0.00 cfs)

**Summary for Pond DS-1b: detention**

Inflow Area = 0.571 ac, 23.27% Impervious, Inflow Depth = 1.30" for 2-year event  
 Inflow = 0.78 cfs @ 12.12 hrs, Volume= 0.062 af  
 Outflow = 0.27 cfs @ 12.48 hrs, Volume= 0.061 af, Atten= 65%, Lag= 21.6 min  
 Primary = 0.27 cfs @ 12.48 hrs, Volume= 0.061 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 859.78' @ 12.48 hrs Surf.Area= 1,536 sf Storage= 778 cf  
 Flood Elev= 862.70' Surf.Area= 1,536 sf Storage= 4,684 cf

Plug-Flow detention time= 64.9 min calculated for 0.061 af (99% of inflow)  
 Center-of-Mass det. time= 61.9 min ( 912.6 - 850.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.20'	0 cf	<b>64.00'W x 24.00'L x 4.17'H Field A</b> 6,400 cf Overall - 6,400 cf Embedded = 0 cf x 40.0% Voids
#2A	859.20'	4,684 cf	<b>retain_it retain_it 3.5' x 24</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 8 Rows adjusted for 135.1 cf perimeter wall
		4,684 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	859.20'	<b>12.0" Round Culvert</b> L= 100.0' Ke= 0.500 Inlet / Outlet Invert= 859.20' / 858.10' S= 0.0110 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>4.0" Vert. 4" Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>12.0" Vert. Overflow</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.27 cfs @ 12.48 hrs HW=859.78' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 0.27 cfs of 1.23 cfs potential flow)
- 2=4" Orifice (Orifice Controls 0.27 cfs @ 3.10 fps)
- 3=Overflow ( Controls 0.00 cfs)

**Summary for Pond DS-2a: detention**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth = 1.43" for 2-year event  
 Inflow = 13.10 cfs @ 12.12 hrs, Volume= 0.734 af  
 Outflow = 1.46 cfs @ 12.88 hrs, Volume= 0.732 af, Atten= 89%, Lag= 46.1 min  
 Primary = 1.46 cfs @ 12.88 hrs, Volume= 0.732 af  
 Routed to Pond G1 : gabion

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 30

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 895.17' @ 12.88 hrs Surf.Area= 4,704 sf Storage= 15,254 cf  
 Flood Elev= 902.66' Storage= 48,125 cf

Plug-Flow detention time= 137.4 min calculated for 0.731 af (100% of inflow)  
 Center-of-Mass det. time= 136.3 min ( 952.0 - 815.6 )

Volume	Invert	Avail.Storage	Storage Description
#1	892.00'	24,073 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 7 Rows adjusted for 394.8 cf perimeter wall
#2	897.00'	24,052 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 6 Rows adjusted for 415.6 cf perimeter wall
		48,125 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	892.00'	<b>24.0" Round Culvert</b> L= 46.0' Ke= 0.500 Inlet / Outlet Invert= 892.00' / 890.52' S= 0.0322 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	892.00'	<b>4.0" Vert. Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	895.40'	<b>8.0" Vert. Orifice (10yr)</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	898.20'	<b>8.0" Vert. Orifice (25yr)</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	899.90'	<b>4.0" Vert. Orifice (50yr)</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	902.00'	<b>4.0' long Sharp-Crested Weir Overflow (100yr)</b> 2 End Contraction(s)

**Primary OutFlow** Max=1.46 cfs @ 12.88 hrs HW=895.17' TW=877.54' (Dynamic Tailwater)

- 1=Culvert (Passes 1.46 cfs of 22.27 cfs potential flow)
- 2=Orifice (2yr) (Orifice Controls 1.46 cfs @ 8.34 fps)
- 3=Orifice (10yr) ( Controls 0.00 cfs)
- 4=Orifice (25yr) ( Controls 0.00 cfs)
- 5=Orifice (50yr) ( Controls 0.00 cfs)
- 6=Sharp-Crested Weir Overflow (100yr)( Controls 0.00 cfs)

**Summary for Pond DS-2b: detention**

Inflow Area = 2.217 ac, 10.77% Impervious, Inflow Depth = 1.12" for 2-year event  
 Inflow = 2.70 cfs @ 12.10 hrs, Volume= 0.206 af  
 Outflow = 0.64 cfs @ 12.54 hrs, Volume= 0.180 af, Atten= 76%, Lag= 26.6 min  
 Primary = 0.64 cfs @ 12.54 hrs, Volume= 0.180 af  
 Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 859.68' @ 12.54 hrs Surf.Area= 5,632 sf Storage= 3,401 cf  
 Flood Elev= 862.70' Surf.Area= 5,645 sf Storage= 17,438 cf

Plug-Flow detention time= 178.4 min calculated for 0.180 af (88% of inflow)  
 Center-of-Mass det. time= 120.2 min ( 973.6 - 853.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.00'	0 cf	<b>88.00'W x 64.00'L x 4.17'H Field A</b> 23,467 cf Overall - 23,467 cf Embedded = 0 cf x 40.0% Voids
#2A	859.00'	17,435 cf	<b>retain_it retain_it 3.5' x 88</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 11 Rows adjusted for 233.3 cf perimeter wall
#3	862.50'	9 cf	<b>4.00'D x 0.70'H Vertical Cone/Cylinder</b>
		17,444 cf	Total Available Storage

Storage Group A created with Chamber Wizard



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 31

Device	Routing	Invert	Outlet Devices
#1	Primary	858.90'	<b>12.0" Round Culvert</b> L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 858.90' / 858.44' S= 0.0153 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>8.0" Vert. Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>4.0' long Sharp-Crested Rectangular Weir</b> 2 End Contraction(s) 0.5' Crest Height
#4	Device 1	863.20'	<b>24.0" x 24.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.64 cfs @ 12.54 hrs HW=859.68' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 0.64 cfs of 1.99 cfs potential flow)  
 2=Orifice (Orifice Controls 0.64 cfs @ 2.36 fps)  
 3=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)  
 4=Orifice/Grate (Controls 0.00 cfs)

**Summary for Pond DW-1: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 2.02" for 2-year event  
 Inflow = 3.93 cfs @ 12.09 hrs, Volume= 0.286 af  
 Outflow = 3.82 cfs @ 12.12 hrs, Volume= 0.260 af, Atten= 3%, Lag= 1.6 min  
 Discarded = 0.05 cfs @ 12.05 hrs, Volume= 0.091 af  
 Primary = 3.78 cfs @ 12.12 hrs, Volume= 0.169 af  
 Routed to Pond dmh05 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 12.05 hrs Surf.Area= 0.031 ac Storage= 0.063 af

Plug-Flow detention time= 214.6 min calculated for 0.260 af (91% of inflow)  
 Center-of-Mass det. time= 168.7 min ( 983.4 - 814.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 14.00 = 0.063 af Total Available Storage			

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 12.05 hrs HW=3.50' (Free Discharge)

- 1=Exfiltration (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.12 hrs HW=3.50' TW=869.53' (Dynamic Tailwater)

- 2=Culvert (Controls 0.00 cfs)

**Summary for Pond DW-10: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 32

Inflow Area = 3.168 ac, 18.24% Impervious, Inflow Depth = 1.11" for 2-year event  
 Inflow = 3.10 cfs @ 12.20 hrs, Volume= 0.294 af  
 Outflow = 3.05 cfs @ 12.22 hrs, Volume= 0.283 af, Atten= 2%, Lag= 1.5 min  
 Discarded = 0.02 cfs @ 12.10 hrs, Volume= 0.036 af  
 Primary = 0.19 cfs @ 12.10 hrs, Volume= 0.116 af  
 Routed to Link SP1 : STUDY POINT #1  
 Secondary = 2.85 cfs @ 12.22 hrs, Volume= 0.132 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Primary area = Inflow area x 0.142  
 Peak Elev= 3.50' @ 12.10 hrs Surf.Area= 0.013 ac Storage= 0.027 af

Plug-Flow detention time= 86.3 min calculated for 0.283 af (96% of inflow)  
 Center-of-Mass det. time= 66.2 min ( 931.2 - 865.0 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 6.00 = 0.027 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Secondary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	3.00'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 3.00' / 3.00' S= 0.0000 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.02 cfs @ 12.10 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.02 cfs)**Primary OutFlow** Max=0.19 cfs @ 12.10 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)↑**2=Culvert** (Barrel Controls 0.19 cfs @ 2.14 fps)**Secondary OutFlow** Max=0.00 cfs @ 12.22 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)**Summary for Pond DW-2: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.  
 Storage multiplier added to account for number of dwelling units with subcatchment.  
 Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.375 ac, 77.23% Impervious, Inflow Depth = 2.47" for 2-year event  
 Inflow = 1.03 cfs @ 12.09 hrs, Volume= 0.077 af  
 Outflow = 0.99 cfs @ 12.11 hrs, Volume= 0.074 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 11.35 hrs, Volume= 0.014 af  
 Primary = 0.98 cfs @ 12.11 hrs, Volume= 0.060 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 11.35 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 121.9 min calculated for 0.073 af (95% of inflow)  
 Center-of-Mass det. time= 95.3 min ( 887.6 - 792.3 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 33

0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 11.35 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=902.75' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-3: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.657 ac, 78.20% Impervious, Inflow Depth = 2.47" for 2-year event  
 Inflow = 4.55 cfs @ 12.09 hrs, Volume= 0.342 af  
 Outflow = 4.37 cfs @ 12.11 hrs, Volume= 0.311 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 11.90 hrs, Volume= 0.109 af  
 Primary = 4.32 cfs @ 12.11 hrs, Volume= 0.203 af  
 Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 11.90 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 210.4 min calculated for 0.311 af (91% of inflow)  
 Center-of-Mass det. time= 166.1 min ( 958.4 - 792.3 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 11.90 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=906.55' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-4: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 34

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 2.29" for 2-year event  
 Inflow = 3.65 cfs @ 12.09 hrs, Volume= 0.270 af  
 Outflow = 3.51 cfs @ 12.11 hrs, Volume= 0.251 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.03 cfs @ 11.85 hrs, Volume= 0.067 af  
 Primary = 3.48 cfs @ 12.11 hrs, Volume= 0.184 af  
 Routed to Pond dmh53 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 11.85 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 167.3 min calculated for 0.251 af (93% of inflow)  
 Center-of-Mass det. time= 130.1 min ( 932.3 - 802.1 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 10.00 = 0.045 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 11.85 hrs HW=3.50' (Free Discharge)  
 ↑ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=917.41' (Dynamic Tailwater)  
 ↑ **2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-5: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.  
 Storage multiplier added to account for number of dwelling units with subcatchment.  
 Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 1.71" for 2-year event  
 Inflow = 2.96 cfs @ 12.09 hrs, Volume= 0.215 af  
 Outflow = 2.84 cfs @ 12.12 hrs, Volume= 0.207 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 11.70 hrs, Volume= 0.026 af  
 Primary = 2.82 cfs @ 12.12 hrs, Volume= 0.181 af  
 Routed to Pond dmh20 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 11.70 hrs Surf.Area= 0.009 ac Storage= 0.018 af

Plug-Flow detention time= 84.2 min calculated for 0.207 af (96% of inflow)  
 Center-of-Mass det. time= 64.1 min ( 893.2 - 829.1 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 4.00 = 0.018 af Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 35

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 11.70 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.12 hrs HW=3.50' TW=903.58' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-6: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 2.29" for 2-year event  
Inflow = 3.62 cfs @ 12.09 hrs, Volume= 0.268 af  
Outflow = 3.28 cfs @ 12.16 hrs, Volume= 0.236 af, Atten= 9%, Lag= 4.2 min  
Discarded = 0.06 cfs @ 12.10 hrs, Volume= 0.117 af  
Primary = 3.22 cfs @ 12.16 hrs, Volume= 0.120 af  
Routed to Pond dmh50 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 12.10 hrs Surf.Area= 0.040 ac Storage= 0.081 af

Plug-Flow detention time= 292.0 min calculated for 0.236 af (88% of inflow)

Center-of-Mass det. time= 238.4 min ( 1,040.5 - 802.1 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 18.00 = 0.081 af			Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.06 cfs @ 12.10 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.06 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.16 hrs HW=3.50' TW=928.55' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-7: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 36

Inflow Area = 2.354 ac, 54.62% Impervious, Inflow Depth = 1.94" for 2-year event  
 Inflow = 5.24 cfs @ 12.09 hrs, Volume= 0.381 af  
 Outflow = 5.03 cfs @ 12.12 hrs, Volume= 0.350 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 12.00 hrs, Volume= 0.104 af  
 Primary = 4.98 cfs @ 12.12 hrs, Volume= 0.247 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 12.00 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 184.8 min calculated for 0.350 af (92% of inflow)  
 Center-of-Mass det. time= 143.9 min ( 962.4 - 818.5 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 12.00 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.05 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.12 hrs HW=3.50' TW=900.78' (Dynamic Tailwater)↑**2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-8: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 2.47" for 2-year event  
 Inflow = 1.65 cfs @ 12.09 hrs, Volume= 0.124 af  
 Outflow = 1.59 cfs @ 12.11 hrs, Volume= 0.120 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 10.50 hrs, Volume= 0.014 af  
 Primary = 1.58 cfs @ 12.11 hrs, Volume= 0.106 af  
 Routed to Pond dmh25 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 10.50 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 79.9 min calculated for 0.120 af (97% of inflow)  
 Center-of-Mass det. time= 62.6 min ( 855.0 - 792.3 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 37

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 10.50 hrs HW=3.50' (Free Discharge)↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=923.27' (Dynamic Tailwater)↑ **2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-9: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.688 ac, 56.40% Impervious, Inflow Depth = 2.02" for 2-year event  
 Inflow = 3.91 cfs @ 12.09 hrs, Volume= 0.285 af  
 Outflow = 3.75 cfs @ 12.11 hrs, Volume= 0.266 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.03 cfs @ 11.90 hrs, Volume= 0.066 af  
 Primary = 3.72 cfs @ 12.11 hrs, Volume= 0.200 af  
 Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 11.90 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 155.3 min calculated for 0.265 af (93% of inflow)

Center-of-Mass det. time= 121.1 min ( 935.8 - 814.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 10.00 = 0.045 af			Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 11.90 hrs HW=3.50' (Free Discharge)↑ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=899.07' (Dynamic Tailwater)↑ **2=Culvert** ( Controls 0.00 cfs)**Summary for Pond G1: gabion**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth > 1.43" for 2-year event  
 Inflow = 1.46 cfs @ 12.88 hrs, Volume= 0.732 af  
 Outflow = 1.46 cfs @ 12.89 hrs, Volume= 0.732 af, Atten= 0%, Lag= 0.2 min  
 Primary = 1.46 cfs @ 12.89 hrs, Volume= 0.732 af  
 Routed to Reach R-02 : Routing through wetland/swale

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 38

Peak Elev= 877.54' @ 12.89 hrs Surf.Area= 115 sf Storage= 3 cf  
 Flood Elev= 880.00' Surf.Area= 2 sf Storage= 444 cf

Plug-Flow detention time= 0.0 min calculated for 0.731 af (100% of inflow)  
 Center-of-Mass det. time= 0.0 min ( 952.0 - 952.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	877.50'	442 cf	<b>18.0" Round Pipe Storage</b> L= 250.0'
#2	879.00'	2 cf	<b>1.50'D x 1.00'H Vertical Cone/Cylinder</b>
		444 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	877.50'	<b>2.0" Horiz. invert orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	878.25'	<b>2.0" Vert. spring line orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	880.00'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=1.46 cfs @ 12.89 hrs HW=877.54' TW=876.11' (Dynamic Tailwater)

- 1=invert orifices (Weir Controls 1.46 cfs @ 0.62 fps)
- 2=spring line orifices ( Controls 0.00 cfs)
- 3=overflow grates ( Controls 0.00 cfs)

**Summary for Pond G2: gabion**

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth > 1.10" for 2-year event  
 Inflow = 2.82 cfs @ 12.69 hrs, Volume= 0.902 af  
 Outflow = 2.82 cfs @ 12.68 hrs, Volume= 0.902 af, Atten= 0%, Lag= 0.0 min  
 Primary = 2.82 cfs @ 12.68 hrs, Volume= 0.902 af  
 Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 810.41' @ 12.68 hrs Surf.Area= 63 sf Storage= 5 cf  
 Flood Elev= 811.80' Storage= 141 cf

Plug-Flow detention time= 0.0 min calculated for 0.902 af (100% of inflow)  
 Center-of-Mass det. time= 0.0 min ( 944.0 - 944.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	810.30'	141 cf	<b>18.0" Round Pipe Storage</b> L= 80.0'

Device	Routing	Invert	Outlet Devices
#1	Primary	810.30'	<b>2.0" Horiz. invert orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	811.05'	<b>2.0" Vert. spring line orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	811.80'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=2.82 cfs @ 12.68 hrs HW=810.41' TW=0.00' (Dynamic Tailwater)

- 1=invert orifices (Orifice Controls 2.82 cfs @ 1.61 fps)
- 2=spring line orifices ( Controls 0.00 cfs)
- 3=overflow grates ( Controls 0.00 cfs)

**Summary for Link SP1: STUDY POINT #1**

Inflow Area = 6.871 ac, 30.28% Impervious, Inflow Depth = 1.12" for 2-year event  
 Inflow = 3.95 cfs @ 12.23 hrs, Volume= 0.639 af  
 Primary = 3.95 cfs @ 12.23 hrs, Volume= 0.639 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP2: STUDY POINT #2**

Inflow Area = 10.269 ac, 37.04% Impervious, Inflow Depth > 1.27" for 2-year event  
 Inflow = 2.32 cfs @ 12.69 hrs, Volume= 1.090 af  
 Primary = 2.32 cfs @ 12.69 hrs, Volume= 1.090 af, Atten= 0%, Lag= 0.0 min



## 2889-01 - Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 2-year Rainfall=3.23"

Printed 12/14/2021

Page 39

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP3: STUDY POINT #3

Inflow Area = 11.229 ac, 32.11% Impervious, Inflow Depth > 1.08" for 2-year event  
Inflow = 3.23 cfs @ 12.65 hrs, Volume= 1.009 af  
Primary = 3.23 cfs @ 12.65 hrs, Volume= 1.009 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP4: STUDY POINT #4

Inflow Area = 0.658 ac, 9.82% Impervious, Inflow Depth = 1.11" for 2-year event  
Inflow = 0.81 cfs @ 12.10 hrs, Volume= 0.061 af  
Primary = 0.81 cfs @ 12.10 hrs, Volume= 0.061 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP5: STUDY POINT #5

Inflow Area = 0.158 ac, 0.00% Impervious, Inflow Depth = 1.00" for 2-year event  
Inflow = 0.17 cfs @ 12.10 hrs, Volume= 0.013 af  
Primary = 0.17 cfs @ 12.10 hrs, Volume= 0.013 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 40

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN

Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>SubcatchmentP-1A: Subcat P-1A</b>	Runoff Area=3.168 ac 18.24% Impervious Runoff Depth=2.33" Flow Length=782' Tc=13.3 min CN=75 Runoff=6.75 cfs 0.615 af
<b>SubcatchmentP-1B: Subcat P-1B</b>	Runoff Area=24,871 sf 23.27% Impervious Runoff Depth=2.58" Flow Length=315' Tc=8.2 min CN=78 Runoff=1.58 cfs 0.123 af
<b>SubcatchmentP-1C: Subcat P-1C</b>	Runoff Area=0.337 ac 20.77% Impervious Runoff Depth=2.33" Tc=6.0 min CN=75 Runoff=0.90 cfs 0.065 af
<b>SubcatchmentP-1D: Subcat P-1D</b>	Runoff Area=31,162 sf 19.39% Impervious Runoff Depth=2.50" Tc=6.0 min CN=77 Runoff=2.05 cfs 0.149 af
<b>SubcatchmentP-1E: Subcat P-1E</b>	Runoff Area=0.382 ac 53.49% Impervious Runoff Depth=3.23" Tc=6.0 min CN=85 Runoff=1.40 cfs 0.103 af
<b>SubcatchmentP-1F: Subcat P-1F</b>	Runoff Area=1.697 ac 56.34% Impervious Runoff Depth=3.53" Tc=6.0 min CN=88 Runoff=6.72 cfs 0.499 af
<b>SubcatchmentP-2A: Subcat P-2A</b>	Runoff Area=1.773 ac 10.14% Impervious Runoff Depth=2.33" Tc=6.0 min CN=75 Runoff=4.73 cfs 0.344 af
<b>SubcatchmentP-2B: Subcat P-2B</b>	Runoff Area=1.201 ac 0.00% Impervious Runoff Depth=1.93" Tc=6.0 min CN=70 Runoff=2.61 cfs 0.193 af
<b>SubcatchmentP-2C: Subcat P-2C</b>	Runoff Area=0.137 ac 62.40% Impervious Runoff Depth=3.63" Tc=6.0 min CN=89 Runoff=0.55 cfs 0.041 af
<b>SubcatchmentP-2D: Subcat P-2D</b>	Runoff Area=0.260 ac 40.58% Impervious Runoff Depth=3.13" Tc=6.0 min CN=84 Runoff=0.93 cfs 0.068 af
<b>SubcatchmentP-2E: Subcat P-2E</b>	Runoff Area=2.354 ac 54.62% Impervious Runoff Depth=3.43" Tc=6.0 min CN=87 Runoff=9.10 cfs 0.672 af
<b>SubcatchmentP-2F: Subcat P-2F</b>	Runoff Area=1.509 ac 43.37% Impervious Runoff Depth=3.13" Tc=6.0 min CN=84 Runoff=5.39 cfs 0.394 af
<b>SubcatchmentP-2G: Subcat P-2G</b>	Runoff Area=1.688 ac 56.40% Impervious Runoff Depth=3.53" Tc=6.0 min CN=88 Runoff=6.68 cfs 0.496 af
<b>SubcatchmentP-2H: Subcat P-2H</b>	Runoff Area=0.601 ac 77.35% Impervious Runoff Depth=4.05" Tc=6.0 min CN=93 Runoff=2.62 cfs 0.203 af
<b>SubcatchmentP-2I: Subcat P-2I</b>	Runoff Area=0.127 ac 22.66% Impervious Runoff Depth=2.67" Tc=6.0 min CN=79 Runoff=0.39 cfs 0.028 af
<b>SubcatchmentP-2J: Subcat P-2J</b>	Runoff Area=0.619 ac 7.73% Impervious Runoff Depth=2.41" Tc=6.0 min CN=76 Runoff=1.71 cfs 0.124 af
<b>SubcatchmentP-3A: Subcat P-3A</b>	Runoff Area=5.023 ac 0.00% Impervious Runoff Depth=1.93" Flow Length=644' Tc=16.1 min CN=70 Runoff=8.08 cfs 0.806 af
<b>SubcatchmentP-3B: Subcat P-3B</b>	Runoff Area=1.351 ac 0.01% Impervious Runoff Depth=2.08" Tc=6.0 min CN=72 Runoff=3.20 cfs 0.234 af
<b>SubcatchmentP-3C: Subcat P-3C</b>	Runoff Area=0.375 ac 77.23% Impervious Runoff Depth=4.05" Tc=6.0 min CN=93 Runoff=1.64 cfs 0.127 af
<b>SubcatchmentP-3D: Subcat P-3D</b>	Runoff Area=1.657 ac 78.20% Impervious Runoff Depth=4.05" Tc=6.0 min CN=93 Runoff=7.24 cfs 0.559 af
<b>SubcatchmentP-3E: Subcat P-3E</b>	Runoff Area=1.417 ac 70.76% Impervious Runoff Depth=3.84" Tc=6.0 min CN=91 Runoff=5.98 cfs 0.453 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 41

**SubcatchmentP-3F: Subcat P-3F**

Runoff Area=1.406 ac 72.39% Impervious Runoff Depth=3.84"  
Tc=6.0 min CN=91 Runoff=5.93 cfs 0.449 af

**SubcatchmentP-4: Subcat P-4**

Runoff Area=28,663 sf 9.82% Impervious Runoff Depth=2.33"  
Tc=6.0 min CN=75 Runoff=1.76 cfs 0.128 af

**SubcatchmentP-5: Subcat P-5**

Runoff Area=6,874 sf 0.00% Impervious Runoff Depth=2.16"  
Tc=6.0 min CN=73 Runoff=0.39 cfs 0.028 af

**Reach R-01: Routing to wetlands**

Avg. Flow Depth=0.23' Max Vel=0.32 fps Inflow=3.20 cfs 0.234 af  
n=0.400 L=722.0' S=0.1087 '/' Capacity=43.77 cfs Outflow=1.25 cfs 0.234 af

**Reach R-02: Routing through wetland/swale**

Avg. Flow Depth=0.71' Max Vel=0.33 fps Inflow=6.70 cfs 1.823 af  
n=0.400 L=525.0' S=0.0223 '/' Capacity=26.65 cfs Outflow=5.15 cfs 1.822 af

**Pond 1P: depression**

Peak Elev=862.40' Storage=149 cf Inflow=5.15 cfs 1.822 af  
Primary=5.15 cfs 1.822 af Secondary=0.00 cfs 0.000 af Outflow=5.15 cfs 1.822 af

**Pond DB-1: detention**

Peak Elev=812.88' Storage=32,293 cf Inflow=25.55 cfs 1.981 af  
Primary=9.03 cfs 1.962 af Secondary=0.00 cfs 0.000 af Outflow=9.03 cfs 1.962 af

**Pond dmh01: dmh**

Peak Elev=850.61' Inflow=1.40 cfs 0.103 af  
12.0" Round Culvert n=0.013 L=12.0' S=0.0100 '/' Outflow=1.40 cfs 0.103 af

**Pond dmh05: dmh**

Peak Elev=870.32' Inflow=6.41 cfs 0.376 af  
15.0" Round Culvert n=0.013 L=97.0' S=0.0351 '/' Outflow=6.41 cfs 0.376 af

**Pond dmh20: dmh**

Peak Elev=904.13' Inflow=5.17 cfs 0.359 af  
15.0" Round Culvert n=0.013 L=205.0' S=0.0119 '/' Outflow=5.17 cfs 0.359 af

**Pond dmh21: dmh**

Peak Elev=901.42' Inflow=13.86 cfs 0.891 af  
24.0" Round Culvert n=0.013 L=190.0' S=0.0100 '/' Outflow=13.86 cfs 0.891 af

**Pond dmh23: dmh**

Peak Elev=899.77' Inflow=20.24 cfs 1.298 af  
30.0" Round Culvert n=0.013 L=27.0' S=0.0130 '/' Outflow=20.24 cfs 1.298 af

**Pond dmh25: dmh**

Peak Elev=923.54' Inflow=2.52 cfs 0.184 af  
12.0" Round Culvert n=0.013 L=97.0' S=0.0697 '/' Outflow=2.52 cfs 0.184 af

**Pond dmh31: dmh**

Peak Elev=876.26' Inflow=0.93 cfs 0.068 af  
12.0" Round Culvert n=0.013 L=96.0' S=0.0803 '/' Outflow=0.93 cfs 0.068 af

**Pond dmh33: dmh**

Peak Elev=860.40' Inflow=1.48 cfs 0.109 af  
15.0" Round Culvert n=0.013 L=27.0' S=0.0130 '/' Outflow=1.48 cfs 0.109 af

**Pond dmh50: dmh**

Peak Elev=929.19' Inflow=5.64 cfs 0.291 af  
15.0" Round Culvert n=0.013 L=102.0' S=0.0799 '/' Outflow=5.64 cfs 0.291 af

**Pond dmh51: dmh**

Peak Elev=920.94' Inflow=5.64 cfs 0.291 af  
15.0" Round Culvert n=0.013 L=127.0' S=0.0780 '/' Outflow=5.64 cfs 0.291 af

**Pond dmh52: dmh**

Peak Elev=894.06' Inflow=5.64 cfs 0.291 af  
15.0" Round Culvert n=0.013 L=62.0' S=0.0802 '/' Outflow=5.64 cfs 0.291 af

**Pond dmh53: dmh**

Peak Elev=917.80' Inflow=5.72 cfs 0.362 af  
18.0" Round Culvert n=0.013 L=31.0' S=0.0097 '/' Outflow=5.72 cfs 0.362 af

**Pond dmh55: dmh**

Peak Elev=907.02' Inflow=12.63 cfs 0.776 af  
24.0" Round Culvert n=0.013 L=72.0' S=0.0211 '/' Outflow=12.63 cfs 0.776 af

**Pond dmh56: dmh**

Peak Elev=903.54' Inflow=14.21 cfs 0.884 af  
24.0" Round Culvert n=0.013 L=20.0' S=0.0095 '/' Outflow=14.21 cfs 0.884 af

**Pond dmh57: dmh**

Peak Elev=902.79' Inflow=14.21 cfs 0.884 af  
24.0" Round Culvert n=0.013 L=97.0' S=0.0476 '/' Outflow=14.21 cfs 0.884 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 42

<b>Pond dmh58: dmh</b>	Peak Elev=897.79' Inflow=14.21 cfs 0.884 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=14.21 cfs 0.884 af
<b>Pond dmh59: dmh</b>	Peak Elev=895.02' Inflow=14.21 cfs 0.884 af 30.0" Round Culvert n=0.013 L=82.0' S=0.0101 '/' Outflow=14.21 cfs 0.884 af
<b>Pond dmh60: dmh</b>	Peak Elev=893.99' Inflow=14.21 cfs 0.884 af 30.0" Round Culvert n=0.013 L=258.0' S=0.0115 '/' Outflow=14.21 cfs 0.884 af
<b>Pond dmh61: dmh</b>	Peak Elev=890.92' Inflow=14.21 cfs 0.884 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=14.21 cfs 0.884 af
<b>Pond dmh62: dmh</b>	Peak Elev=888.42' Inflow=19.85 cfs 1.174 af 30.0" Round Culvert n=0.013 L=62.0' S=0.0248 '/' Outflow=19.85 cfs 1.174 af
<b>Pond dmh69: dmh</b>	Peak Elev=814.45' Inflow=19.85 cfs 1.174 af 30.0" Round Culvert n=0.013 L=29.0' S=0.0338 '/' Outflow=19.85 cfs 1.174 af
<b>Pond DS-1a: detention</b>	Peak Elev=850.60' Storage=10,411 cf Inflow=9.82 cfs 0.628 af Outflow=3.08 cfs 0.628 af
<b>Pond DS-1b: detention</b>	Peak Elev=860.49' Storage=1,725 cf Inflow=1.58 cfs 0.123 af Outflow=0.45 cfs 0.123 af
<b>Pond DS-2a: detention</b>	Peak Elev=898.06' Storage=29,193 cf Inflow=22.76 cfs 1.482 af Outflow=4.61 cfs 1.479 af
<b>Pond DS-2b: detention</b>	Peak Elev=860.39' Storage=6,906 cf Inflow=5.80 cfs 0.426 af Outflow=1.55 cfs 0.401 af
<b>Pond DW-1: House Drywell</b>	Peak Elev=3.50' Storage=0.063 af Inflow=6.72 cfs 0.499 af Discarded=0.05 cfs 0.096 af Primary=6.41 cfs 0.376 af Outflow=6.46 cfs 0.472 af
<b>Pond DW-10: House Drywell</b>	Peak Elev=3.50' Storage=0.027 af Inflow=6.75 cfs 0.615 af Discarded=0.02 cfs 0.038 af Primary=0.19 cfs 0.168 af Secondary=6.45 cfs 0.397 af Outflow=6.65 cfs 0.604 af
<b>Pond DW-2: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=1.64 cfs 0.127 af Discarded=0.01 cfs 0.015 af Primary=1.57 cfs 0.108 af Outflow=1.58 cfs 0.123 af
<b>Pond DW-3: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=7.24 cfs 0.559 af Discarded=0.05 cfs 0.115 af Primary=6.92 cfs 0.413 af Outflow=6.97 cfs 0.529 af
<b>Pond DW-4: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=5.98 cfs 0.453 af Discarded=0.03 cfs 0.072 af Primary=5.72 cfs 0.362 af Outflow=5.75 cfs 0.434 af
<b>Pond DW-5: House Drywell</b>	Peak Elev=3.50' Storage=0.018 af Inflow=5.39 cfs 0.394 af Discarded=0.01 cfs 0.028 af Primary=5.17 cfs 0.359 af Outflow=5.18 cfs 0.386 af
<b>Pond DW-6: House Drywell</b>	Peak Elev=3.50' Storage=0.081 af Inflow=5.93 cfs 0.449 af Discarded=0.06 cfs 0.125 af Primary=5.64 cfs 0.291 af Outflow=5.70 cfs 0.415 af
<b>Pond DW-7: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=9.10 cfs 0.672 af Discarded=0.05 cfs 0.110 af Primary=8.69 cfs 0.532 af Outflow=8.74 cfs 0.642 af
<b>Pond DW-8: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=2.62 cfs 0.203 af Discarded=0.01 cfs 0.015 af Primary=2.52 cfs 0.184 af Outflow=2.53 cfs 0.199 af
<b>Pond DW-9: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=6.68 cfs 0.496 af Discarded=0.03 cfs 0.070 af Primary=6.39 cfs 0.407 af Outflow=6.42 cfs 0.477 af
<b>Pond G1: gabion</b>	Peak Elev=877.62' Storage=17 cf Inflow=4.61 cfs 1.479 af Outflow=4.60 cfs 1.479 af
<b>Pond G2: gabion</b>	Peak Elev=811.16' Storage=83 cf Inflow=9.03 cfs 1.962 af Outflow=9.06 cfs 1.962 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 43

**Link SP1: STUDY POINT #1**Inflow=10.12 cfs 1.382 af  
Primary=10.12 cfs 1.382 af**Link SP2: STUDY POINT #2**Inflow=6.69 cfs 2.251 af  
Primary=6.69 cfs 2.251 af**Link SP3: STUDY POINT #3**Inflow=10.26 cfs 2.196 af  
Primary=10.26 cfs 2.196 af**Link SP4: STUDY POINT #4**Inflow=1.76 cfs 0.128 af  
Primary=1.76 cfs 0.128 af**Link SP5: STUDY POINT #5**Inflow=0.39 cfs 0.028 af  
Primary=0.39 cfs 0.028 af**Total Runoff Area = 29.185 ac   Runoff Volume = 6.903 af   Average Runoff Depth = 2.84"**  
**67.26% Pervious = 19.630 ac   32.74% Impervious = 9.555 ac**

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 44

**Summary for Subcatchment P-1A: Subcat P-1A**

Runoff = 6.75 cfs @ 12.19 hrs, Volume= 0.615 af, Depth= 2.33"  
 Routed to Pond DW-10 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.059	98	Roofs, HSG B
0.085	98	Paved parking, HSG B
0.168	55	Woods, Good, HSG B
0.183	61	>75% Grass cover, Good, HSG B
1.273	74	>75% Grass cover, Good, HSG C
0.966	70	Woods, Good, HSG C
0.044	98	Paved parking, HSG C
0.390	98	Roofs, HSG C
3.168	75	Weighted Average
2.590		81.76% Pervious Area
0.578		18.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.8	55	0.1670	0.09		<b>Sheet Flow,</b> Woods: Dense underbrush n= 0.800 P2= 3.28"
1.1	105	0.0500	1.57		<b>Shallow Concentrated Flow,</b> Short Grass Pasture Kv= 7.0 fps
2.4	622	0.0280	4.24	4.11	<b>Trap/Vee/Rect Channel Flow,</b> Bot.W=1.00' D=0.25' Z= 3.0 & 20.0 ' Top.W=6.75' n= 0.016 Asphalt, rough
13.3	782	Total			

**Summary for Subcatchment P-1B: Subcat P-1B**

Runoff = 1.58 cfs @ 12.12 hrs, Volume= 0.123 af, Depth= 2.58"  
 Routed to Pond DS-1b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (sf)	CN	Description
4,342	98	Paved parking, HSG C
1,445	98	Paved parking, HSG B
3,282	61	>75% Grass cover, Good, HSG B
13,797	74	>75% Grass cover, Good, HSG C
2,004	70	Woods, Good, HSG C
24,871	78	Weighted Average
19,083		76.73% Pervious Area
5,787		23.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 45

**Summary for Subcatchment P-1C: Subcat P-1C**

Runoff = 0.90 cfs @ 12.09 hrs, Volume= 0.065 af, Depth= 2.33"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.002	98	Paved parking, HSG C
0.068	98	Paved parking, HSG B
0.111	61	>75% Grass cover, Good, HSG B
0.156	74	>75% Grass cover, Good, HSG C
0.337	75	Weighted Average
0.267		79.23% Pervious Area
0.070		20.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-1D: Subcat P-1D**

Runoff = 2.05 cfs @ 12.09 hrs, Volume= 0.149 af, Depth= 2.50"  
 Routed to Pond DS-1a : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (sf)	CN	Description
4,574	61	>75% Grass cover, Good, HSG B
2,625	98	Paved parking, HSG B
2,222	98	Roofs, HSG C
1,194	98	Paved parking, HSG C
20,546	74	>75% Grass cover, Good, HSG C
31,162	77	Weighted Average
25,121		80.61% Pervious Area
6,042		19.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-1E: Subcat P-1E**

Runoff = 1.40 cfs @ 12.09 hrs, Volume= 0.103 af, Depth= 3.23"  
 Routed to Pond dmh01 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.040	61	>75% Grass cover, Good, HSG B
0.037	98	Paved parking, HSG B
0.168	98	Paved parking, HSG C
0.138	74	>75% Grass cover, Good, HSG C
0.382	85	Weighted Average
0.178		46.51% Pervious Area
0.204		53.49% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 46

**Summary for Subcatchment P-1F: Subcat P-1F**

Runoff = 6.72 cfs @ 12.09 hrs, Volume= 0.499 af, Depth= 3.53"  
 Routed to Pond DW-1 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.741	74	>75% Grass cover, Good, HSG C
0.492	98	Roofs, HSG C
0.464	98	Paved parking, HSG C
1.697	88	Weighted Average
0.741		43.66% Pervious Area
0.956		56.34% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2A: Subcat P-2A**

Runoff = 4.73 cfs @ 12.09 hrs, Volume= 0.344 af, Depth= 2.33"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.180	98	Roofs, HSG C
0.428	70	Woods, Good, HSG C
1.165	74	>75% Grass cover, Good, HSG C
1.773	75	Weighted Average
1.593		89.86% Pervious Area
0.180		10.14% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2B: Subcat P-2B**

Runoff = 2.61 cfs @ 12.10 hrs, Volume= 0.193 af, Depth= 1.93"  
 Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.522	74	>75% Grass cover, Good, HSG C
0.365	70	Woods, Good, HSG C
0.314	65	Brush, Good, HSG C
1.201	70	Weighted Average
1.201		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 47

**Summary for Subcatchment P-2C: Subcat P-2C**

Runoff = 0.55 cfs @ 12.09 hrs, Volume= 0.041 af, Depth= 3.63"  
 Routed to Pond dmh33 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.085	98	Paved parking, HSG C
0.051	74	>75% Grass cover, Good, HSG C
0.137	89	Weighted Average
0.051		37.60% Pervious Area
0.085		62.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 Min

**Summary for Subcatchment P-2D: Subcat P-2D**

Runoff = 0.93 cfs @ 12.09 hrs, Volume= 0.068 af, Depth= 3.13"  
 Routed to Pond dmh31 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.106	98	Paved parking, HSG C
0.155	74	>75% Grass cover, Good, HSG C
0.260	84	Weighted Average
0.155		59.42% Pervious Area
0.106		40.58% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2E: Subcat P-2E**

Runoff = 9.10 cfs @ 12.09 hrs, Volume= 0.672 af, Depth= 3.43"  
 Routed to Pond DW-7 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
1.068	74	>75% Grass cover, Good, HSG C
0.691	98	Roofs, HSG C
0.595	98	Paved parking, HSG C
2.354	87	Weighted Average
1.068		45.38% Pervious Area
1.286		54.62% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2F: Subcat P-2F**

Runoff = 5.39 cfs @ 12.09 hrs, Volume= 0.394 af, Depth= 3.13"  
 Routed to Pond DW-5 : House Drywell

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 48

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.854	74	>75% Grass cover, Good, HSG C
0.370	98	Roofs, HSG C
0.284	98	Paved parking, HSG C
1.509	84	Weighted Average
0.854		56.63% Pervious Area
0.654		43.37% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-2G: Subcat P-2G

Runoff = 6.68 cfs @ 12.09 hrs, Volume= 0.496 af, Depth= 3.53"  
 Routed to Pond DW-9 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.736	74	>75% Grass cover, Good, HSG C
0.000	65	Brush, Good, HSG C
0.588	98	Roofs, HSG C
0.364	98	Paved parking, HSG C
1.688	88	Weighted Average
0.736		43.60% Pervious Area
0.952		56.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-2H: Subcat P-2H

Runoff = 2.62 cfs @ 12.09 hrs, Volume= 0.203 af, Depth= 4.05"  
 Routed to Pond DW-8 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.136	74	>75% Grass cover, Good, HSG C
0.160	98	Roofs, HSG C
0.304	98	Paved parking, HSG C
0.601	93	Weighted Average
0.136		22.65% Pervious Area
0.465		77.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-2I: Subcat P-2I

Runoff = 0.39 cfs @ 12.09 hrs, Volume= 0.028 af, Depth= 2.67"  
 Routed to Link SP2 : STUDY POINT #2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 49

Area (ac)	CN	Description
0.098	74	>75% Grass cover, Good, HSG C
0.029	98	Paved parking, HSG C
0.127	79	Weighted Average
0.098		77.34% Pervious Area
0.029		22.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, TR-55 Min</b>

**Summary for Subcatchment P-2J: Subcat P-2J**

Runoff = 1.71 cfs @ 12.09 hrs, Volume= 0.124 af, Depth= 2.41"  
 Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.016	70	Woods, Good, HSG C
0.048	98	Roofs, HSG C
0.556	74	>75% Grass cover, Good, HSG C
0.619	76	Weighted Average
0.571		92.27% Pervious Area
0.048		7.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

**Summary for Subcatchment P-3A: Subcat P-3A**

Runoff = 8.08 cfs @ 12.23 hrs, Volume= 0.806 af, Depth= 1.93"  
 Routed to Pond DB-1 : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
2.599	74	>75% Grass cover, Good, HSG C
0.847	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.023	70	Weighted Average
5.023		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
1.3	299	0.3000	3.83		<b>Shallow Concentrated Flow, D-E</b>
					Short Grass Pasture Kv= 7.0 fps
16.1	644	Total			

**Summary for Subcatchment P-3B: Subcat P-3B**

Runoff = 3.20 cfs @ 12.10 hrs, Volume= 0.234 af, Depth= 2.08"  
 Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 50

Area (ac)	CN	Description
0.000	98	Roofs, HSG C
0.172	65	Brush, Good, HSG C
0.274	70	Woods, Good, HSG C
0.905	74	>75% Grass cover, Good, HSG C
1.351	72	Weighted Average
1.351		99.99% Pervious Area
0.000		0.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry,</b>

**Summary for Subcatchment P-3C: Subcat P-3C**

Runoff = 1.64 cfs @ 12.09 hrs, Volume= 0.127 af, Depth= 4.05"  
 Routed to Pond DW-2 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.085	74	>75% Grass cover, Good, HSG C
0.051	98	Roofs, HSG C
0.239	98	Paved parking, HSG C
0.375	93	Weighted Average
0.085		22.77% Pervious Area
0.290		77.23% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

**Summary for Subcatchment P-3D: Subcat P-3D**

Runoff = 7.24 cfs @ 12.09 hrs, Volume= 0.559 af, Depth= 4.05"  
 Routed to Pond DW-3 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.361	74	>75% Grass cover, Good, HSG C
0.725	98	Roofs, HSG C
0.571	98	Paved parking, HSG C
1.657	93	Weighted Average
0.361		21.80% Pervious Area
1.295		78.20% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr-55 min</b>

**Summary for Subcatchment P-3E: Subcat P-3E**

Runoff = 5.98 cfs @ 12.09 hrs, Volume= 0.453 af, Depth= 3.84"  
 Routed to Pond DW-4 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 51

Area (ac)	CN	Description
0.414	74	>75% Grass cover, Good, HSG C
0.552	98	Roofs, HSG C
0.451	98	Paved parking, HSG C
1.417	91	Weighted Average
0.414		29.24% Pervious Area
1.003		70.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-3F: Subcat P-3F**

Runoff = 5.93 cfs @ 12.09 hrs, Volume= 0.449 af, Depth= 3.84"  
 Routed to Pond DW-6 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (ac)	CN	Description
0.388	74	>75% Grass cover, Good, HSG C
0.565	98	Roofs, HSG C
0.452	98	Paved parking, HSG C
1.406	91	Weighted Average
0.388		27.61% Pervious Area
1.018		72.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-4: Subcat P-4**

Runoff = 1.76 cfs @ 12.09 hrs, Volume= 0.128 af, Depth= 2.33"  
 Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

Area (sf)	CN	Description
56	61	>75% Grass cover, Good, HSG B
16,537	74	>75% Grass cover, Good, HSG C
9,257	70	Woods, Good, HSG C
2,814	98	Paved parking, HSG C
28,663	75	Weighted Average
25,849		90.18% Pervious Area
2,814		9.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-5: Subcat P-5**

Runoff = 0.39 cfs @ 12.10 hrs, Volume= 0.028 af, Depth= 2.16"  
 Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-year Rainfall=4.85"

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 52

Area (sf)	CN	Description
2,401	70	Woods, Good, HSG C
4,473	74	>75% Grass cover, Good, HSG C
6,874	73	Weighted Average
6,874		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					<b>Direct Entry, TR-55 Min.</b>
5.0	0	Total, Increased to minimum Tc = 6.0 min			

### Summary for Reach R-01: Routing to wetlands

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.


This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 1.351 ac, 0.01% Impervious, Inflow Depth = 2.08" for 10-year event  
 Inflow = 3.20 cfs @ 12.10 hrs, Volume= 0.234 af  
 Outflow = 1.25 cfs @ 12.38 hrs, Volume= 0.234 af, Atten= 61%, Lag= 17.0 min  
 Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 0.32 fps, Min. Travel Time= 37.0 min  
 Avg. Velocity = 0.12 fps, Avg. Travel Time= 97.3 min

Peak Storage= 2,782 cf @ 12.38 hrs  
 Average Depth at Peak Storage= 0.23' , Surface Width= 28.20'  
 Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush  
 Side Slope Z-value= 50.0 '/' Top Width= 105.00'  
 Length= 722.0' Slope= 0.1087 '/  
 Inlet Invert= 889.50', Outlet Invert= 811.00'

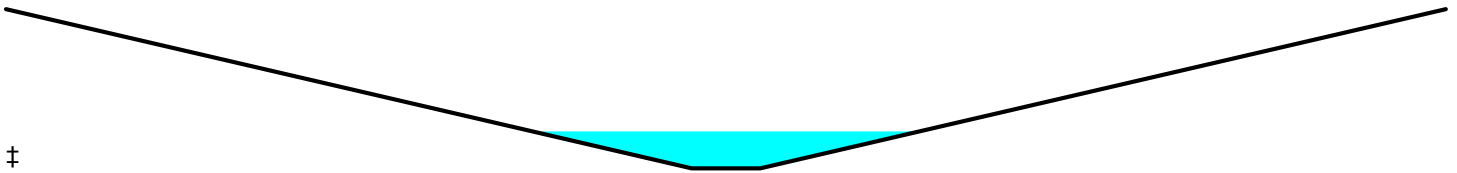

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth > 2.76" for 10-year event  
 Inflow = 6.70 cfs @ 12.16 hrs, Volume= 1.823 af  
 Outflow = 5.15 cfs @ 12.74 hrs, Volume= 1.822 af, Atten= 23%, Lag= 34.8 min  
 Routed to Pond 1P : depression

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 0.33 fps, Min. Travel Time= 26.5 min  
 Avg. Velocity = 0.14 fps, Avg. Travel Time= 62.4 min

Peak Storage= 8,184 cf @ 12.74 hrs  
 Average Depth at Peak Storage= 0.71' , Surface Width= 33.83'  
 Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 26.65 cfs

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.


HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 53

10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush  
 Side Slope Z-value= 30.0 3.5 '/' Top Width= 60.25'  
 Length= 525.0' Slope= 0.0223 '/'  
 Inlet Invert= 875.70', Outlet Invert= 864.00'

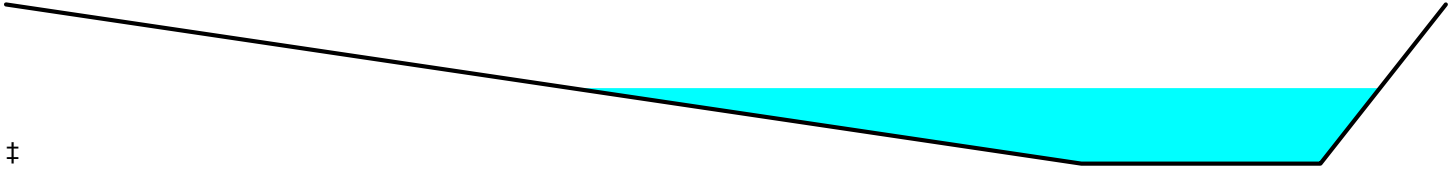**Summary for Pond 1P: depression**

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth > 2.76" for 10-year event  
 Inflow = 5.15 cfs @ 12.74 hrs, Volume= 1.822 af  
 Outflow = 5.15 cfs @ 12.74 hrs, Volume= 1.822 af, Atten= 0%, Lag= 0.4 min  
 Primary = 5.15 cfs @ 12.74 hrs, Volume= 1.822 af  
 Routed to Link SP2 : STUDY POINT #2  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 862.40' @ 12.74 hrs Surf.Area= 416 sf Storage= 149 cf  
 Flood Elev= 864.00' Surf.Area= 837 sf Storage= 1,133 cf

Plug-Flow detention time= 0.7 min calculated for 1.822 af (100% of inflow)  
 Center-of-Mass det. time= 0.6 min ( 949.5 - 948.9 )

Volume	Invert	Avail.Storage	Storage Description		
#1	862.00'	1,133 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
862.00	334	74.0	0	0	334
864.00	837	119.0	1,133	1,133	1,052

Device	Routing	Invert	Outlet Devices
#1	Primary	859.00'	<b>24.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.00' / 858.73' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	862.00'	<b>24.0" Horiz. beehive</b> C= 0.600 Limited to weir flow at low heads
#3	Secondary	863.30'	<b>10.0' long x 5.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

**Primary OutFlow** Max=5.15 cfs @ 12.74 hrs HW=862.40' TW=0.00' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 5.15 cfs of 23.42 cfs potential flow)

↑ **2=beehive** (Weir Controls 5.15 cfs @ 2.06 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=862.00' TW=0.00' (Dynamic Tailwater)

↑ **3=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

**Summary for Pond DB-1: detention**

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth = 2.41" for 10-year event  
 Inflow = 25.55 cfs @ 12.13 hrs, Volume= 1.981 af  
 Outflow = 9.03 cfs @ 12.52 hrs, Volume= 1.962 af, Atten= 65%, Lag= 23.6 min  
 Primary = 9.03 cfs @ 12.52 hrs, Volume= 1.962 af  
 Routed to Pond G2 : gabion  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Link SP3 : STUDY POINT #3

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 54

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 812.88' @ 12.52 hrs Surf.Area= 18,888 sf Storage= 32,293 cf  
 Flood Elev= 816.00' Surf.Area= 24,900 sf Storage= 100,504 cf

Plug-Flow detention time= 95.3 min calculated for 1.962 af (99% of inflow)  
 Center-of-Mass det. time= 89.6 min ( 909.4 - 819.8 )

Volume	Invert	Avail.Storage	Storage Description
#1	811.00'	100,504 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
811.00	15,556	576.0	0	0	15,556
812.00	17,303	594.0	16,422	16,422	17,331
813.00	19,115	613.0	18,201	34,623	19,253
814.00	20,984	632.0	20,042	54,665	21,236
815.00	22,910	651.0	21,940	76,605	23,279
816.00	24,900	670.0	23,898	100,504	25,383

Device	Routing	Invert	Outlet Devices
#1	Primary	811.00'	<b>18.0" Round Culvert</b> L= 32.0' Ke= 0.500 Inlet / Outlet Invert= 811.00' / 810.30' S= 0.0219 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf
#2	Device 1	811.00'	<b>8.0" Vert. (2) 8" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	811.90'	<b>12.0" Vert. (2) 12" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	813.20'	<b>24.0" x 24.0" Horiz. 24" Top of Structure</b> C= 0.600 Limited to weir flow at low heads
#5	Secondary	814.40'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.43 2.54 2.70 2.69 2.68 2.68 2.66 2.64 2.64 2.64 2.65 2.65 2.66 2.66 2.68 2.70 2.74

**Primary OutFlow** Max=9.03 cfs @ 12.52 hrs HW=812.88' TW=811.15' (Dynamic Tailwater)

1=Culvert (Inlet Controls 9.03 cfs @ 5.11 fps)  
 2=(2) 8" Orifice (2yr) (Passes < 4.17 cfs potential flow)  
 3=(2) 12" Orifice (10yr) (Passes < 5.25 cfs potential flow)  
 4=24" Top of Structure ( Controls 0.00 cfs)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=811.00' TW=0.00' (Dynamic Tailwater)

5=Broad-Crested Rectangular Weir( Controls 0.00 cfs)

**Summary for Pond dmh01: dmh**

Inflow Area = 0.382 ac, 53.49% Impervious, Inflow Depth = 3.23" for 10-year event  
 Inflow = 1.40 cfs @ 12.09 hrs, Volume= 0.103 af  
 Outflow = 1.40 cfs @ 12.09 hrs, Volume= 0.103 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.40 cfs @ 12.09 hrs, Volume= 0.103 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 850.61' @ 12.48 hrs  
 Flood Elev= 855.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	849.34'	<b>12.0" Round Culvert</b> L= 12.0' Ke= 0.500 Inlet / Outlet Invert= 849.34' / 849.22' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.37 cfs @ 12.09 hrs HW=850.05' TW=849.58' (Dynamic Tailwater)

1=Culvert (Barrel Controls 1.37 cfs @ 3.22 fps)



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 55

**Summary for Pond dmh05: dmh**

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 2.66" for 10-year event  
 Inflow = 6.41 cfs @ 12.11 hrs, Volume= 0.376 af  
 Outflow = 6.41 cfs @ 12.11 hrs, Volume= 0.376 af, Atten= 0%, Lag= 0.0 min  
 Primary = 6.41 cfs @ 12.11 hrs, Volume= 0.376 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 870.32' @ 12.11 hrs  
 Flood Elev= 883.10'

Device	Routing	Invert	Outlet Devices
#1	Primary	868.52'	<b>15.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 868.52' / 865.12' S= 0.0351 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=6.26 cfs @ 12.11 hrs HW=870.27' TW=849.75' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 6.26 cfs @ 5.10 fps)

**Summary for Pond dmh20: dmh**

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 2.85" for 10-year event  
 Inflow = 5.17 cfs @ 12.11 hrs, Volume= 0.359 af  
 Outflow = 5.17 cfs @ 12.11 hrs, Volume= 0.359 af, Atten= 0%, Lag= 0.0 min  
 Primary = 5.17 cfs @ 12.11 hrs, Volume= 0.359 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 904.13' @ 12.11 hrs  
 Flood Elev= 907.61'

Device	Routing	Invert	Outlet Devices
#1	Primary	902.74'	<b>15.0" Round Culvert</b> L= 205.0' Ke= 0.500 Inlet / Outlet Invert= 902.74' / 900.30' S= 0.0119 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=5.03 cfs @ 12.11 hrs HW=904.09' TW=901.38' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 5.03 cfs @ 4.10 fps)

**Summary for Pond dmh21: dmh**

Inflow Area = 3.863 ac, 50.23% Impervious, Inflow Depth = 2.77" for 10-year event  
 Inflow = 13.86 cfs @ 12.11 hrs, Volume= 0.891 af  
 Outflow = 13.86 cfs @ 12.11 hrs, Volume= 0.891 af, Atten= 0%, Lag= 0.0 min  
 Primary = 13.86 cfs @ 12.11 hrs, Volume= 0.891 af  
 Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 901.42' @ 12.13 hrs  
 Flood Elev= 905.24'

Device	Routing	Invert	Outlet Devices
#1	Primary	899.55'	<b>24.0" Round Culvert</b> L= 190.0' Ke= 0.500 Inlet / Outlet Invert= 899.55' / 897.65' S= 0.0100 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=12.80 cfs @ 12.11 hrs HW=901.38' TW=899.73' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 12.80 cfs @ 5.58 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 56

**Summary for Pond dmh23: dmh**

Inflow Area = 5.551 ac, 52.10% Impervious, Inflow Depth = 2.81" for 10-year event  
 Inflow = 20.24 cfs @ 12.11 hrs, Volume= 1.298 af  
 Outflow = 20.24 cfs @ 12.11 hrs, Volume= 1.298 af, Atten= 0%, Lag= 0.0 min  
 Primary = 20.24 cfs @ 12.11 hrs, Volume= 1.298 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 899.77' @ 12.11 hrs  
 Flood Elev= 910.71'

Device	Routing	Invert	Outlet Devices
#1	Primary	897.55'	<b>30.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 897.55' / 897.20' S= 0.0130 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=19.74 cfs @ 12.11 hrs HW=899.73' TW=895.65' (Dynamic Tailwater)  
**1=Culvert** (Barrel Controls 19.74 cfs @ 5.81 fps)

**Summary for Pond dmh25: dmh**

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 3.67" for 10-year event  
 Inflow = 2.52 cfs @ 12.11 hrs, Volume= 0.184 af  
 Outflow = 2.52 cfs @ 12.11 hrs, Volume= 0.184 af, Atten= 0%, Lag= 0.0 min  
 Primary = 2.52 cfs @ 12.11 hrs, Volume= 0.184 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 923.54' @ 12.11 hrs  
 Flood Elev= 930.54'

Device	Routing	Invert	Outlet Devices
#1	Primary	922.60'	<b>12.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 922.60' / 915.84' S= 0.0697 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=2.47 cfs @ 12.11 hrs HW=923.52' TW=895.62' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 2.47 cfs @ 3.26 fps)

**Summary for Pond dmh31: dmh**

Inflow Area = 0.260 ac, 40.58% Impervious, Inflow Depth = 3.13" for 10-year event  
 Inflow = 0.93 cfs @ 12.09 hrs, Volume= 0.068 af  
 Outflow = 0.93 cfs @ 12.09 hrs, Volume= 0.068 af, Atten= 0%, Lag= 0.0 min  
 Primary = 0.93 cfs @ 12.09 hrs, Volume= 0.068 af  
 Routed to Pond dmh33 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 876.26' @ 12.09 hrs  
 Flood Elev= 885.77'

Device	Routing	Invert	Outlet Devices
#1	Primary	875.76'	<b>12.0" Round Culvert</b> L= 96.0' Ke= 0.500 Inlet / Outlet Invert= 875.76' / 868.05' S= 0.0803 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.91 cfs @ 12.09 hrs HW=876.25' TW=860.31' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 0.91 cfs @ 2.38 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 57

**Summary for Pond dmh33: dmh**

Inflow Area = 0.397 ac, 48.09% Impervious, Inflow Depth = 3.30" for 10-year event  
 Inflow = 1.48 cfs @ 12.09 hrs, Volume= 0.109 af  
 Outflow = 1.48 cfs @ 12.09 hrs, Volume= 0.109 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.48 cfs @ 12.09 hrs, Volume= 0.109 af  
 Routed to Pond DS-2b : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 860.40' @ 12.50 hrs  
 Flood Elev= 864.98'

Device	Routing	Invert	Outlet Devices
#1	Primary	859.71'	<b>15.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.71' / 859.36' S= 0.0130 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=1.31 cfs @ 12.09 hrs HW=860.31' TW=859.90' (Dynamic Tailwater)  
 ↑**1=Culvert** (Outlet Controls 1.31 cfs @ 3.32 fps)

**Summary for Pond dmh50: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 2.48" for 10-year event  
 Inflow = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af  
 Outflow = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af, Atten= 0%, Lag= 0.0 min  
 Primary = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af  
 Routed to Pond dmh51 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 929.19' @ 12.11 hrs  
 Flood Elev= 933.94'

Device	Routing	Invert	Outlet Devices
#1	Primary	927.65'	<b>15.0" Round Culvert</b> L= 102.0' Ke= 0.500 Inlet / Outlet Invert= 927.65' / 919.50' S= 0.0799 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=5.52 cfs @ 12.11 hrs HW=929.15' TW=920.90' (Dynamic Tailwater)  
 ↑**1=Culvert** (Inlet Controls 5.52 cfs @ 4.50 fps)

**Summary for Pond dmh51: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 2.48" for 10-year event  
 Inflow = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af  
 Outflow = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af, Atten= 0%, Lag= 0.0 min  
 Primary = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af  
 Routed to Pond dmh52 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 920.94' @ 12.11 hrs  
 Flood Elev= 924.04'

Device	Routing	Invert	Outlet Devices
#1	Primary	919.40'	<b>15.0" Round Culvert</b> L= 127.0' Ke= 0.500 Inlet / Outlet Invert= 919.40' / 909.50' S= 0.0780 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=5.52 cfs @ 12.11 hrs HW=920.90' TW=894.02' (Dynamic Tailwater)  
 ↑**1=Culvert** (Inlet Controls 5.52 cfs @ 4.50 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 58

**Summary for Pond dmh52: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 2.48" for 10-year event  
 Inflow = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af  
 Outflow = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af, Atten= 0%, Lag= 0.0 min  
 Primary = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 894.06' @ 12.11 hrs  
 Flood Elev= 914.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.52'	<b>15.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 892.52' / 887.55' S= 0.0802 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=5.52 cfs @ 12.11 hrs HW=894.02' TW=888.39' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 5.52 cfs @ 4.50 fps)

**Summary for Pond dmh53: dmh**

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 3.07" for 10-year event  
 Inflow = 5.72 cfs @ 12.11 hrs, Volume= 0.362 af  
 Outflow = 5.72 cfs @ 12.11 hrs, Volume= 0.362 af, Atten= 0%, Lag= 0.0 min  
 Primary = 5.72 cfs @ 12.11 hrs, Volume= 0.362 af  
 Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 917.80' @ 12.11 hrs  
 Flood Elev= 921.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	916.46'	<b>18.0" Round Culvert</b> L= 31.0' Ke= 0.500 Inlet / Outlet Invert= 916.46' / 916.16' S= 0.0097 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=5.59 cfs @ 12.11 hrs HW=917.77' TW=906.99' (Dynamic Tailwater)  
**1=Culvert** (Barrel Controls 5.59 cfs @ 4.54 fps)

**Summary for Pond dmh55: dmh**

Inflow Area = 3.074 ac, 74.77% Impervious, Inflow Depth = 3.03" for 10-year event  
 Inflow = 12.63 cfs @ 12.11 hrs, Volume= 0.776 af  
 Outflow = 12.63 cfs @ 12.11 hrs, Volume= 0.776 af, Atten= 0%, Lag= 0.0 min  
 Primary = 12.63 cfs @ 12.11 hrs, Volume= 0.776 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 907.02' @ 12.11 hrs  
 Flood Elev= 911.86'

Device	Routing	Invert	Outlet Devices
#1	Primary	905.32'	<b>24.0" Round Culvert</b> L= 72.0' Ke= 0.500 Inlet / Outlet Invert= 905.32' / 903.80' S= 0.0211 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=12.36 cfs @ 12.11 hrs HW=906.99' TW=903.41' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 12.36 cfs @ 4.40 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 59

**Summary for Pond dmh56: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 3.08" for 10-year event  
 Inflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Outflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af, Atten= 0%, Lag= 0.0 min  
 Primary = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Routed to Pond dmh57 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 903.54' @ 12.14 hrs  
 Flood Elev= 908.47'

Device	Routing	Invert	Outlet Devices
#1	Primary	901.21'	<b>24.0" Round Culvert</b> L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 901.21' / 901.02' S= 0.0095 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=12.29 cfs @ 12.11 hrs HW=903.41' TW=902.75' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 12.29 cfs @ 3.91 fps)

**Summary for Pond dmh57: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 3.08" for 10-year event  
 Inflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Outflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af, Atten= 0%, Lag= 0.0 min  
 Primary = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Routed to Pond dmh58 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 902.79' @ 12.11 hrs  
 Flood Elev= 908.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	900.92'	<b>24.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 900.92' / 896.30' S= 0.0476 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=13.90 cfs @ 12.11 hrs HW=902.75' TW=897.77' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 13.90 cfs @ 4.61 fps)

**Summary for Pond dmh58: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 3.08" for 10-year event  
 Inflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Outflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af, Atten= 0%, Lag= 0.0 min  
 Primary = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Routed to Pond dmh59 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 897.79' @ 12.11 hrs  
 Flood Elev= 901.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	896.20'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 896.20' / 893.43' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=13.89 cfs @ 12.11 hrs HW=897.77' TW=894.99' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 13.89 cfs @ 4.27 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 60

**Summary for Pond dmh59: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 3.08" for 10-year event  
 Inflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Outflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af, Atten= 0%, Lag= 0.0 min  
 Primary = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Routed to Pond dmh60 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 895.02' @ 12.13 hrs  
 Flood Elev= 909.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	893.33'	<b>30.0" Round Culvert</b> L= 82.0' Ke= 0.500 Inlet / Outlet Invert= 893.33' / 892.50' S= 0.0101 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=13.11 cfs @ 12.11 hrs HW=894.99' TW=893.97' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 13.11 cfs @ 5.38 fps)

**Summary for Pond dmh60: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 3.08" for 10-year event  
 Inflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Outflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af, Atten= 0%, Lag= 0.0 min  
 Primary = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Routed to Pond dmh61 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 893.99' @ 12.11 hrs  
 Flood Elev= 901.96'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.40'	<b>30.0" Round Culvert</b> L= 258.0' Ke= 0.500 Inlet / Outlet Invert= 892.40' / 889.43' S= 0.0115 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=13.89 cfs @ 12.11 hrs HW=893.97' TW=890.90' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 13.89 cfs @ 4.27 fps)

**Summary for Pond dmh61: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 3.08" for 10-year event  
 Inflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Outflow = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af, Atten= 0%, Lag= 0.0 min  
 Primary = 14.21 cfs @ 12.11 hrs, Volume= 0.884 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 890.92' @ 12.11 hrs  
 Flood Elev= 898.16'

Device	Routing	Invert	Outlet Devices
#1	Primary	889.33'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 889.33' / 886.55' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=13.89 cfs @ 12.11 hrs HW=890.90' TW=888.39' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 13.89 cfs @ 4.27 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 61

**Summary for Pond dmh62: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 2.90" for 10-year event  
 Inflow = 19.85 cfs @ 12.11 hrs, Volume= 1.174 af  
 Outflow = 19.85 cfs @ 12.11 hrs, Volume= 1.174 af, Atten= 0%, Lag= 0.0 min  
 Primary = 19.85 cfs @ 12.11 hrs, Volume= 1.174 af  
 Routed to Pond dmh69 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 888.42' @ 12.11 hrs  
 Flood Elev= 902.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	886.45'	<b>30.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 886.45' / 884.91' S= 0.0248 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=19.41 cfs @ 12.11 hrs HW=888.39' TW=814.42' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 19.41 cfs @ 4.74 fps)

**Summary for Pond dmh69: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 2.90" for 10-year event  
 Inflow = 19.85 cfs @ 12.11 hrs, Volume= 1.174 af  
 Outflow = 19.85 cfs @ 12.11 hrs, Volume= 1.174 af, Atten= 0%, Lag= 0.0 min  
 Primary = 19.85 cfs @ 12.11 hrs, Volume= 1.174 af  
 Routed to Pond DB-1 : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 814.45' @ 12.11 hrs  
 Flood Elev= 818.02'

Device	Routing	Invert	Outlet Devices
#1	Primary	812.48'	<b>30.0" Round Culvert</b> L= 29.0' Ke= 0.500 Inlet / Outlet Invert= 812.48' / 811.50' S= 0.0338 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=19.41 cfs @ 12.11 hrs HW=814.42' TW=812.13' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 19.41 cfs @ 4.74 fps)

**Summary for Pond DS-1a: detention**

Inflow Area = 2.795 ac, 46.49% Impervious, Inflow Depth = 2.70" for 10-year event  
 Inflow = 9.82 cfs @ 12.11 hrs, Volume= 0.628 af  
 Outflow = 3.08 cfs @ 12.44 hrs, Volume= 0.628 af, Atten= 69%, Lag= 20.0 min  
 Primary = 3.08 cfs @ 12.44 hrs, Volume= 0.628 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 850.60' @ 12.44 hrs Surf.Area= 4,480 sf Storage= 10,411 cf  
 Flood Elev= 853.00' Surf.Area= 4,505 sf Storage= 19,995 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)  
 Center-of-Mass det. time= 102.0 min ( 913.4 - 811.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	848.00'	0 cf	<b>112.00'W x 40.00'L x 5.67'H Field A</b> 25,387 cf Overall - 25,387 cf Embedded = 0 cf
#2A	848.00'	19,995 cf	<b>retain_it retain_it 5.0' x 70</b> Inside #1 Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 14 Rows adjusted for 394.8 cf perimeter wall
#3	853.00'	56 cf	<b>4.00'D x 4.45'H CB-9</b>
#4	853.00'	38 cf	<b>4.00'D x 3.00'H CB-8</b>
		20,088 cf	Total Available Storage

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 62

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	847.90'	<b>15.0" Round Culvert</b> L= 129.0' Ke= 0.500 Inlet / Outlet Invert= 847.90' / 846.36' S= 0.0119 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	847.90'	<b>3.0" Vert. 3" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	849.50'	<b>7.0" Vert. 7" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	851.30'	<b>6.0" Vert. 6" Orifice (25yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	851.90'	<b>8.0" Vert. 8" Orifice (50yr) X 3.00</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	852.80'	<b>4.0' long Overflow Weir</b> 2 End Contraction(s) 4.0' Crest Height

**Primary OutFlow** Max=3.07 cfs @ 12.44 hrs HW=850.60' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 3.07 cfs of 8.02 cfs potential flow)
- 2=3" Orifice (2yr) (Orifice Controls 0.76 cfs @ 7.73 fps)
- 3=7" Orifice (10yr) (Orifice Controls 2.32 cfs @ 4.33 fps)
- 4=6" Orifice (25yr) ( Controls 0.00 cfs)
- 5=8" Orifice (50yr) ( Controls 0.00 cfs)
- 6=Overflow Weir ( Controls 0.00 cfs)

**Summary for Pond DS-1b: detention**

Inflow Area = 0.571 ac, 23.27% Impervious, Inflow Depth = 2.58" for 10-year event  
 Inflow = 1.58 cfs @ 12.12 hrs, Volume= 0.123 af  
 Outflow = 0.45 cfs @ 12.52 hrs, Volume= 0.123 af, Atten= 72%, Lag= 24.0 min  
 Primary = 0.45 cfs @ 12.52 hrs, Volume= 0.123 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 860.49' @ 12.52 hrs Surf.Area= 1,536 sf Storage= 1,725 cf  
 Flood Elev= 862.70' Surf.Area= 1,536 sf Storage= 4,684 cf

Plug-Flow detention time= 60.3 min calculated for 0.122 af (100% of inflow)  
 Center-of-Mass det. time= 59.3 min ( 889.9 - 830.5 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.20'	0 cf	<b>64.00'W x 24.00'L x 4.17'H Field A</b> 6,400 cf Overall - 6,400 cf Embedded = 0 cf x 40.0% Voids
#2A	859.20'	4,684 cf	<b>retain_it retain_it 3.5' x 24</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 8 Rows adjusted for 135.1 cf perimeter wall
		4,684 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	859.20'	<b>12.0" Round Culvert</b> L= 100.0' Ke= 0.500 Inlet / Outlet Invert= 859.20' / 858.10' S= 0.0110 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>4.0" Vert. 4" Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>12.0" Vert. Overflow</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.44 cfs @ 12.52 hrs HW=860.49' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 0.44 cfs of 3.36 cfs potential flow)
- 2=4" Orifice (Orifice Controls 0.44 cfs @ 5.10 fps)
- 3=Overflow ( Controls 0.00 cfs)

**Summary for Pond DS-2a: detention**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth = 2.89" for 10-year event  
 Inflow = 22.76 cfs @ 12.11 hrs, Volume= 1.482 af  
 Outflow = 4.61 cfs @ 12.56 hrs, Volume= 1.479 af, Atten= 80%, Lag= 26.7 min  
 Primary = 4.61 cfs @ 12.56 hrs, Volume= 1.479 af  
 Routed to Pond G1 : gabion



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 63

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 898.06' @ 12.56 hrs Surf.Area= 4,704 sf Storage= 29,193 cf  
 Flood Elev= 902.66' Storage= 48,125 cf

Plug-Flow detention time= 124.9 min calculated for 1.479 af (100% of inflow)  
 Center-of-Mass det. time= 123.9 min ( 932.0 - 808.1 )

Volume	Invert	Avail.Storage	Storage Description
#1	892.00'	24,073 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 7 Rows adjusted for 394.8 cf perimeter wall
#2	897.00'	24,052 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 6 Rows adjusted for 415.6 cf perimeter wall
		48,125 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	892.00'	<b>24.0" Round Culvert</b> L= 46.0' Ke= 0.500 Inlet / Outlet Invert= 892.00' / 890.52' S= 0.0322 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	892.00'	<b>4.0" Vert. Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	895.40'	<b>8.0" Vert. Orifice (10yr)</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	898.20'	<b>8.0" Vert. Orifice (25yr)</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	899.90'	<b>4.0" Vert. Orifice (50yr)</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	902.00'	<b>4.0' long Sharp-Crested Weir Overflow (100yr)</b> 2 End Contraction(s)

**Primary OutFlow** Max=4.61 cfs @ 12.56 hrs HW=898.06' TW=877.62' (Dynamic Tailwater)

- 1=Culvert (Passes 4.61 cfs of 34.03 cfs potential flow)
- 2=Orifice (2yr) (Orifice Controls 2.04 cfs @ 11.69 fps)
- 3=Orifice (10yr) (Orifice Controls 2.56 cfs @ 7.35 fps)
- 4=Orifice (25yr) ( Controls 0.00 cfs)
- 5=Orifice (50yr) ( Controls 0.00 cfs)
- 6=Sharp-Crested Weir Overflow (100yr)( Controls 0.00 cfs)

**Summary for Pond DS-2b: detention**

Inflow Area = 2.217 ac, 10.77% Impervious, Inflow Depth = 2.31" for 10-year event  
 Inflow = 5.80 cfs @ 12.09 hrs, Volume= 0.426 af  
 Outflow = 1.55 cfs @ 12.49 hrs, Volume= 0.401 af, Atten= 73%, Lag= 23.6 min  
 Primary = 1.55 cfs @ 12.49 hrs, Volume= 0.401 af  
 Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 860.39' @ 12.49 hrs Surf.Area= 5,632 sf Storage= 6,906 cf  
 Flood Elev= 862.70' Surf.Area= 5,645 sf Storage= 17,438 cf

Plug-Flow detention time= 119.3 min calculated for 0.400 af (94% of inflow)  
 Center-of-Mass det. time= 88.2 min ( 921.8 - 833.6 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.00'	0 cf	<b>88.00"W x 64.00'L x 4.17'H Field A</b> 23,467 cf Overall - 23,467 cf Embedded = 0 cf x 40.0% Voids
#2A	859.00'	17,435 cf	<b>retain_it retain_it 3.5' x 88</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 11 Rows adjusted for 233.3 cf perimeter wall
#3	862.50'	9 cf	<b>4.00'D x 0.70'H Vertical Cone/Cylinder</b>
		17,444 cf	Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 64

Device	Routing	Invert	Outlet Devices
#1	Primary	858.90'	<b>12.0" Round Culvert</b> L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 858.90' / 858.44' S= 0.0153 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>8.0" Vert. Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>4.0' long Sharp-Crested Rectangular Weir</b> 2 End Contraction(s) 0.5' Crest Height
#4	Device 1	863.20'	<b>24.0" x 24.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=1.55 cfs @ 12.49 hrs HW=860.39' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 1.55 cfs of 3.75 cfs potential flow)  
 2=Orifice (Orifice Controls 1.55 cfs @ 4.44 fps)  
 3=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)  
 4=Orifice/Grate (Controls 0.00 cfs)

**Summary for Pond DW-1: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 3.53" for 10-year event  
 Inflow = 6.72 cfs @ 12.09 hrs, Volume= 0.499 af  
 Outflow = 6.46 cfs @ 12.11 hrs, Volume= 0.472 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 11.60 hrs, Volume= 0.096 af  
 Primary = 6.41 cfs @ 12.11 hrs, Volume= 0.376 af  
 Routed to Pond dmh05 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 11.60 hrs Surf.Area= 0.031 ac Storage= 0.063 af

Plug-Flow detention time= 129.5 min calculated for 0.471 af (95% of inflow)  
 Center-of-Mass det. time= 101.0 min ( 900.0 - 799.0 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 14.00 = 0.063 af Total Available Storage			

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 11.60 hrs HW=3.50' (Free Discharge)

- 1=Exfiltration (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=870.27' (Dynamic Tailwater)

- 2=Culvert (Controls 0.00 cfs)

**Summary for Pond DW-10: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 65

Inflow Area = 3.168 ac, 18.24% Impervious, Inflow Depth = 2.33" for 10-year event  
 Inflow = 6.75 cfs @ 12.19 hrs, Volume= 0.615 af  
 Outflow = 6.65 cfs @ 12.22 hrs, Volume= 0.604 af, Atten= 1%, Lag= 1.5 min  
 Discarded = 0.02 cfs @ 11.50 hrs, Volume= 0.038 af  
 Primary = 0.19 cfs @ 11.50 hrs, Volume= 0.168 af  
 Routed to Link SP1 : STUDY POINT #1  
 Secondary = 6.45 cfs @ 12.22 hrs, Volume= 0.397 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Primary area = Inflow area x 0.142

Peak Elev= 3.50' @ 11.50 hrs Surf.Area= 0.013 ac Storage= 0.027 af

Plug-Flow detention time= 43.5 min calculated for 0.603 af (98% of inflow)

Center-of-Mass det. time= 34.2 min ( 877.3 - 843.1 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 6.00 = 0.027 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Secondary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	3.00'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 3.00' / 3.00' S= 0.0000 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.02 cfs @ 11.50 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.02 cfs)**Primary OutFlow** Max=0.19 cfs @ 11.50 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)↑**2=Culvert** (Barrel Controls 0.19 cfs @ 2.14 fps)**Secondary OutFlow** Max=0.00 cfs @ 12.22 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)**Summary for Pond DW-2: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.375 ac, 77.23% Impervious, Inflow Depth = 4.05" for 10-year event  
 Inflow = 1.64 cfs @ 12.09 hrs, Volume= 0.127 af  
 Outflow = 1.58 cfs @ 12.11 hrs, Volume= 0.123 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 9.90 hrs, Volume= 0.015 af  
 Primary = 1.57 cfs @ 12.11 hrs, Volume= 0.108 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 9.90 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 81.4 min calculated for 0.123 af (97% of inflow)

Center-of-Mass det. time= 64.3 min ( 843.5 - 779.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 66

0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 9.90 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=903.41' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-3: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.657 ac, 78.20% Impervious, Inflow Depth = 4.05" for 10-year event  
Inflow = 7.24 cfs @ 12.09 hrs, Volume= 0.559 af  
Outflow = 6.97 cfs @ 12.11 hrs, Volume= 0.529 af, Atten= 4%, Lag= 1.4 min  
Discarded = 0.05 cfs @ 11.20 hrs, Volume= 0.115 af  
Primary = 6.92 cfs @ 12.11 hrs, Volume= 0.413 af  
Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 11.20 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 137.6 min calculated for 0.528 af (94% of inflow)

Center-of-Mass det. time= 108.2 min ( 887.4 - 779.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 11.20 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=906.99' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-4: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 67

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 3.84" for 10-year event  
 Inflow = 5.98 cfs @ 12.09 hrs, Volume= 0.453 af  
 Outflow = 5.75 cfs @ 12.11 hrs, Volume= 0.434 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.03 cfs @ 10.90 hrs, Volume= 0.072 af  
 Primary = 5.72 cfs @ 12.11 hrs, Volume= 0.362 af  
 Routed to Pond dmh53 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 10.90 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 108.2 min calculated for 0.434 af (96% of inflow)  
 Center-of-Mass det. time= 83.9 min ( 871.7 - 787.8 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 10.00 = 0.045 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 10.90 hrs HW=3.50' (Free Discharge)  
 ↑ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=917.77' (Dynamic Tailwater)  
 ↑ **2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-5: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.  
 Storage multiplier added to account for number of dwelling units with subcatchment.  
 Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 3.13" for 10-year event  
 Inflow = 5.39 cfs @ 12.09 hrs, Volume= 0.394 af  
 Outflow = 5.18 cfs @ 12.11 hrs, Volume= 0.386 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 10.55 hrs, Volume= 0.028 af  
 Primary = 5.17 cfs @ 12.11 hrs, Volume= 0.359 af  
 Routed to Pond dmh20 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 10.55 hrs Surf.Area= 0.009 ac Storage= 0.018 af

Plug-Flow detention time= 49.4 min calculated for 0.386 af (98% of inflow)  
 Center-of-Mass det. time= 38.7 min ( 850.4 - 811.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 4.00 = 0.018 af Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 68

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 10.55 hrs HW=3.50' (Free Discharge)

↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=904.09' (Dynamic Tailwater)

↑ **2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-6: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 3.84" for 10-year event  
 Inflow = 5.93 cfs @ 12.09 hrs, Volume= 0.449 af  
 Outflow = 5.70 cfs @ 12.11 hrs, Volume= 0.415 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.06 cfs @ 11.80 hrs, Volume= 0.125 af  
 Primary = 5.64 cfs @ 12.11 hrs, Volume= 0.291 af  
 Routed to Pond dmh50 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 11.80 hrs Surf.Area= 0.040 ac Storage= 0.081 af

Plug-Flow detention time= 183.5 min calculated for 0.415 af (92% of inflow)

Center-of-Mass det. time= 143.8 min ( 931.7 - 787.8 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 18.00 = 0.081 af			Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.06 cfs @ 11.80 hrs HW=3.50' (Free Discharge)

↑ **1=Exfiltration** (Exfiltration Controls 0.06 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=929.15' (Dynamic Tailwater)

↑ **2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-7: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 69

Inflow Area = 2.354 ac, 54.62% Impervious, Inflow Depth = 3.43" for 10-year event  
 Inflow = 9.10 cfs @ 12.09 hrs, Volume= 0.672 af  
 Outflow = 8.74 cfs @ 12.11 hrs, Volume= 0.642 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 11.45 hrs, Volume= 0.110 af  
 Primary = 8.69 cfs @ 12.11 hrs, Volume= 0.532 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 11.45 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 111.8 min calculated for 0.642 af (95% of inflow)  
 Center-of-Mass det. time= 86.1 min ( 888.5 - 802.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 11.45 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.05 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=901.38' (Dynamic Tailwater)↑**2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-8: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 4.05" for 10-year event  
 Inflow = 2.62 cfs @ 12.09 hrs, Volume= 0.203 af  
 Outflow = 2.53 cfs @ 12.11 hrs, Volume= 0.199 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 8.95 hrs, Volume= 0.015 af  
 Primary = 2.52 cfs @ 12.11 hrs, Volume= 0.184 af  
 Routed to Pond dmh25 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 8.95 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 53.5 min calculated for 0.199 af (98% of inflow)  
 Center-of-Mass det. time= 42.7 min ( 821.9 - 779.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 70

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 8.95 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.01 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=923.52' (Dynamic Tailwater)↑**2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-9: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.688 ac, 56.40% Impervious, Inflow Depth = 3.53" for 10-year event  
 Inflow = 6.68 cfs @ 12.09 hrs, Volume= 0.496 af  
 Outflow = 6.42 cfs @ 12.11 hrs, Volume= 0.477 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.03 cfs @ 11.10 hrs, Volume= 0.070 af  
 Primary = 6.39 cfs @ 12.11 hrs, Volume= 0.407 af  
 Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 11.10 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 95.9 min calculated for 0.476 af (96% of inflow)

Center-of-Mass det. time= 74.8 min ( 873.8 - 799.0 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 10.00 = 0.045 af			Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 11.10 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.03 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=899.73' (Dynamic Tailwater)↑**2=Culvert** ( Controls 0.00 cfs)**Summary for Pond G1: gabion**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth > 2.89" for 10-year event  
 Inflow = 4.61 cfs @ 12.56 hrs, Volume= 1.479 af  
 Outflow = 4.60 cfs @ 12.57 hrs, Volume= 1.479 af, Atten= 0%, Lag= 0.6 min  
 Primary = 4.60 cfs @ 12.57 hrs, Volume= 1.479 af  
 Routed to Reach R-02 : Routing through wetland/swale

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs



**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 71

Peak Elev= 877.62' @ 12.57 hrs Surf.Area= 206 sf Storage= 17 cf  
 Flood Elev= 880.00' Surf.Area= 2 sf Storage= 444 cf

Plug-Flow detention time= 0.0 min calculated for 1.477 af (100% of inflow)  
 Center-of-Mass det. time= 0.0 min ( 932.1 - 932.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	877.50'	442 cf	<b>18.0" Round Pipe Storage</b> L= 250.0'
#2	879.00'	2 cf	<b>1.50'D x 1.00'H Vertical Cone/Cylinder</b>
		444 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	877.50'	<b>2.0" Horiz. invert orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	878.25'	<b>2.0" Vert. spring line orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	880.00'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=4.60 cfs @ 12.57 hrs HW=877.62' TW=876.41' (Dynamic Tailwater)

1=invert orifices (Orifice Controls 4.60 cfs @ 1.69 fps)

2=spring line orifices ( Controls 0.00 cfs)

3=overflow grates ( Controls 0.00 cfs)

**Summary for Pond G2: gabion**

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth > 2.38" for 10-year event  
 Inflow = 9.03 cfs @ 12.52 hrs, Volume= 1.962 af  
 Outflow = 9.06 cfs @ 12.51 hrs, Volume= 1.962 af, Atten= 0%, Lag= 0.0 min  
 Primary = 9.06 cfs @ 12.51 hrs, Volume= 1.962 af  
 Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 811.16' @ 12.51 hrs Surf.Area= 119 sf Storage= 83 cf  
 Flood Elev= 811.80' Storage= 141 cf

Plug-Flow detention time= 0.1 min calculated for 1.959 af (100% of inflow)  
 Center-of-Mass det. time= 0.1 min ( 909.5 - 909.4 )

Volume	Invert	Avail.Storage	Storage Description
#1	810.30'	141 cf	<b>18.0" Round Pipe Storage</b> L= 80.0'

Device	Routing	Invert	Outlet Devices
#1	Primary	810.30'	<b>2.0" Horiz. invert orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	811.05'	<b>2.0" Vert. spring line orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	811.80'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=9.04 cfs @ 12.51 hrs HW=811.15' TW=0.00' (Dynamic Tailwater)

1=invert orifices (Orifice Controls 7.77 cfs @ 4.45 fps)

2=spring line orifices (Orifice Controls 1.27 cfs @ 1.10 fps)

3=overflow grates ( Controls 0.00 cfs)

**Summary for Link SP1: STUDY POINT #1**

Inflow Area = 6.871 ac, 30.28% Impervious, Inflow Depth = 2.41" for 10-year event  
 Inflow = 10.12 cfs @ 12.23 hrs, Volume= 1.382 af  
 Primary = 10.12 cfs @ 12.23 hrs, Volume= 1.382 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP2: STUDY POINT #2**

Inflow Area = 10.269 ac, 37.04% Impervious, Inflow Depth > 2.63" for 10-year event  
 Inflow = 6.69 cfs @ 12.66 hrs, Volume= 2.251 af  
 Primary = 6.69 cfs @ 12.66 hrs, Volume= 2.251 af, Atten= 0%, Lag= 0.0 min

## 2889-01 - Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-year Rainfall=4.85"

Printed 12/14/2021

Page 72

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP3: STUDY POINT #3

Inflow Area = 11.229 ac, 32.11% Impervious, Inflow Depth > 2.35" for 10-year event  
Inflow = 10.26 cfs @ 12.50 hrs, Volume= 2.196 af  
Primary = 10.26 cfs @ 12.50 hrs, Volume= 2.196 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP4: STUDY POINT #4

Inflow Area = 0.658 ac, 9.82% Impervious, Inflow Depth = 2.33" for 10-year event  
Inflow = 1.76 cfs @ 12.09 hrs, Volume= 0.128 af  
Primary = 1.76 cfs @ 12.09 hrs, Volume= 0.128 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP5: STUDY POINT #5

Inflow Area = 0.158 ac, 0.00% Impervious, Inflow Depth = 2.16" for 10-year event  
Inflow = 0.39 cfs @ 12.10 hrs, Volume= 0.028 af  
Primary = 0.39 cfs @ 12.10 hrs, Volume= 0.028 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 73

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points  
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
 Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>SubcatchmentP-1A: Subcat P-1A</b>	Runoff Area=3.168 ac 18.24% Impervious Runoff Depth=3.38" Flow Length=782' Tc=13.3 min CN=75 Runoff=9.86 cfs 0.894 af
<b>SubcatchmentP-1B: Subcat P-1B</b>	Runoff Area=24,871 sf 23.27% Impervious Runoff Depth=3.69" Flow Length=315' Tc=8.2 min CN=78 Runoff=2.25 cfs 0.175 af
<b>SubcatchmentP-1C: Subcat P-1C</b>	Runoff Area=0.337 ac 20.77% Impervious Runoff Depth=3.38" Tc=6.0 min CN=75 Runoff=1.31 cfs 0.095 af
<b>SubcatchmentP-1D: Subcat P-1D</b>	Runoff Area=31,162 sf 19.39% Impervious Runoff Depth=3.58" Tc=6.0 min CN=77 Runoff=2.94 cfs 0.214 af
<b>SubcatchmentP-1E: Subcat P-1E</b>	Runoff Area=0.382 ac 53.49% Impervious Runoff Depth=4.42" Tc=6.0 min CN=85 Runoff=1.90 cfs 0.141 af
<b>SubcatchmentP-1F: Subcat P-1F</b>	Runoff Area=1.697 ac 56.34% Impervious Runoff Depth=4.74" Tc=6.0 min CN=88 Runoff=8.90 cfs 0.671 af
<b>SubcatchmentP-2A: Subcat P-2A</b>	Runoff Area=1.773 ac 10.14% Impervious Runoff Depth=3.38" Tc=6.0 min CN=75 Runoff=6.90 cfs 0.500 af
<b>SubcatchmentP-2B: Subcat P-2B</b>	Runoff Area=1.201 ac 0.00% Impervious Runoff Depth=2.90" Tc=6.0 min CN=70 Runoff=3.99 cfs 0.290 af
<b>SubcatchmentP-2C: Subcat P-2C</b>	Runoff Area=0.137 ac 62.40% Impervious Runoff Depth=4.85" Tc=6.0 min CN=89 Runoff=0.73 cfs 0.055 af
<b>SubcatchmentP-2D: Subcat P-2D</b>	Runoff Area=0.260 ac 40.58% Impervious Runoff Depth=4.31" Tc=6.0 min CN=84 Runoff=1.27 cfs 0.093 af
<b>SubcatchmentP-2E: Subcat P-2E</b>	Runoff Area=2.354 ac 54.62% Impervious Runoff Depth=4.63" Tc=6.0 min CN=87 Runoff=12.13 cfs 0.909 af
<b>SubcatchmentP-2F: Subcat P-2F</b>	Runoff Area=1.509 ac 43.37% Impervious Runoff Depth=4.31" Tc=6.0 min CN=84 Runoff=7.34 cfs 0.542 af
<b>SubcatchmentP-2G: Subcat P-2G</b>	Runoff Area=1.688 ac 56.40% Impervious Runoff Depth=4.74" Tc=6.0 min CN=88 Runoff=8.85 cfs 0.667 af
<b>SubcatchmentP-2H: Subcat P-2H</b>	Runoff Area=0.601 ac 77.35% Impervious Runoff Depth=5.30" Tc=6.0 min CN=93 Runoff=3.38 cfs 0.265 af
<b>SubcatchmentP-2I: Subcat P-2I</b>	Runoff Area=0.127 ac 22.66% Impervious Runoff Depth=3.79" Tc=6.0 min CN=79 Runoff=0.55 cfs 0.040 af
<b>SubcatchmentP-2J: Subcat P-2J</b>	Runoff Area=0.619 ac 7.73% Impervious Runoff Depth=3.48" Tc=6.0 min CN=76 Runoff=2.48 cfs 0.180 af
<b>SubcatchmentP-3A: Subcat P-3A</b>	Runoff Area=5.023 ac 0.00% Impervious Runoff Depth=2.90" Flow Length=644' Tc=16.1 min CN=70 Runoff=12.39 cfs 1.214 af
<b>SubcatchmentP-3B: Subcat P-3B</b>	Runoff Area=1.351 ac 0.01% Impervious Runoff Depth=3.09" Tc=6.0 min CN=72 Runoff=4.80 cfs 0.348 af
<b>SubcatchmentP-3C: Subcat P-3C</b>	Runoff Area=0.375 ac 77.23% Impervious Runoff Depth=5.30" Tc=6.0 min CN=93 Runoff=2.11 cfs 0.166 af
<b>SubcatchmentP-3D: Subcat P-3D</b>	Runoff Area=1.657 ac 78.20% Impervious Runoff Depth=5.30" Tc=6.0 min CN=93 Runoff=9.33 cfs 0.732 af
<b>SubcatchmentP-3E: Subcat P-3E</b>	Runoff Area=1.417 ac 70.76% Impervious Runoff Depth=5.07" Tc=6.0 min CN=91 Runoff=7.78 cfs 0.599 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 74

**Subcatchment P-3F: Subcat P-3F**Runoff Area=1.406 ac 72.39% Impervious Runoff Depth=5.07"  
Tc=6.0 min CN=91 Runoff=7.72 cfs 0.594 af**Subcatchment P-4: Subcat P-4**Runoff Area=28,663 sf 9.82% Impervious Runoff Depth=3.38"  
Tc=6.0 min CN=75 Runoff=2.56 cfs 0.186 af**Subcatchment P-5: Subcat P-5**Runoff Area=6,874 sf 0.00% Impervious Runoff Depth=3.19"  
Tc=6.0 min CN=73 Runoff=0.58 cfs 0.042 af**Reach R-01: Routing to wetlands**Avg. Flow Depth=0.29' Max Vel=0.37 fps Inflow=4.80 cfs 0.348 af  
n=0.400 L=722.0' S=0.1087 '/ Capacity=43.77 cfs Outflow=2.03 cfs 0.348 af**Reach R-02: Routing through wetland/swale**Avg. Flow Depth=0.91' Max Vel=0.38 fps Inflow=10.83 cfs 2.589 af  
n=0.400 L=525.0' S=0.0223 '/ Capacity=26.65 cfs Outflow=8.76 cfs 2.587 af**Pond 1P: depression**Peak Elev=862.57' Storage=222 cf Inflow=8.76 cfs 2.587 af  
Primary=8.76 cfs 2.587 af Secondary=0.00 cfs 0.000 af Outflow=8.76 cfs 2.587 af**Pond DB-1: detention**Peak Elev=813.62' Storage=46,804 cf Inflow=34.91 cfs 2.881 af  
Primary=11.63 cfs 2.861 af Secondary=0.00 cfs 0.000 af Outflow=11.63 cfs 2.861 af**Pond dmh01: dmh**Peak Elev=851.60' Inflow=1.90 cfs 0.141 af  
12.0" Round Culvert n=0.013 L=12.0' S=0.0100 '/ Outflow=1.90 cfs 0.141 af**Pond dmh05: dmh**Peak Elev=871.22' Inflow=8.51 cfs 0.544 af  
15.0" Round Culvert n=0.013 L=97.0' S=0.0351 '/ Outflow=8.51 cfs 0.544 af**Pond dmh20: dmh**Peak Elev=904.89' Inflow=7.04 cfs 0.505 af  
15.0" Round Culvert n=0.013 L=205.0' S=0.0119 '/ Outflow=7.04 cfs 0.505 af**Pond dmh21: dmh**Peak Elev=902.10' Inflow=18.65 cfs 1.270 af  
24.0" Round Culvert n=0.013 L=190.0' S=0.0100 '/ Outflow=18.65 cfs 1.270 af**Pond dmh23: dmh**Peak Elev=900.29' Inflow=27.13 cfs 1.845 af  
30.0" Round Culvert n=0.013 L=27.0' S=0.0130 '/ Outflow=27.13 cfs 1.845 af**Pond dmh25: dmh**Peak Elev=923.84' Inflow=3.25 cfs 0.246 af  
12.0" Round Culvert n=0.013 L=97.0' S=0.0697 '/ Outflow=3.25 cfs 0.246 af**Pond dmh31: dmh**Peak Elev=876.35' Inflow=1.27 cfs 0.093 af  
12.0" Round Culvert n=0.013 L=96.0' S=0.0803 '/ Outflow=1.27 cfs 0.093 af**Pond dmh33: dmh**Peak Elev=861.06' Inflow=1.99 cfs 0.149 af  
15.0" Round Culvert n=0.013 L=27.0' S=0.0130 '/ Outflow=1.99 cfs 0.149 af**Pond dmh50: dmh**Peak Elev=929.83' Inflow=7.37 cfs 0.431 af  
15.0" Round Culvert n=0.013 L=102.0' S=0.0799 '/ Outflow=7.37 cfs 0.431 af**Pond dmh51: dmh**Peak Elev=921.58' Inflow=7.37 cfs 0.431 af  
15.0" Round Culvert n=0.013 L=127.0' S=0.0780 '/ Outflow=7.37 cfs 0.431 af**Pond dmh52: dmh**Peak Elev=894.70' Inflow=7.37 cfs 0.431 af  
15.0" Round Culvert n=0.013 L=62.0' S=0.0802 '/ Outflow=7.37 cfs 0.431 af**Pond dmh53: dmh**Peak Elev=918.08' Inflow=7.46 cfs 0.506 af  
18.0" Round Culvert n=0.013 L=31.0' S=0.0097 '/ Outflow=7.46 cfs 0.506 af**Pond dmh55: dmh**Peak Elev=907.49' Inflow=16.38 cfs 1.088 af  
24.0" Round Culvert n=0.013 L=72.0' S=0.0211 '/ Outflow=16.38 cfs 1.088 af**Pond dmh56: dmh**Peak Elev=904.67' Inflow=18.41 cfs 1.235 af  
24.0" Round Culvert n=0.013 L=20.0' S=0.0095 '/ Outflow=18.41 cfs 1.235 af**Pond dmh57: dmh**Peak Elev=903.40' Inflow=18.41 cfs 1.235 af  
24.0" Round Culvert n=0.013 L=97.0' S=0.0476 '/ Outflow=18.41 cfs 1.235 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 75

<b>Pond dmh58: dmh</b>	Peak Elev=898.08' Inflow=18.41 cfs 1.235 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=18.41 cfs 1.235 af
<b>Pond dmh59: dmh</b>	Peak Elev=895.34' Inflow=18.41 cfs 1.235 af 30.0" Round Culvert n=0.013 L=82.0' S=0.0101 '/' Outflow=18.41 cfs 1.235 af
<b>Pond dmh60: dmh</b>	Peak Elev=894.28' Inflow=18.41 cfs 1.235 af 30.0" Round Culvert n=0.013 L=258.0' S=0.0115 '/' Outflow=18.41 cfs 1.235 af
<b>Pond dmh61: dmh</b>	Peak Elev=891.21' Inflow=18.41 cfs 1.235 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=18.41 cfs 1.235 af
<b>Pond dmh62: dmh</b>	Peak Elev=888.87' Inflow=25.78 cfs 1.666 af 30.0" Round Culvert n=0.013 L=62.0' S=0.0248 '/' Outflow=25.78 cfs 1.666 af
<b>Pond dmh69: dmh</b>	Peak Elev=814.90' Inflow=25.78 cfs 1.666 af 30.0" Round Culvert n=0.013 L=29.0' S=0.0338 '/' Outflow=25.78 cfs 1.666 af
<b>Pond DS-1a: detention</b>	Peak Elev=851.58' Storage=14,329 cf Inflow=13.28 cfs 0.899 af Outflow=4.75 cfs 0.899 af
<b>Pond DS-1b: detention</b>	Peak Elev=861.13' Storage=2,587 cf Inflow=2.25 cfs 0.175 af Outflow=0.56 cfs 0.175 af
<b>Pond DS-2a: detention</b>	Peak Elev=900.09' Storage=38,932 cf Inflow=30.38 cfs 2.091 af Outflow=8.04 cfs 2.089 af
<b>Pond DS-2b: detention</b>	Peak Elev=861.05' Storage=10,223 cf Inflow=8.46 cfs 0.619 af Outflow=2.07 cfs 0.593 af
<b>Pond DW-1: House Drywell</b>	Peak Elev=3.50' Storage=0.063 af Inflow=8.90 cfs 0.671 af Discarded=0.05 cfs 0.100 af Primary=8.51 cfs 0.544 af Outflow=8.56 cfs 0.644 af
<b>Pond DW-10: House Drywell</b>	Peak Elev=3.50' Storage=0.027 af Inflow=9.86 cfs 0.894 af Discarded=0.02 cfs 0.040 af Primary=0.19 cfs 0.200 af Secondary=9.52 cfs 0.643 af Outflow=9.73 cfs 0.883 af
<b>Pond DW-2: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=2.11 cfs 0.166 af Discarded=0.01 cfs 0.015 af Primary=2.03 cfs 0.147 af Outflow=2.03 cfs 0.162 af
<b>Pond DW-3: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=9.33 cfs 0.732 af Discarded=0.05 cfs 0.119 af Primary=8.93 cfs 0.582 af Outflow=8.98 cfs 0.701 af
<b>Pond DW-4: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=7.78 cfs 0.599 af Discarded=0.03 cfs 0.074 af Primary=7.46 cfs 0.506 af Outflow=7.49 cfs 0.580 af
<b>Pond DW-5: House Drywell</b>	Peak Elev=3.50' Storage=0.018 af Inflow=7.34 cfs 0.542 af Discarded=0.01 cfs 0.029 af Primary=7.04 cfs 0.505 af Outflow=7.05 cfs 0.534 af
<b>Pond DW-6: House Drywell</b>	Peak Elev=3.50' Storage=0.081 af Inflow=7.72 cfs 0.594 af Discarded=0.06 cfs 0.129 af Primary=7.37 cfs 0.431 af Outflow=7.43 cfs 0.560 af
<b>Pond DW-7: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=12.13 cfs 0.909 af Discarded=0.05 cfs 0.114 af Primary=11.61 cfs 0.764 af Outflow=11.67 cfs 0.878 af
<b>Pond DW-8: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=3.38 cfs 0.265 af Discarded=0.01 cfs 0.016 af Primary=3.25 cfs 0.246 af Outflow=3.26 cfs 0.261 af
<b>Pond DW-9: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=8.85 cfs 0.667 af Discarded=0.03 cfs 0.072 af Primary=8.48 cfs 0.576 af Outflow=8.51 cfs 0.648 af
<b>Pond G1: gabion</b>	Peak Elev=877.88' Storage=86 cf Inflow=8.04 cfs 2.089 af Outflow=8.04 cfs 2.089 af
<b>Pond G2: gabion</b>	Peak Elev=811.29' Storage=99 cf Inflow=11.63 cfs 2.861 af Outflow=11.65 cfs 2.861 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 76

**Link SP1: STUDY POINT #1**Inflow=15.02 cfs 2.012 af  
Primary=15.02 cfs 2.012 af**Link SP2: STUDY POINT #2**Inflow=10.88 cfs 3.220 af  
Primary=10.88 cfs 3.220 af**Link SP3: STUDY POINT #3**Inflow=13.52 cfs 3.209 af  
Primary=13.52 cfs 3.209 af**Link SP4: STUDY POINT #4**Inflow=2.56 cfs 0.186 af  
Primary=2.56 cfs 0.186 af**Link SP5: STUDY POINT #5**Inflow=0.58 cfs 0.042 af  
Primary=0.58 cfs 0.042 af**Total Runoff Area = 29.185 ac   Runoff Volume = 9.612 af   Average Runoff Depth = 3.95"**  
**67.26% Pervious = 19.630 ac   32.74% Impervious = 9.555 ac**

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 77

**Summary for Subcatchment P-1A: Subcat P-1A**

Runoff = 9.86 cfs @ 12.19 hrs, Volume= 0.894 af, Depth= 3.38"  
 Routed to Pond DW-10 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.059	98	Roofs, HSG B
0.085	98	Paved parking, HSG B
0.168	55	Woods, Good, HSG B
0.183	61	>75% Grass cover, Good, HSG B
1.273	74	>75% Grass cover, Good, HSG C
0.966	70	Woods, Good, HSG C
0.044	98	Paved parking, HSG C
0.390	98	Roofs, HSG C
3.168	75	Weighted Average
2.590		81.76% Pervious Area
0.578		18.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.8	55	0.1670	0.09		<b>Sheet Flow,</b> Woods: Dense underbrush n= 0.800 P2= 3.28"
1.1	105	0.0500	1.57		<b>Shallow Concentrated Flow,</b> Short Grass Pasture Kv= 7.0 fps
2.4	622	0.0280	4.24	4.11	<b>Trap/Vee/Rect Channel Flow,</b> Bot.W=1.00' D=0.25' Z= 3.0 & 20.0 ' Top.W=6.75' n= 0.016 Asphalt, rough
13.3	782	Total			

**Summary for Subcatchment P-1B: Subcat P-1B**

Runoff = 2.25 cfs @ 12.12 hrs, Volume= 0.175 af, Depth= 3.69"  
 Routed to Pond DS-1b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (sf)	CN	Description
4,342	98	Paved parking, HSG C
1,445	98	Paved parking, HSG B
3,282	61	>75% Grass cover, Good, HSG B
13,797	74	>75% Grass cover, Good, HSG C
2,004	70	Woods, Good, HSG C
24,871	78	Weighted Average
19,083		76.73% Pervious Area
5,787		23.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 78

**Summary for Subcatchment P-1C: Subcat P-1C**

Runoff = 1.31 cfs @ 12.09 hrs, Volume= 0.095 af, Depth= 3.38"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.002	98	Paved parking, HSG C
0.068	98	Paved parking, HSG B
0.111	61	>75% Grass cover, Good, HSG B
0.156	74	>75% Grass cover, Good, HSG C
0.337	75	Weighted Average
0.267		79.23% Pervious Area
0.070		20.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-1D: Subcat P-1D**

Runoff = 2.94 cfs @ 12.09 hrs, Volume= 0.214 af, Depth= 3.58"  
 Routed to Pond DS-1a : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (sf)	CN	Description
4,574	61	>75% Grass cover, Good, HSG B
2,625	98	Paved parking, HSG B
2,222	98	Roofs, HSG C
1,194	98	Paved parking, HSG C
20,546	74	>75% Grass cover, Good, HSG C
31,162	77	Weighted Average
25,121		80.61% Pervious Area
6,042		19.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-1E: Subcat P-1E**

Runoff = 1.90 cfs @ 12.09 hrs, Volume= 0.141 af, Depth= 4.42"  
 Routed to Pond dmh01 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.040	61	>75% Grass cover, Good, HSG B
0.037	98	Paved parking, HSG B
0.168	98	Paved parking, HSG C
0.138	74	>75% Grass cover, Good, HSG C
0.382	85	Weighted Average
0.178		46.51% Pervious Area
0.204		53.49% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 79

**Summary for Subcatchment P-1F: Subcat P-1F**

Runoff = 8.90 cfs @ 12.09 hrs, Volume= 0.671 af, Depth= 4.74"  
 Routed to Pond DW-1 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.741	74	>75% Grass cover, Good, HSG C
0.492	98	Roofs, HSG C
0.464	98	Paved parking, HSG C
1.697	88	Weighted Average
0.741		43.66% Pervious Area
0.956		56.34% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2A: Subcat P-2A**

Runoff = 6.90 cfs @ 12.09 hrs, Volume= 0.500 af, Depth= 3.38"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.180	98	Roofs, HSG C
0.428	70	Woods, Good, HSG C
1.165	74	>75% Grass cover, Good, HSG C
1.773	75	Weighted Average
1.593		89.86% Pervious Area
0.180		10.14% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2B: Subcat P-2B**

Runoff = 3.99 cfs @ 12.09 hrs, Volume= 0.290 af, Depth= 2.90"  
 Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.522	74	>75% Grass cover, Good, HSG C
0.365	70	Woods, Good, HSG C
0.314	65	Brush, Good, HSG C
1.201	70	Weighted Average
1.201		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 80

**Summary for Subcatchment P-2C: Subcat P-2C**

Runoff = 0.73 cfs @ 12.09 hrs, Volume= 0.055 af, Depth= 4.85"  
 Routed to Pond dmh33 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.085	98	Paved parking, HSG C
0.051	74	>75% Grass cover, Good, HSG C
0.137	89	Weighted Average
0.051		37.60% Pervious Area
0.085		62.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 Min

**Summary for Subcatchment P-2D: Subcat P-2D**

Runoff = 1.27 cfs @ 12.09 hrs, Volume= 0.093 af, Depth= 4.31"  
 Routed to Pond dmh31 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.106	98	Paved parking, HSG C
0.155	74	>75% Grass cover, Good, HSG C
0.260	84	Weighted Average
0.155		59.42% Pervious Area
0.106		40.58% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2E: Subcat P-2E**

Runoff = 12.13 cfs @ 12.09 hrs, Volume= 0.909 af, Depth= 4.63"  
 Routed to Pond DW-7 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
1.068	74	>75% Grass cover, Good, HSG C
0.691	98	Roofs, HSG C
0.595	98	Paved parking, HSG C
2.354	87	Weighted Average
1.068		45.38% Pervious Area
1.286		54.62% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2F: Subcat P-2F**

Runoff = 7.34 cfs @ 12.09 hrs, Volume= 0.542 af, Depth= 4.31"  
 Routed to Pond DW-5 : House Drywell

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 81

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.854	74	>75% Grass cover, Good, HSG C
0.370	98	Roofs, HSG C
0.284	98	Paved parking, HSG C
1.509	84	Weighted Average
0.854		56.63% Pervious Area
0.654		43.37% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-2G: Subcat P-2G

Runoff = 8.85 cfs @ 12.09 hrs, Volume= 0.667 af, Depth= 4.74"  
 Routed to Pond DW-9 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.736	74	>75% Grass cover, Good, HSG C
0.000	65	Brush, Good, HSG C
0.588	98	Roofs, HSG C
0.364	98	Paved parking, HSG C
1.688	88	Weighted Average
0.736		43.60% Pervious Area
0.952		56.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-2H: Subcat P-2H

Runoff = 3.38 cfs @ 12.09 hrs, Volume= 0.265 af, Depth= 5.30"  
 Routed to Pond DW-8 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.136	74	>75% Grass cover, Good, HSG C
0.160	98	Roofs, HSG C
0.304	98	Paved parking, HSG C
0.601	93	Weighted Average
0.136		22.65% Pervious Area
0.465		77.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-2I: Subcat P-2I

Runoff = 0.55 cfs @ 12.09 hrs, Volume= 0.040 af, Depth= 3.79"  
 Routed to Link SP2 : STUDY POINT #2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 82

Area (ac)	CN	Description
0.098	74	>75% Grass cover, Good, HSG C
0.029	98	Paved parking, HSG C
0.127	79	Weighted Average
0.098		77.34% Pervious Area
0.029		22.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, TR-55 Min</b>

**Summary for Subcatchment P-2J: Subcat P-2J**

Runoff = 2.48 cfs @ 12.09 hrs, Volume= 0.180 af, Depth= 3.48"  
 Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.016	70	Woods, Good, HSG C
0.048	98	Roofs, HSG C
0.556	74	>75% Grass cover, Good, HSG C
0.619	76	Weighted Average
0.571		92.27% Pervious Area
0.048		7.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

**Summary for Subcatchment P-3A: Subcat P-3A**

Runoff = 12.39 cfs @ 12.23 hrs, Volume= 1.214 af, Depth= 2.90"  
 Routed to Pond DB-1 : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
2.599	74	>75% Grass cover, Good, HSG C
0.847	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.023	70	Weighted Average
5.023		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
1.3	299	0.3000	3.83		<b>Shallow Concentrated Flow, D-E</b>
					Short Grass Pasture Kv= 7.0 fps
16.1	644	Total			

**Summary for Subcatchment P-3B: Subcat P-3B**

Runoff = 4.80 cfs @ 12.09 hrs, Volume= 0.348 af, Depth= 3.09"  
 Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 83

Area (ac)	CN	Description
0.000	98	Roofs, HSG C
0.172	65	Brush, Good, HSG C
0.274	70	Woods, Good, HSG C
0.905	74	>75% Grass cover, Good, HSG C
1.351	72	Weighted Average
1.351		99.99% Pervious Area
0.000		0.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry,</b>

### Summary for Subcatchment P-3C: Subcat P-3C

Runoff = 2.11 cfs @ 12.09 hrs, Volume= 0.166 af, Depth= 5.30"  
 Routed to Pond DW-2 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.085	74	>75% Grass cover, Good, HSG C
0.051	98	Roofs, HSG C
0.239	98	Paved parking, HSG C
0.375	93	Weighted Average
0.085		22.77% Pervious Area
0.290		77.23% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

### Summary for Subcatchment P-3D: Subcat P-3D

Runoff = 9.33 cfs @ 12.09 hrs, Volume= 0.732 af, Depth= 5.30"  
 Routed to Pond DW-3 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.361	74	>75% Grass cover, Good, HSG C
0.725	98	Roofs, HSG C
0.571	98	Paved parking, HSG C
1.657	93	Weighted Average
0.361		21.80% Pervious Area
1.295		78.20% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr-55 min</b>

### Summary for Subcatchment P-3E: Subcat P-3E

Runoff = 7.78 cfs @ 12.09 hrs, Volume= 0.599 af, Depth= 5.07"  
 Routed to Pond DW-4 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 84

Area (ac)	CN	Description
0.414	74	>75% Grass cover, Good, HSG C
0.552	98	Roofs, HSG C
0.451	98	Paved parking, HSG C
1.417	91	Weighted Average
0.414		29.24% Pervious Area
1.003		70.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

### Summary for Subcatchment P-3F: Subcat P-3F

Runoff = 7.72 cfs @ 12.09 hrs, Volume= 0.594 af, Depth= 5.07"  
 Routed to Pond DW-6 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (ac)	CN	Description
0.388	74	>75% Grass cover, Good, HSG C
0.565	98	Roofs, HSG C
0.452	98	Paved parking, HSG C
1.406	91	Weighted Average
0.388		27.61% Pervious Area
1.018		72.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

### Summary for Subcatchment P-4: Subcat P-4

Runoff = 2.56 cfs @ 12.09 hrs, Volume= 0.186 af, Depth= 3.38"  
 Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

Area (sf)	CN	Description
56	61	>75% Grass cover, Good, HSG B
16,537	74	>75% Grass cover, Good, HSG C
9,257	70	Woods, Good, HSG C
2,814	98	Paved parking, HSG C
28,663	75	Weighted Average
25,849		90.18% Pervious Area
2,814		9.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-5: Subcat P-5

Runoff = 0.58 cfs @ 12.09 hrs, Volume= 0.042 af, Depth= 3.19"  
 Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-year Rainfall=6.12"

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 85

Area (sf)	CN	Description
2,401	70	Woods, Good, HSG C
4,473	74	>75% Grass cover, Good, HSG C
6,874	73	Weighted Average
6,874		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					<b>Direct Entry, TR-55 Min.</b>
5.0	0	Total, Increased to minimum Tc = 6.0 min			

### Summary for Reach R-01: Routing to wetlands

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.


This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 1.351 ac, 0.01% Impervious, Inflow Depth = 3.09" for 25-year event  
 Inflow = 4.80 cfs @ 12.09 hrs, Volume= 0.348 af  
 Outflow = 2.03 cfs @ 12.33 hrs, Volume= 0.348 af, Atten= 58%, Lag= 14.3 min  
 Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 0.37 fps, Min. Travel Time= 32.7 min  
 Avg. Velocity = 0.13 fps, Avg. Travel Time= 89.8 min

Peak Storage= 3,991 cf @ 12.33 hrs  
 Average Depth at Peak Storage= 0.29' , Surface Width= 33.62'  
 Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush  
 Side Slope Z-value= 50.0 '/' Top Width= 105.00'  
 Length= 722.0' Slope= 0.1087 '/  
 Inlet Invert= 889.50', Outlet Invert= 811.00'

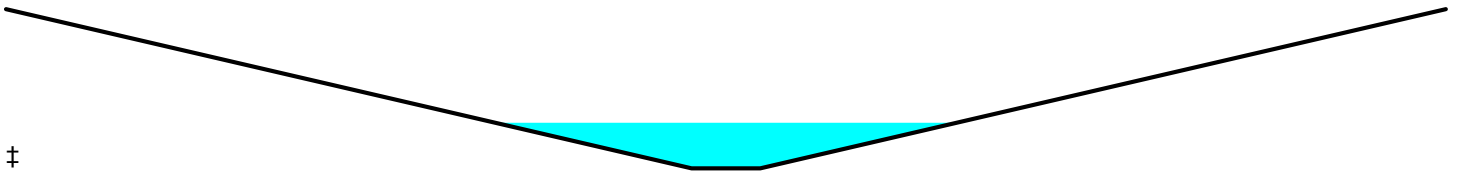

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth > 3.92" for 25-year event  
 Inflow = 10.83 cfs @ 12.11 hrs, Volume= 2.589 af  
 Outflow = 8.76 cfs @ 12.64 hrs, Volume= 2.587 af, Atten= 19%, Lag= 31.5 min  
 Routed to Pond 1P : depression

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 0.38 fps, Min. Travel Time= 23.0 min  
 Avg. Velocity = 0.15 fps, Avg. Travel Time= 57.4 min

Peak Storage= 12,106 cf @ 12.64 hrs  
 Average Depth at Peak Storage= 0.91' , Surface Width= 40.56'  
 Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 26.65 cfs

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.


HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 86

10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush  
 Side Slope Z-value= 30.0 3.5 '/' Top Width= 60.25'  
 Length= 525.0' Slope= 0.0223 '/'  
 Inlet Invert= 875.70', Outlet Invert= 864.00'

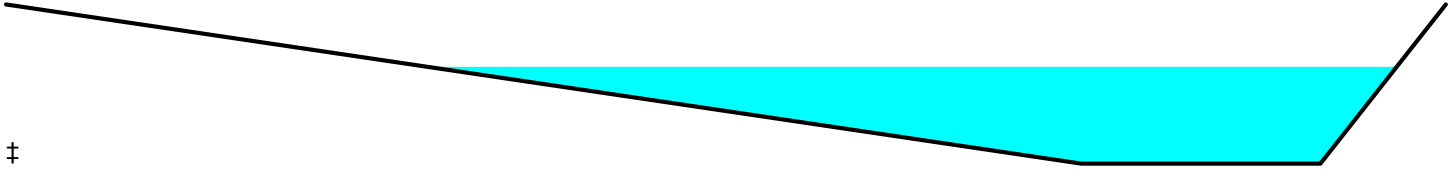**Summary for Pond 1P: depression**

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth > 3.92" for 25-year event  
 Inflow = 8.76 cfs @ 12.64 hrs, Volume= 2.587 af  
 Outflow = 8.76 cfs @ 12.64 hrs, Volume= 2.587 af, Atten= 0%, Lag= 0.4 min  
 Primary = 8.76 cfs @ 12.64 hrs, Volume= 2.587 af  
 Routed to Link SP2 : STUDY POINT #2  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 862.57' @ 12.64 hrs Surf.Area= 453 sf Storage= 222 cf  
 Flood Elev= 864.00' Surf.Area= 837 sf Storage= 1,133 cf

Plug-Flow detention time= 0.6 min calculated for 2.587 af (100% of inflow)  
 Center-of-Mass det. time= 0.6 min ( 930.7 - 930.1 )

Volume	Invert	Avail.Storage	Storage Description		
#1	862.00'	1,133 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
862.00	334	74.0	0	0	334
864.00	837	119.0	1,133	1,133	1,052

Device	Routing	Invert	Outlet Devices
#1	Primary	859.00'	<b>24.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.00' / 858.73' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	862.00'	<b>24.0" Horiz. beehive</b> C= 0.600 Limited to weir flow at low heads
#3	Secondary	863.30'	<b>10.0' long x 5.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

**Primary OutFlow** Max=8.75 cfs @ 12.64 hrs HW=862.57' TW=0.00' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 8.75 cfs of 24.23 cfs potential flow)

↑ **2=beehive** (Weir Controls 8.75 cfs @ 2.46 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=862.00' TW=0.00' (Dynamic Tailwater)

↑ **3=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

**Summary for Pond DB-1: detention**

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth = 3.50" for 25-year event  
 Inflow = 34.91 cfs @ 12.13 hrs, Volume= 2.881 af  
 Outflow = 11.63 cfs @ 12.54 hrs, Volume= 2.861 af, Atten= 67%, Lag= 24.7 min  
 Primary = 11.63 cfs @ 12.54 hrs, Volume= 2.861 af  
 Routed to Pond G2 : gabion  
 Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
 Routed to Link SP3 : STUDY POINT #3



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 87

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 813.62' @ 12.54 hrs Surf.Area= 20,261 sf Storage= 46,804 cf  
 Flood Elev= 816.00' Surf.Area= 24,900 sf Storage= 100,504 cf

Plug-Flow detention time= 87.1 min calculated for 2.861 af (99% of inflow)  
 Center-of-Mass det. time= 82.9 min ( 897.3 - 814.4 )

Volume	Invert	Avail.Storage	Storage Description
#1	811.00'	100,504 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
811.00	15,556	576.0	0	0	15,556
812.00	17,303	594.0	16,422	16,422	17,331
813.00	19,115	613.0	18,201	34,623	19,253
814.00	20,984	632.0	20,042	54,665	21,236
815.00	22,910	651.0	21,940	76,605	23,279
816.00	24,900	670.0	23,898	100,504	25,383

Device	Routing	Invert	Outlet Devices
#1	Primary	811.00'	<b>18.0" Round Culvert</b> L= 32.0' Ke= 0.500 Inlet / Outlet Invert= 811.00' / 810.30' S= 0.0219 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf
#2	Device 1	811.00'	<b>8.0" Vert. (2) 8" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	811.90'	<b>12.0" Vert. (2) 12" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	813.20'	<b>24.0" x 24.0" Horiz. 24" Top of Structure</b> C= 0.600 Limited to weir flow at low heads
#5	Secondary	814.40'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.43 2.54 2.70 2.69 2.68 2.68 2.66 2.64 2.64 2.64 2.65 2.65 2.66 2.66 2.68 2.70 2.74

**Primary OutFlow** Max=11.63 cfs @ 12.54 hrs HW=813.62' TW=811.29' (Dynamic Tailwater)

1=Culvert (Inlet Controls 11.63 cfs @ 6.58 fps)  
 2=(2) 8" Orifice (2yr) (Passes < 5.08 cfs potential flow)  
 3=(2) 12" Orifice (10yr) (Passes < 8.35 cfs potential flow)  
 4=24" Top of Structure (Passes < 7.06 cfs potential flow)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=811.00' TW=0.00' (Dynamic Tailwater)

5=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

**Summary for Pond dmh01: dmh**

Inflow Area = 0.382 ac, 53.49% Impervious, Inflow Depth = 4.42" for 25-year event  
 Inflow = 1.90 cfs @ 12.09 hrs, Volume= 0.141 af  
 Outflow = 1.90 cfs @ 12.09 hrs, Volume= 0.141 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.90 cfs @ 12.09 hrs, Volume= 0.141 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 851.60' @ 12.43 hrs  
 Flood Elev= 855.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	849.34'	<b>12.0" Round Culvert</b> L= 12.0' Ke= 0.500 Inlet / Outlet Invert= 849.34' / 849.22' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.09 hrs HW=850.31' TW=850.45' (Dynamic Tailwater)

1=Culvert ( Controls 0.00 cfs)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 88

**Summary for Pond dmh05: dmh**

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 3.85" for 25-year event  
 Inflow = 8.51 cfs @ 12.11 hrs, Volume= 0.544 af  
 Outflow = 8.51 cfs @ 12.11 hrs, Volume= 0.544 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.51 cfs @ 12.11 hrs, Volume= 0.544 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 871.22' @ 12.11 hrs  
 Flood Elev= 883.10'

Device	Routing	Invert	Outlet Devices
#1	Primary	868.52'	<b>15.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 868.52' / 865.12' S= 0.0351 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=8.32 cfs @ 12.11 hrs HW=871.13' TW=850.64' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 8.32 cfs @ 6.78 fps)

**Summary for Pond dmh20: dmh**

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 4.02" for 25-year event  
 Inflow = 7.04 cfs @ 12.11 hrs, Volume= 0.505 af  
 Outflow = 7.04 cfs @ 12.11 hrs, Volume= 0.505 af, Atten= 0%, Lag= 0.0 min  
 Primary = 7.04 cfs @ 12.11 hrs, Volume= 0.505 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 904.89' @ 12.13 hrs  
 Flood Elev= 907.61'

Device	Routing	Invert	Outlet Devices
#1	Primary	902.74'	<b>15.0" Round Culvert</b> L= 205.0' Ke= 0.500 Inlet / Outlet Invert= 902.74' / 900.30' S= 0.0119 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=6.50 cfs @ 12.11 hrs HW=904.78' TW=902.04' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 6.50 cfs @ 5.30 fps)

**Summary for Pond dmh21: dmh**

Inflow Area = 3.863 ac, 50.23% Impervious, Inflow Depth = 3.94" for 25-year event  
 Inflow = 18.65 cfs @ 12.11 hrs, Volume= 1.270 af  
 Outflow = 18.65 cfs @ 12.11 hrs, Volume= 1.270 af, Atten= 0%, Lag= 0.0 min  
 Primary = 18.65 cfs @ 12.11 hrs, Volume= 1.270 af  
 Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 902.10' @ 12.12 hrs  
 Flood Elev= 905.24'

Device	Routing	Invert	Outlet Devices
#1	Primary	899.55'	<b>24.0" Round Culvert</b> L= 190.0' Ke= 0.500 Inlet / Outlet Invert= 899.55' / 897.65' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=17.71 cfs @ 12.11 hrs HW=902.04' TW=900.24' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 17.71 cfs @ 5.81 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 89

**Summary for Pond dmh23: dmh**

Inflow Area = 5.551 ac, 52.10% Impervious, Inflow Depth = 3.99" for 25-year event  
 Inflow = 27.13 cfs @ 12.11 hrs, Volume= 1.845 af  
 Outflow = 27.13 cfs @ 12.11 hrs, Volume= 1.845 af, Atten= 0%, Lag= 0.0 min  
 Primary = 27.13 cfs @ 12.11 hrs, Volume= 1.845 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 900.29' @ 12.11 hrs  
 Flood Elev= 910.71'

Device	Routing	Invert	Outlet Devices
#1	Primary	897.55'	<b>30.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 897.55' / 897.20' S= 0.0130 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=26.50 cfs @ 12.11 hrs HW=900.24' TW=897.42' (Dynamic Tailwater)  
**1=Culvert** (Barrel Controls 26.50 cfs @ 6.24 fps)

**Summary for Pond dmh25: dmh**

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 4.91" for 25-year event  
 Inflow = 3.25 cfs @ 12.11 hrs, Volume= 0.246 af  
 Outflow = 3.25 cfs @ 12.11 hrs, Volume= 0.246 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.25 cfs @ 12.11 hrs, Volume= 0.246 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 923.84' @ 12.11 hrs  
 Flood Elev= 930.54'

Device	Routing	Invert	Outlet Devices
#1	Primary	922.60'	<b>12.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 922.60' / 915.84' S= 0.0697 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=3.18 cfs @ 12.11 hrs HW=923.81' TW=897.39' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 3.18 cfs @ 4.05 fps)

**Summary for Pond dmh31: dmh**

Inflow Area = 0.260 ac, 40.58% Impervious, Inflow Depth = 4.31" for 25-year event  
 Inflow = 1.27 cfs @ 12.09 hrs, Volume= 0.093 af  
 Outflow = 1.27 cfs @ 12.09 hrs, Volume= 0.093 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.27 cfs @ 12.09 hrs, Volume= 0.093 af  
 Routed to Pond dmh33 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 876.35' @ 12.09 hrs  
 Flood Elev= 885.77'

Device	Routing	Invert	Outlet Devices
#1	Primary	875.76'	<b>12.0" Round Culvert</b> L= 96.0' Ke= 0.500 Inlet / Outlet Invert= 875.76' / 868.05' S= 0.0803 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.24 cfs @ 12.09 hrs HW=876.34' TW=860.50' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 1.24 cfs @ 2.60 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 90

**Summary for Pond dmh33: dmh**

Inflow Area = 0.397 ac, 48.09% Impervious, Inflow Depth = 4.50" for 25-year event  
 Inflow = 1.99 cfs @ 12.09 hrs, Volume= 0.149 af  
 Outflow = 1.99 cfs @ 12.09 hrs, Volume= 0.149 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.99 cfs @ 12.09 hrs, Volume= 0.149 af  
 Routed to Pond DS-2b : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 861.06' @ 12.54 hrs  
 Flood Elev= 864.98'

Device	Routing	Invert	Outlet Devices
#1	Primary	859.71'	<b>15.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.71' / 859.36' S= 0.0130 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=1.28 cfs @ 12.09 hrs HW=860.50' TW=860.32' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 1.28 cfs @ 2.26 fps)

**Summary for Pond dmh50: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 3.68" for 25-year event  
 Inflow = 7.37 cfs @ 12.11 hrs, Volume= 0.431 af  
 Outflow = 7.37 cfs @ 12.11 hrs, Volume= 0.431 af, Atten= 0%, Lag= 0.0 min  
 Primary = 7.37 cfs @ 12.11 hrs, Volume= 0.431 af  
 Routed to Pond dmh51 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 929.83' @ 12.11 hrs  
 Flood Elev= 933.94'

Device	Routing	Invert	Outlet Devices
#1	Primary	927.65'	<b>15.0" Round Culvert</b> L= 102.0' Ke= 0.500 Inlet / Outlet Invert= 927.65' / 919.50' S= 0.0799 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=7.21 cfs @ 12.11 hrs HW=929.76' TW=921.51' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 7.21 cfs @ 5.88 fps)

**Summary for Pond dmh51: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 3.68" for 25-year event  
 Inflow = 7.37 cfs @ 12.11 hrs, Volume= 0.431 af  
 Outflow = 7.37 cfs @ 12.11 hrs, Volume= 0.431 af, Atten= 0%, Lag= 0.0 min  
 Primary = 7.37 cfs @ 12.11 hrs, Volume= 0.431 af  
 Routed to Pond dmh52 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 921.58' @ 12.11 hrs  
 Flood Elev= 924.04'

Device	Routing	Invert	Outlet Devices
#1	Primary	919.40'	<b>15.0" Round Culvert</b> L= 127.0' Ke= 0.500 Inlet / Outlet Invert= 919.40' / 909.50' S= 0.0780 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=7.21 cfs @ 12.11 hrs HW=921.51' TW=894.63' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 7.21 cfs @ 5.88 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 91

**Summary for Pond dmh52: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 3.68" for 25-year event  
 Inflow = 7.37 cfs @ 12.11 hrs, Volume= 0.431 af  
 Outflow = 7.37 cfs @ 12.11 hrs, Volume= 0.431 af, Atten= 0%, Lag= 0.0 min  
 Primary = 7.37 cfs @ 12.11 hrs, Volume= 0.431 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 894.70' @ 12.11 hrs  
 Flood Elev= 914.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.52'	<b>15.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 892.52' / 887.55' S= 0.0802 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=7.21 cfs @ 12.11 hrs HW=894.63' TW=888.82' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 7.21 cfs @ 5.88 fps)

**Summary for Pond dmh53: dmh**

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 4.29" for 25-year event  
 Inflow = 7.46 cfs @ 12.11 hrs, Volume= 0.506 af  
 Outflow = 7.46 cfs @ 12.11 hrs, Volume= 0.506 af, Atten= 0%, Lag= 0.0 min  
 Primary = 7.46 cfs @ 12.11 hrs, Volume= 0.506 af  
 Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 918.08' @ 12.11 hrs  
 Flood Elev= 921.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	916.46'	<b>18.0" Round Culvert</b> L= 31.0' Ke= 0.500 Inlet / Outlet Invert= 916.46' / 916.16' S= 0.0097 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=7.30 cfs @ 12.11 hrs HW=918.06' TW=907.44' (Dynamic Tailwater)  
**1=Culvert** (Barrel Controls 7.30 cfs @ 4.82 fps)

**Summary for Pond dmh55: dmh**

Inflow Area = 3.074 ac, 74.77% Impervious, Inflow Depth = 4.25" for 25-year event  
 Inflow = 16.38 cfs @ 12.11 hrs, Volume= 1.088 af  
 Outflow = 16.38 cfs @ 12.11 hrs, Volume= 1.088 af, Atten= 0%, Lag= 0.0 min  
 Primary = 16.38 cfs @ 12.11 hrs, Volume= 1.088 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 907.49' @ 12.11 hrs  
 Flood Elev= 911.86'

Device	Routing	Invert	Outlet Devices
#1	Primary	905.32'	<b>24.0" Round Culvert</b> L= 72.0' Ke= 0.500 Inlet / Outlet Invert= 905.32' / 903.80' S= 0.0211 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=16.03 cfs @ 12.11 hrs HW=907.44' TW=904.41' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 16.03 cfs @ 5.10 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 92

**Summary for Pond dmh56: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 4.30" for 25-year event  
 Inflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Outflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af, Atten= 0%, Lag= 0.0 min  
 Primary = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Routed to Pond dmh57 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 904.67' @ 12.14 hrs  
 Flood Elev= 908.47'

Device	Routing	Invert	Outlet Devices
#1	Primary	901.21'	<b>24.0" Round Culvert</b> L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 901.21' / 901.02' S= 0.0095 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=15.68 cfs @ 12.11 hrs HW=904.41' TW=903.34' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 15.68 cfs @ 4.99 fps)

**Summary for Pond dmh57: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 4.30" for 25-year event  
 Inflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Outflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af, Atten= 0%, Lag= 0.0 min  
 Primary = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Routed to Pond dmh58 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 903.40' @ 12.11 hrs  
 Flood Elev= 908.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	900.92'	<b>24.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 900.92' / 896.30' S= 0.0476 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=18.02 cfs @ 12.11 hrs HW=903.34' TW=898.05' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 18.02 cfs @ 5.74 fps)

**Summary for Pond dmh58: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 4.30" for 25-year event  
 Inflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Outflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af, Atten= 0%, Lag= 0.0 min  
 Primary = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Routed to Pond dmh59 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 898.08' @ 12.11 hrs  
 Flood Elev= 901.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	896.20'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 896.20' / 893.43' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=18.02 cfs @ 12.11 hrs HW=898.05' TW=895.30' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 18.02 cfs @ 4.63 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 93

**Summary for Pond dmh59: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 4.30" for 25-year event  
 Inflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Outflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af, Atten= 0%, Lag= 0.0 min  
 Primary = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Routed to Pond dmh60 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 895.34' @ 12.13 hrs  
 Flood Elev= 909.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	893.33'	<b>30.0" Round Culvert</b> L= 82.0' Ke= 0.500 Inlet / Outlet Invert= 893.33' / 892.50' S= 0.0101 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=16.82 cfs @ 12.11 hrs HW=895.30' TW=894.25' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 16.82 cfs @ 5.58 fps)

**Summary for Pond dmh60: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 4.30" for 25-year event  
 Inflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Outflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af, Atten= 0%, Lag= 0.0 min  
 Primary = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Routed to Pond dmh61 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 894.28' @ 12.11 hrs  
 Flood Elev= 901.96'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.40'	<b>30.0" Round Culvert</b> L= 258.0' Ke= 0.500 Inlet / Outlet Invert= 892.40' / 889.43' S= 0.0115 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=18.02 cfs @ 12.11 hrs HW=894.25' TW=891.19' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 18.02 cfs @ 4.63 fps)

**Summary for Pond dmh61: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 4.30" for 25-year event  
 Inflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Outflow = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af, Atten= 0%, Lag= 0.0 min  
 Primary = 18.41 cfs @ 12.11 hrs, Volume= 1.235 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 891.21' @ 12.12 hrs  
 Flood Elev= 898.16'

Device	Routing	Invert	Outlet Devices
#1	Primary	889.33'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 889.33' / 886.55' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=17.68 cfs @ 12.11 hrs HW=891.19' TW=888.82' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 17.68 cfs @ 6.28 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 94

**Summary for Pond dmh62: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 4.12" for 25-year event  
 Inflow = 25.78 cfs @ 12.11 hrs, Volume= 1.666 af  
 Outflow = 25.78 cfs @ 12.11 hrs, Volume= 1.666 af, Atten= 0%, Lag= 0.0 min  
 Primary = 25.78 cfs @ 12.11 hrs, Volume= 1.666 af  
 Routed to Pond dmh69 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 888.87' @ 12.11 hrs  
 Flood Elev= 902.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	886.45'	<b>30.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 886.45' / 884.91' S= 0.0248 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=25.26 cfs @ 12.11 hrs HW=888.82' TW=814.85' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 25.26 cfs @ 5.25 fps)

**Summary for Pond dmh69: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 4.12" for 25-year event  
 Inflow = 25.78 cfs @ 12.11 hrs, Volume= 1.666 af  
 Outflow = 25.78 cfs @ 12.11 hrs, Volume= 1.666 af, Atten= 0%, Lag= 0.0 min  
 Primary = 25.78 cfs @ 12.11 hrs, Volume= 1.666 af  
 Routed to Pond DB-1 : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 814.90' @ 12.11 hrs  
 Flood Elev= 818.02'

Device	Routing	Invert	Outlet Devices
#1	Primary	812.48'	<b>30.0" Round Culvert</b> L= 29.0' Ke= 0.500 Inlet / Outlet Invert= 812.48' / 811.50' S= 0.0338 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=25.26 cfs @ 12.11 hrs HW=814.85' TW=812.65' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 25.26 cfs @ 5.25 fps)

**Summary for Pond DS-1a: detention**

Inflow Area = 2.795 ac, 46.49% Impervious, Inflow Depth = 3.86" for 25-year event  
 Inflow = 13.28 cfs @ 12.10 hrs, Volume= 0.899 af  
 Outflow = 4.75 cfs @ 12.39 hrs, Volume= 0.899 af, Atten= 64%, Lag= 17.2 min  
 Primary = 4.75 cfs @ 12.39 hrs, Volume= 0.899 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 851.58' @ 12.39 hrs Surf.Area= 4,480 sf Storage= 14,329 cf  
 Flood Elev= 853.00' Surf.Area= 4,505 sf Storage= 19,995 cf

Plug-Flow detention time= 91.5 min calculated for 0.897 af (100% of inflow)  
 Center-of-Mass det. time= 91.6 min ( 897.1 - 805.5 )

Volume	Invert	Avail. Storage	Storage Description
#1A	848.00'	0 cf	<b>112.00'W x 40.00'L x 5.67'H Field A</b> 25,387 cf Overall - 25,387 cf Embedded = 0 cf
#2A	848.00'	19,995 cf	<b>retain_it retain_it 5.0' x 70</b> Inside #1 Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 14 Rows adjusted for 394.8 cf perimeter wall
#3	853.00'	56 cf	<b>4.00'D x 4.45'H CB-9</b>
#4	853.00'	38 cf	<b>4.00'D x 3.00'H CB-8</b>
		20,088 cf	Total Available Storage



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 95

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	847.90'	<b>15.0" Round Culvert</b> L= 129.0' Ke= 0.500 Inlet / Outlet Invert= 847.90' / 846.36' S= 0.0119 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	847.90'	<b>3.0" Vert. 3" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	849.50'	<b>7.0" Vert. 7" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	851.30'	<b>6.0" Vert. 6" Orifice (25yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	851.90'	<b>8.0" Vert. 8" Orifice (50yr) X 3.00</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	852.80'	<b>4.0' long Overflow Weir</b> 2 End Contraction(s) 4.0' Crest Height

**Primary OutFlow** Max=4.74 cfs @ 12.39 hrs HW=851.58' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 4.74 cfs of 9.24 cfs potential flow)
- 2=3" Orifice (2yr) (Orifice Controls 0.89 cfs @ 9.08 fps)
- 3=7" Orifice (10yr) (Orifice Controls 3.44 cfs @ 6.44 fps)
- 4=6" Orifice (25yr) (Orifice Controls 0.41 cfs @ 1.80 fps)
- 5=8" Orifice (50yr) ( Controls 0.00 cfs)
- 6=Overflow Weir ( Controls 0.00 cfs)

**Summary for Pond DS-1b: detention**

Inflow Area = 0.571 ac, 23.27% Impervious, Inflow Depth = 3.69" for 25-year event  
 Inflow = 2.25 cfs @ 12.12 hrs, Volume= 0.175 af  
 Outflow = 0.56 cfs @ 12.54 hrs, Volume= 0.175 af, Atten= 75%, Lag= 25.4 min  
 Primary = 0.56 cfs @ 12.54 hrs, Volume= 0.175 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 861.13' @ 12.54 hrs Surf.Area= 1,536 sf Storage= 2,587 cf  
 Flood Elev= 862.70' Surf.Area= 1,536 sf Storage= 4,684 cf

Plug-Flow detention time= 63.7 min calculated for 0.175 af (100% of inflow)  
 Center-of-Mass det. time= 62.4 min ( 882.8 - 820.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.20'	0 cf	<b>64.00'W x 24.00'L x 4.17'H Field A</b> 6,400 cf Overall - 6,400 cf Embedded = 0 cf x 40.0% Voids
#2A	859.20'	4,684 cf	<b>retain_it retain_it 3.5' x 24</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 8 Rows adjusted for 135.1 cf perimeter wall
		4,684 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	859.20'	<b>12.0" Round Culvert</b> L= 100.0' Ke= 0.500 Inlet / Outlet Invert= 859.20' / 858.10' S= 0.0110 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>4.0" Vert. 4" Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>12.0" Vert. Overflow</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.56 cfs @ 12.54 hrs HW=861.13' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 0.56 cfs of 4.17 cfs potential flow)
- 2=4" Orifice (Orifice Controls 0.56 cfs @ 6.40 fps)
- 3=Overflow ( Controls 0.00 cfs)

**Summary for Pond DS-2a: detention**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth = 4.08" for 25-year event  
 Inflow = 30.38 cfs @ 12.11 hrs, Volume= 2.091 af  
 Outflow = 8.04 cfs @ 12.49 hrs, Volume= 2.089 af, Atten= 74%, Lag= 22.6 min  
 Primary = 8.04 cfs @ 12.49 hrs, Volume= 2.089 af  
 Routed to Pond G1 : gabion

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 96

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 900.09' @ 12.49 hrs Surf.Area= 4,704 sf Storage= 38,932 cf  
 Flood Elev= 902.66' Storage= 48,125 cf

Plug-Flow detention time= 114.4 min calculated for 2.089 af (100% of inflow)  
 Center-of-Mass det. time= 113.6 min ( 915.7 - 802.1 )

Volume	Invert	Avail.Storage	Storage Description
#1	892.00'	24,073 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 7 Rows adjusted for 394.8 cf perimeter wall
#2	897.00'	24,052 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 6 Rows adjusted for 415.6 cf perimeter wall
		48,125 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	892.00'	<b>24.0" Round Culvert</b> L= 46.0' Ke= 0.500 Inlet / Outlet Invert= 892.00' / 890.52' S= 0.0322 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	892.00'	<b>4.0" Vert. Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	895.40'	<b>8.0" Vert. Orifice (10yr)</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	898.20'	<b>8.0" Vert. Orifice (25yr)</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	899.90'	<b>4.0" Vert. Orifice (50yr)</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	902.00'	<b>4.0' long Sharp-Crested Weir Overflow (100yr)</b> 2 End Contraction(s)

**Primary OutFlow** Max=8.04 cfs @ 12.49 hrs HW=900.08' TW=877.87' (Dynamic Tailwater)

- 1=Culvert (Passes 8.04 cfs of 40.26 cfs potential flow)
- 2=Orifice (2yr) (Orifice Controls 2.36 cfs @ 13.55 fps)
- 3=Orifice (10yr) (Orifice Controls 3.51 cfs @ 10.04 fps)
- 4=Orifice (25yr) (Orifice Controls 2.09 cfs @ 6.00 fps)
- 5=Orifice (50yr) (Orifice Controls 0.07 cfs @ 1.46 fps)
- 6=Sharp-Crested Weir Overflow (100yr) (Controls 0.00 cfs)

**Summary for Pond DS-2b: detention**

Inflow Area = 2.217 ac, 10.77% Impervious, Inflow Depth = 3.35" for 25-year event  
 Inflow = 8.46 cfs @ 12.09 hrs, Volume= 0.619 af  
 Outflow = 2.07 cfs @ 12.50 hrs, Volume= 0.593 af, Atten= 76%, Lag= 24.4 min  
 Primary = 2.07 cfs @ 12.50 hrs, Volume= 0.593 af  
 Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 861.05' @ 12.50 hrs Surf.Area= 5,632 sf Storage= 10,223 cf  
 Flood Elev= 862.70' Surf.Area= 5,645 sf Storage= 17,438 cf

Plug-Flow detention time= 106.2 min calculated for 0.592 af (96% of inflow)  
 Center-of-Mass det. time= 83.8 min ( 907.3 - 823.5 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.00'	0 cf	<b>88.00"W x 64.00"L x 4.17"H Field A</b> 23,467 cf Overall - 23,467 cf Embedded = 0 cf x 40.0% Voids
#2A	859.00'	17,435 cf	<b>retain_it retain_it 3.5' x 88</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 11 Rows adjusted for 233.3 cf perimeter wall
#3	862.50'	9 cf	<b>4.00'D x 0.70'H Vertical Cone/Cylinder</b>
		17,444 cf	Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 97

Device	Routing	Invert	Outlet Devices
#1	Primary	858.90'	<b>12.0" Round Culvert</b> L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 858.90' / 858.44' S= 0.0153 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>8.0" Vert. Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>4.0' long Sharp-Crested Rectangular Weir</b> 2 End Contraction(s) 0.5' Crest Height
#4	Device 1	863.20'	<b>24.0" x 24.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=2.07 cfs @ 12.50 hrs HW=861.05' TW=0.00' (Dynamic Tailwater)

1=Culvert (Passes 2.07 cfs of 4.86 cfs potential flow)

2=Orifice (Orifice Controls 2.07 cfs @ 5.93 fps)

3=Sharp-Crested Rectangular Weir ( Controls 0.00 cfs)

4=Orifice/Grate ( Controls 0.00 cfs)

**Summary for Pond DW-1: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 4.74" for 25-year event  
 Inflow = 8.90 cfs @ 12.09 hrs, Volume= 0.671 af  
 Outflow = 8.56 cfs @ 12.11 hrs, Volume= 0.644 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 10.90 hrs, Volume= 0.100 af  
 Primary = 8.51 cfs @ 12.11 hrs, Volume= 0.544 af  
 Routed to Pond dmh05 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 10.90 hrs Surf.Area= 0.031 ac Storage= 0.063 af

Plug-Flow detention time= 102.2 min calculated for 0.644 af (96% of inflow)

Center-of-Mass det. time= 79.1 min ( 869.9 - 790.8 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 14.00 = 0.063 af Total Available Storage			

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 10.90 hrs HW=3.50' (Free Discharge)

1=Exfiltration (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=871.13' (Dynamic Tailwater)

2=Culvert ( Controls 0.00 cfs)

**Summary for Pond DW-10: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 98

Inflow Area = 3.168 ac, 18.24% Impervious, Inflow Depth = 3.38" for 25-year event  
 Inflow = 9.86 cfs @ 12.19 hrs, Volume= 0.894 af  
 Outflow = 9.73 cfs @ 12.21 hrs, Volume= 0.883 af, Atten= 1%, Lag= 1.6 min  
 Discarded = 0.02 cfs @ 10.75 hrs, Volume= 0.040 af  
 Primary = 0.19 cfs @ 10.75 hrs, Volume= 0.200 af  
 Routed to Link SP1 : STUDY POINT #1  
 Secondary = 9.52 cfs @ 12.21 hrs, Volume= 0.643 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Primary area = Inflow area x 0.142  
 Peak Elev= 3.50' @ 10.75 hrs Surf.Area= 0.013 ac Storage= 0.027 af

Plug-Flow detention time= 32.6 min calculated for 0.883 af (99% of inflow)  
 Center-of-Mass det. time= 25.2 min ( 857.6 - 832.3 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 6.00 = 0.027 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Secondary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	3.00'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 3.00' / 3.00' S= 0.0000 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.02 cfs @ 10.75 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.02 cfs)**Primary OutFlow** Max=0.19 cfs @ 10.75 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)↑**2=Culvert** (Barrel Controls 0.19 cfs @ 2.14 fps)**Secondary OutFlow** Max=0.00 cfs @ 12.21 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)**Summary for Pond DW-2: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.  
 Storage multiplier added to account for number of dwelling units with subcatchment.  
 Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.375 ac, 77.23% Impervious, Inflow Depth = 5.30" for 25-year event  
 Inflow = 2.11 cfs @ 12.09 hrs, Volume= 0.166 af  
 Outflow = 2.03 cfs @ 12.11 hrs, Volume= 0.162 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 9.00 hrs, Volume= 0.015 af  
 Primary = 2.03 cfs @ 12.11 hrs, Volume= 0.147 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 9.00 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 66.6 min calculated for 0.162 af (98% of inflow)  
 Center-of-Mass det. time= 52.3 min ( 824.7 - 772.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 99

0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 9.00 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=904.41' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-3: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.657 ac, 78.20% Impervious, Inflow Depth = 5.30" for 25-year event  
Inflow = 9.33 cfs @ 12.09 hrs, Volume= 0.732 af  
Outflow = 8.98 cfs @ 12.11 hrs, Volume= 0.701 af, Atten= 4%, Lag= 1.4 min  
Discarded = 0.05 cfs @ 10.40 hrs, Volume= 0.119 af  
Primary = 8.93 cfs @ 12.11 hrs, Volume= 0.582 af  
Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Peak Elev= 3.50' @ 10.40 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 111.8 min calculated for 0.701 af (96% of inflow)  
Center-of-Mass det. time= 87.4 min ( 859.8 - 772.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 10.40 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=907.44' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-4: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 100

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 5.07" for 25-year event  
 Inflow = 7.78 cfs @ 12.09 hrs, Volume= 0.599 af  
 Outflow = 7.49 cfs @ 12.11 hrs, Volume= 0.580 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.03 cfs @ 10.10 hrs, Volume= 0.074 af  
 Primary = 7.46 cfs @ 12.11 hrs, Volume= 0.506 af  
 Routed to Pond dmh53 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 10.10 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 85.2 min calculated for 0.579 af (97% of inflow)  
 Center-of-Mass det. time= 67.2 min ( 847.6 - 780.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 10.00 = 0.045 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 10.10 hrs HW=3.50' (Free Discharge)  
 ↑ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=918.06' (Dynamic Tailwater)  
 ↑ **2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-5: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.  
 Storage multiplier added to account for number of dwelling units with subcatchment.  
 Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 4.31" for 25-year event  
 Inflow = 7.34 cfs @ 12.09 hrs, Volume= 0.542 af  
 Outflow = 7.05 cfs @ 12.11 hrs, Volume= 0.534 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 9.65 hrs, Volume= 0.029 af  
 Primary = 7.04 cfs @ 12.11 hrs, Volume= 0.505 af  
 Routed to Pond dmh20 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 9.65 hrs Surf.Area= 0.009 ac Storage= 0.018 af

Plug-Flow detention time= 38.8 min calculated for 0.534 af (99% of inflow)  
 Center-of-Mass det. time= 30.1 min ( 832.9 - 802.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 4.00 = 0.018 af Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 101

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 9.65 hrs HW=3.50' (Free Discharge)

↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=904.78' (Dynamic Tailwater)

↑ **2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-6: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area =	1.406 ac, 72.39% Impervious, Inflow Depth = 5.07" for 25-year event
Inflow =	7.72 cfs @ 12.09 hrs, Volume= 0.594 af
Outflow =	7.43 cfs @ 12.11 hrs, Volume= 0.560 af, Atten= 4%, Lag= 1.4 min
Discarded =	0.06 cfs @ 11.35 hrs, Volume= 0.129 af
Primary =	7.37 cfs @ 12.11 hrs, Volume= 0.431 af

Routed to Pond dmh50 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 11.35 hrs Surf.Area= 0.040 ac Storage= 0.081 af

Plug-Flow detention time= 144.2 min calculated for 0.559 af (94% of inflow)

Center-of-Mass det. time= 113.4 min ( 893.8 - 780.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 18.00 = 0.081 af			Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.06 cfs @ 11.35 hrs HW=3.50' (Free Discharge)

↑ **1=Exfiltration** (Exfiltration Controls 0.06 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=929.76' (Dynamic Tailwater)

↑ **2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-7: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 102

Inflow Area = 2.354 ac, 54.62% Impervious, Inflow Depth = 4.63" for 25-year event  
 Inflow = 12.13 cfs @ 12.09 hrs, Volume= 0.909 af  
 Outflow = 11.67 cfs @ 12.11 hrs, Volume= 0.878 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 10.70 hrs, Volume= 0.114 af  
 Primary = 11.61 cfs @ 12.11 hrs, Volume= 0.764 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 10.70 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 86.0 min calculated for 0.877 af (97% of inflow)  
 Center-of-Mass det. time= 67.3 min ( 861.2 - 794.0 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 10.70 hrs HW=3.50' (Free Discharge)  
 ↑ **1=Exfiltration** (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=902.04' (Dynamic Tailwater)  
 ↑ **2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-8: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.  
 Storage multiplier added to account for number of dwelling units with subcatchment.  
 Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 5.30" for 25-year event  
 Inflow = 3.38 cfs @ 12.09 hrs, Volume= 0.265 af  
 Outflow = 3.26 cfs @ 12.11 hrs, Volume= 0.261 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 7.95 hrs, Volume= 0.016 af  
 Primary = 3.25 cfs @ 12.11 hrs, Volume= 0.246 af  
 Routed to Pond dmh25 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 7.95 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 43.1 min calculated for 0.261 af (98% of inflow)  
 Center-of-Mass det. time= 34.8 min ( 807.3 - 772.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 103

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 7.95 hrs HW=3.50' (Free Discharge)↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=923.81' (Dynamic Tailwater)↑ **2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-9: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.688 ac, 56.40% Impervious, Inflow Depth = 4.74" for 25-year event  
 Inflow = 8.85 cfs @ 12.09 hrs, Volume= 0.667 af  
 Outflow = 8.51 cfs @ 12.11 hrs, Volume= 0.648 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.03 cfs @ 10.30 hrs, Volume= 0.072 af  
 Primary = 8.48 cfs @ 12.11 hrs, Volume= 0.576 af  
 Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 10.30 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 75.1 min calculated for 0.647 af (97% of inflow)

Center-of-Mass det. time= 59.0 min ( 849.8 - 790.8 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 10.00 = 0.045 af			Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 10.30 hrs HW=3.50' (Free Discharge)↑ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=900.24' (Dynamic Tailwater)↑ **2=Culvert** ( Controls 0.00 cfs)**Summary for Pond G1: gabion**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth > 4.07" for 25-year event  
 Inflow = 8.04 cfs @ 12.49 hrs, Volume= 2.089 af  
 Outflow = 8.04 cfs @ 12.50 hrs, Volume= 2.089 af, Atten= 0%, Lag= 0.5 min  
 Primary = 8.04 cfs @ 12.50 hrs, Volume= 2.089 af  
 Routed to Reach R-02 : Routing through wetland/swale

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 104

Peak Elev= 877.88' @ 12.50 hrs Surf.Area= 325 sf Storage= 86 cf  
 Flood Elev= 880.00' Surf.Area= 2 sf Storage= 444 cf

Plug-Flow detention time= 0.1 min calculated for 2.086 af (100% of inflow)  
 Center-of-Mass det. time= 0.1 min ( 915.8 - 915.7 )

Volume	Invert	Avail.Storage	Storage Description
#1	877.50'	442 cf	<b>18.0" Round Pipe Storage</b> L= 250.0'
#2	879.00'	2 cf	<b>1.50'D x 1.00'H Vertical Cone/Cylinder</b>
		444 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	877.50'	<b>2.0" Horiz. invert orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	878.25'	<b>2.0" Vert. spring line orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	880.00'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=8.04 cfs @ 12.50 hrs HW=877.88' TW=876.60' (Dynamic Tailwater)

1=invert orifices (Orifice Controls 8.04 cfs @ 2.95 fps)

2=spring line orifices ( Controls 0.00 cfs)

3=overflow grates ( Controls 0.00 cfs)

**Summary for Pond G2: gabion**

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth > 3.48" for 25-year event  
 Inflow = 11.63 cfs @ 12.54 hrs, Volume= 2.861 af  
 Outflow = 11.65 cfs @ 12.55 hrs, Volume= 2.861 af, Atten= 0%, Lag= 0.4 min  
 Primary = 11.65 cfs @ 12.55 hrs, Volume= 2.861 af  
 Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 811.29' @ 12.55 hrs Surf.Area= 114 sf Storage= 99 cf  
 Flood Elev= 811.80' Storage= 141 cf

Plug-Flow detention time= 0.1 min calculated for 2.861 af (100% of inflow)  
 Center-of-Mass det. time= 0.1 min ( 897.4 - 897.3 )

Volume	Invert	Avail.Storage	Storage Description
#1	810.30'	141 cf	<b>18.0" Round Pipe Storage</b> L= 80.0'

Device	Routing	Invert	Outlet Devices
#1	Primary	810.30'	<b>2.0" Horiz. invert orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	811.05'	<b>2.0" Vert. spring line orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	811.80'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=11.65 cfs @ 12.55 hrs HW=811.29' TW=0.00' (Dynamic Tailwater)

1=invert orifices (Orifice Controls 8.35 cfs @ 4.78 fps)

2=spring line orifices (Orifice Controls 3.30 cfs @ 1.89 fps)

3=overflow grates ( Controls 0.00 cfs)

**Summary for Link SP1: STUDY POINT #1**

Inflow Area = 6.871 ac, 30.28% Impervious, Inflow Depth = 3.51" for 25-year event  
 Inflow = 15.02 cfs @ 12.22 hrs, Volume= 2.012 af  
 Primary = 15.02 cfs @ 12.22 hrs, Volume= 2.012 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP2: STUDY POINT #2**

Inflow Area = 10.269 ac, 37.04% Impervious, Inflow Depth > 3.76" for 25-year event  
 Inflow = 10.88 cfs @ 12.62 hrs, Volume= 3.220 af  
 Primary = 10.88 cfs @ 12.62 hrs, Volume= 3.220 af, Atten= 0%, Lag= 0.0 min

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 25-year Rainfall=6.12"

Printed 12/14/2021

Page 105

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP3: STUDY POINT #3**

Inflow Area = 11.229 ac, 32.11% Impervious, Inflow Depth > 3.43" for 25-year event  
Inflow = 13.52 cfs @ 12.47 hrs, Volume= 3.209 af  
Primary = 13.52 cfs @ 12.47 hrs, Volume= 3.209 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP4: STUDY POINT #4**

Inflow Area = 0.658 ac, 9.82% Impervious, Inflow Depth = 3.38" for 25-year event  
Inflow = 2.56 cfs @ 12.09 hrs, Volume= 0.186 af  
Primary = 2.56 cfs @ 12.09 hrs, Volume= 0.186 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP5: STUDY POINT #5**

Inflow Area = 0.158 ac, 0.00% Impervious, Inflow Depth = 3.19" for 25-year event  
Inflow = 0.58 cfs @ 12.09 hrs, Volume= 0.042 af  
Primary = 0.58 cfs @ 12.09 hrs, Volume= 0.042 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 106

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points  
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
 Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>SubcatchmentP-1A: Subcat P-1A</b>	Runoff Area=3.168 ac 18.24% Impervious Runoff Depth=4.41" Flow Length=782' Tc=13.3 min CN=75 Runoff=12.85 cfs 1.166 af
<b>SubcatchmentP-1B: Subcat P-1B</b>	Runoff Area=24,871 sf 23.27% Impervious Runoff Depth=4.75" Flow Length=315' Tc=8.2 min CN=78 Runoff=2.89 cfs 0.226 af
<b>SubcatchmentP-1C: Subcat P-1C</b>	Runoff Area=0.337 ac 20.77% Impervious Runoff Depth=4.41" Tc=6.0 min CN=75 Runoff=1.71 cfs 0.124 af
<b>SubcatchmentP-1D: Subcat P-1D</b>	Runoff Area=31,162 sf 19.39% Impervious Runoff Depth=4.64" Tc=6.0 min CN=77 Runoff=3.79 cfs 0.276 af
<b>SubcatchmentP-1E: Subcat P-1E</b>	Runoff Area=0.382 ac 53.49% Impervious Runoff Depth=5.54" Tc=6.0 min CN=85 Runoff=2.35 cfs 0.176 af
<b>SubcatchmentP-1F: Subcat P-1F</b>	Runoff Area=1.697 ac 56.34% Impervious Runoff Depth=5.89" Tc=6.0 min CN=88 Runoff=10.92 cfs 0.832 af
<b>SubcatchmentP-2A: Subcat P-2A</b>	Runoff Area=1.773 ac 10.14% Impervious Runoff Depth=4.41" Tc=6.0 min CN=75 Runoff=8.97 cfs 0.652 af
<b>SubcatchmentP-2B: Subcat P-2B</b>	Runoff Area=1.201 ac 0.00% Impervious Runoff Depth=3.87" Tc=6.0 min CN=70 Runoff=5.34 cfs 0.387 af
<b>SubcatchmentP-2C: Subcat P-2C</b>	Runoff Area=0.137 ac 62.40% Impervious Runoff Depth=6.00" Tc=6.0 min CN=89 Runoff=0.89 cfs 0.068 af
<b>SubcatchmentP-2D: Subcat P-2D</b>	Runoff Area=0.260 ac 40.58% Impervious Runoff Depth=5.43" Tc=6.0 min CN=84 Runoff=1.58 cfs 0.118 af
<b>SubcatchmentP-2E: Subcat P-2E</b>	Runoff Area=2.354 ac 54.62% Impervious Runoff Depth=5.77" Tc=6.0 min CN=87 Runoff=14.94 cfs 1.132 af
<b>SubcatchmentP-2F: Subcat P-2F</b>	Runoff Area=1.509 ac 43.37% Impervious Runoff Depth=5.43" Tc=6.0 min CN=84 Runoff=9.14 cfs 0.682 af
<b>SubcatchmentP-2G: Subcat P-2G</b>	Runoff Area=1.688 ac 56.40% Impervious Runoff Depth=5.89" Tc=6.0 min CN=88 Runoff=10.85 cfs 0.828 af
<b>SubcatchmentP-2H: Subcat P-2H</b>	Runoff Area=0.601 ac 77.35% Impervious Runoff Depth=6.47" Tc=6.0 min CN=93 Runoff=4.08 cfs 0.324 af
<b>SubcatchmentP-2I: Subcat P-2I</b>	Runoff Area=0.127 ac 22.66% Impervious Runoff Depth=4.86" Tc=6.0 min CN=79 Runoff=0.70 cfs 0.052 af
<b>SubcatchmentP-2J: Subcat P-2J</b>	Runoff Area=0.619 ac 7.73% Impervious Runoff Depth=4.53" Tc=6.0 min CN=76 Runoff=3.21 cfs 0.233 af
<b>SubcatchmentP-3A: Subcat P-3A</b>	Runoff Area=5.023 ac 0.00% Impervious Runoff Depth=3.87" Flow Length=644' Tc=16.1 min CN=70 Runoff=16.71 cfs 1.620 af
<b>SubcatchmentP-3B: Subcat P-3B</b>	Runoff Area=1.351 ac 0.01% Impervious Runoff Depth=4.09" Tc=6.0 min CN=72 Runoff=6.34 cfs 0.460 af
<b>SubcatchmentP-3C: Subcat P-3C</b>	Runoff Area=0.375 ac 77.23% Impervious Runoff Depth=6.47" Tc=6.0 min CN=93 Runoff=2.55 cfs 0.202 af
<b>SubcatchmentP-3D: Subcat P-3D</b>	Runoff Area=1.657 ac 78.20% Impervious Runoff Depth=6.47" Tc=6.0 min CN=93 Runoff=11.25 cfs 0.893 af
<b>SubcatchmentP-3E: Subcat P-3E</b>	Runoff Area=1.417 ac 70.76% Impervious Runoff Depth=6.23" Tc=6.0 min CN=91 Runoff=9.44 cfs 0.736 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 107

**Subcatchment P-3F: Subcat P-3F**Runoff Area=1.406 ac 72.39% Impervious Runoff Depth=6.23"  
Tc=6.0 min CN=91 Runoff=9.37 cfs 0.730 af**Subcatchment P-4: Subcat P-4**Runoff Area=28,663 sf 9.82% Impervious Runoff Depth=4.41"  
Tc=6.0 min CN=75 Runoff=3.33 cfs 0.242 af**Subcatchment P-5: Subcat P-5**Runoff Area=6,874 sf 0.00% Impervious Runoff Depth=4.20"  
Tc=6.0 min CN=73 Runoff=0.76 cfs 0.055 af**Reach R-01: Routing to wetlands**Avg. Flow Depth=0.33' Max Vel=0.40 fps Inflow=6.34 cfs 0.460 af  
n=0.400 L=722.0' S=0.1087 ' Capacity=43.77 cfs Outflow=2.83 cfs 0.460 af**Reach R-02: Routing through wetland/swale**Avg. Flow Depth=1.05' Max Vel=0.41 fps Inflow=14.68 cfs 3.318 af  
n=0.400 L=525.0' S=0.0223 ' Capacity=26.65 cfs Outflow=11.88 cfs 3.316 af**Pond 1P: depression**Peak Elev=862.69' Storage=282 cf Inflow=11.88 cfs 3.316 af  
Primary=11.88 cfs 3.316 af Secondary=0.00 cfs 0.000 af Outflow=11.88 cfs 3.316 af**Pond DB-1: detention**Peak Elev=814.31' Storage=61,154 cf Inflow=43.80 cfs 3.748 af  
Primary=13.60 cfs 3.728 af Secondary=0.00 cfs 0.000 af Outflow=13.60 cfs 3.728 af**Pond dmh01: dmh**Peak Elev=852.29' Inflow=2.35 cfs 0.176 af  
12.0" Round Culvert n=0.013 L=12.0' S=0.0100 ' Outflow=2.35 cfs 0.176 af**Pond dmh05: dmh**Peak Elev=872.27' Inflow=10.46 cfs 0.703 af  
15.0" Round Culvert n=0.013 L=97.0' S=0.0351 ' Outflow=10.46 cfs 0.703 af**Pond dmh20: dmh**Peak Elev=907.81' Inflow=8.78 cfs 0.645 af  
15.0" Round Culvert n=0.013 L=205.0' S=0.0119 ' Outflow=8.78 cfs 0.645 af**Pond dmh21: dmh**Peak Elev=903.84' Inflow=23.09 cfs 1.630 af  
24.0" Round Culvert n=0.013 L=190.0' S=0.0100 ' Outflow=23.09 cfs 1.630 af**Pond dmh23: dmh**Peak Elev=902.10' Inflow=33.51 cfs 2.364 af  
30.0" Round Culvert n=0.013 L=27.0' S=0.0130 ' Outflow=33.51 cfs 2.364 af**Pond dmh25: dmh**Peak Elev=924.17' Inflow=3.92 cfs 0.304 af  
12.0" Round Culvert n=0.013 L=97.0' S=0.0697 ' Outflow=3.92 cfs 0.304 af**Pond dmh31: dmh**Peak Elev=876.44' Inflow=1.58 cfs 0.118 af  
12.0" Round Culvert n=0.013 L=96.0' S=0.0803 ' Outflow=1.58 cfs 0.118 af**Pond dmh33: dmh**Peak Elev=861.71' Inflow=2.47 cfs 0.186 af  
15.0" Round Culvert n=0.013 L=27.0' S=0.0130 ' Outflow=2.47 cfs 0.186 af**Pond dmh50: dmh**Peak Elev=930.57' Inflow=8.96 cfs 0.564 af  
15.0" Round Culvert n=0.013 L=102.0' S=0.0799 ' Outflow=8.96 cfs 0.564 af**Pond dmh51: dmh**Peak Elev=922.32' Inflow=8.96 cfs 0.564 af  
15.0" Round Culvert n=0.013 L=127.0' S=0.0780 ' Outflow=8.96 cfs 0.564 af**Pond dmh52: dmh**Peak Elev=895.44' Inflow=8.96 cfs 0.564 af  
15.0" Round Culvert n=0.013 L=62.0' S=0.0802 ' Outflow=8.96 cfs 0.564 af**Pond dmh53: dmh**Peak Elev=918.50' Inflow=9.06 cfs 0.641 af  
18.0" Round Culvert n=0.013 L=31.0' S=0.0097 ' Outflow=9.06 cfs 0.641 af**Pond dmh55: dmh**Peak Elev=908.04' Inflow=19.84 cfs 1.382 af  
24.0" Round Culvert n=0.013 L=72.0' S=0.0211 ' Outflow=19.84 cfs 1.382 af**Pond dmh56: dmh**Peak Elev=905.95' Inflow=22.29 cfs 1.565 af  
24.0" Round Culvert n=0.013 L=20.0' S=0.0095 ' Outflow=22.29 cfs 1.565 af**Pond dmh57: dmh**Peak Elev=904.09' Inflow=22.29 cfs 1.565 af  
24.0" Round Culvert n=0.013 L=97.0' S=0.0476 ' Outflow=22.29 cfs 1.565 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 108

<b>Pond dmh58: dmh</b>	Peak Elev=898.34' Inflow=22.29 cfs 1.565 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=22.29 cfs 1.565 af
<b>Pond dmh59: dmh</b>	Peak Elev=895.63' Inflow=22.29 cfs 1.565 af 30.0" Round Culvert n=0.013 L=82.0' S=0.0101 '/' Outflow=22.29 cfs 1.565 af
<b>Pond dmh60: dmh</b>	Peak Elev=894.54' Inflow=22.29 cfs 1.565 af 30.0" Round Culvert n=0.013 L=258.0' S=0.0115 '/' Outflow=22.29 cfs 1.565 af
<b>Pond dmh61: dmh</b>	Peak Elev=891.53' Inflow=22.29 cfs 1.565 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=22.29 cfs 1.565 af
<b>Pond dmh62: dmh</b>	Peak Elev=889.45' Inflow=31.25 cfs 2.129 af 30.0" Round Culvert n=0.013 L=62.0' S=0.0248 '/' Outflow=31.25 cfs 2.129 af
<b>Pond dmh69: dmh</b>	Peak Elev=815.48' Inflow=31.25 cfs 2.129 af 30.0" Round Culvert n=0.013 L=29.0' S=0.0338 '/' Outflow=31.25 cfs 2.129 af
<b>Pond DS-1a: detention</b>	Peak Elev=852.24' Storage=16,936 cf Inflow=16.51 cfs 1.156 af Outflow=7.60 cfs 1.156 af
<b>Pond DS-1b: detention</b>	Peak Elev=861.78' Storage=3,453 cf Inflow=2.89 cfs 0.226 af Outflow=0.65 cfs 0.226 af
<b>Pond DS-2a: detention</b>	Peak Elev=901.98' Storage=48,009 cf Inflow=37.43 cfs 2.668 af Outflow=10.53 cfs 2.666 af
<b>Pond DS-2b: detention</b>	Peak Elev=861.71' Storage=13,500 cf Inflow=11.01 cfs 0.807 af Outflow=2.48 cfs 0.781 af
<b>Pond DW-1: House Drywell</b>	Peak Elev=3.50' Storage=0.063 af Inflow=10.92 cfs 0.832 af Discarded=0.05 cfs 0.102 af Primary=10.46 cfs 0.703 af Outflow=10.50 cfs 0.806 af
<b>Pond DW-10: House Drywell</b>	Peak Elev=3.50' Storage=0.027 af Inflow=12.85 cfs 1.166 af Discarded=0.02 cfs 0.041 af Primary=0.19 cfs 0.217 af Secondary=12.47 cfs 0.897 af Outflow=12.68 cfs 1.155 af
<b>Pond DW-2: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=2.55 cfs 0.202 af Discarded=0.01 cfs 0.016 af Primary=2.45 cfs 0.183 af Outflow=2.46 cfs 0.199 af
<b>Pond DW-3: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=11.25 cfs 0.893 af Discarded=0.05 cfs 0.122 af Primary=10.78 cfs 0.741 af Outflow=10.84 cfs 0.862 af
<b>Pond DW-4: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=9.44 cfs 0.736 af Discarded=0.03 cfs 0.076 af Primary=9.06 cfs 0.641 af Outflow=9.09 cfs 0.717 af
<b>Pond DW-5: House Drywell</b>	Peak Elev=3.50' Storage=0.018 af Inflow=9.14 cfs 0.682 af Discarded=0.01 cfs 0.029 af Primary=8.78 cfs 0.645 af Outflow=8.79 cfs 0.674 af
<b>Pond DW-6: House Drywell</b>	Peak Elev=3.50' Storage=0.081 af Inflow=9.37 cfs 0.730 af Discarded=0.06 cfs 0.132 af Primary=8.96 cfs 0.564 af Outflow=9.02 cfs 0.696 af
<b>Pond DW-7: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=14.94 cfs 1.132 af Discarded=0.05 cfs 0.117 af Primary=14.32 cfs 0.985 af Outflow=14.37 cfs 1.101 af
<b>Pond DW-8: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=4.08 cfs 0.324 af Discarded=0.01 cfs 0.016 af Primary=3.92 cfs 0.304 af Outflow=3.93 cfs 0.320 af
<b>Pond DW-9: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=10.85 cfs 0.828 af Discarded=0.03 cfs 0.074 af Primary=10.41 cfs 0.735 af Outflow=10.45 cfs 0.809 af
<b>Pond G1: gabion</b>	Peak Elev=878.14' Storage=181 cf Inflow=10.53 cfs 2.666 af Outflow=10.53 cfs 2.666 af
<b>Pond G2: gabion</b>	Peak Elev=811.44' Storage=115 cf Inflow=13.60 cfs 3.728 af Outflow=13.61 cfs 3.728 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

*Type III 24-hr 50-year Rainfall=7.30"*

Printed 12/14/2021

Page 109

**Link SP1: STUDY POINT #1**Inflow=21.09 cfs 2.620 af  
Primary=21.09 cfs 2.620 af**Link SP2: STUDY POINT #2**Inflow=14.47 cfs 4.148 af  
Primary=14.47 cfs 4.148 af**Link SP3: STUDY POINT #3**Inflow=16.13 cfs 4.188 af  
Primary=16.13 cfs 4.188 af**Link SP4: STUDY POINT #4**Inflow=3.33 cfs 0.242 af  
Primary=3.33 cfs 0.242 af**Link SP5: STUDY POINT #5**Inflow=0.76 cfs 0.055 af  
Primary=0.76 cfs 0.055 af**Total Runoff Area = 29.185 ac   Runoff Volume = 12.216 af   Average Runoff Depth = 5.02"**  
**67.26% Pervious = 19.630 ac   32.74% Impervious = 9.555 ac**

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 110

**Summary for Subcatchment P-1A: Subcat P-1A**

Runoff = 12.85 cfs @ 12.19 hrs, Volume= 1.166 af, Depth= 4.41"  
 Routed to Pond DW-10 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.059	98	Roofs, HSG B
0.085	98	Paved parking, HSG B
0.168	55	Woods, Good, HSG B
0.183	61	>75% Grass cover, Good, HSG B
1.273	74	>75% Grass cover, Good, HSG C
0.966	70	Woods, Good, HSG C
0.044	98	Paved parking, HSG C
0.390	98	Roofs, HSG C
3.168	75	Weighted Average
2.590		81.76% Pervious Area
0.578		18.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.8	55	0.1670	0.09		<b>Sheet Flow,</b> Woods: Dense underbrush n= 0.800 P2= 3.28"
1.1	105	0.0500	1.57		<b>Shallow Concentrated Flow,</b> Short Grass Pasture Kv= 7.0 fps
2.4	622	0.0280	4.24	4.11	<b>Trap/Vee/Rect Channel Flow,</b> Bot.W=1.00' D=0.25' Z= 3.0 & 20.0 ' Top.W=6.75' n= 0.016 Asphalt, rough
13.3	782	Total			

**Summary for Subcatchment P-1B: Subcat P-1B**

Runoff = 2.89 cfs @ 12.12 hrs, Volume= 0.226 af, Depth= 4.75"  
 Routed to Pond DS-1b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (sf)	CN	Description
4,342	98	Paved parking, HSG C
1,445	98	Paved parking, HSG B
3,282	61	>75% Grass cover, Good, HSG B
13,797	74	>75% Grass cover, Good, HSG C
2,004	70	Woods, Good, HSG C
24,871	78	Weighted Average
19,083		76.73% Pervious Area
5,787		23.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 111

**Summary for Subcatchment P-1C: Subcat P-1C**

Runoff = 1.71 cfs @ 12.09 hrs, Volume= 0.124 af, Depth= 4.41"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.002	98	Paved parking, HSG C
0.068	98	Paved parking, HSG B
0.111	61	>75% Grass cover, Good, HSG B
0.156	74	>75% Grass cover, Good, HSG C
0.337	75	Weighted Average
0.267		79.23% Pervious Area
0.070		20.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-1D: Subcat P-1D**

Runoff = 3.79 cfs @ 12.09 hrs, Volume= 0.276 af, Depth= 4.64"  
 Routed to Pond DS-1a : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (sf)	CN	Description
4,574	61	>75% Grass cover, Good, HSG B
2,625	98	Paved parking, HSG B
2,222	98	Roofs, HSG C
1,194	98	Paved parking, HSG C
20,546	74	>75% Grass cover, Good, HSG C
31,162	77	Weighted Average
25,121		80.61% Pervious Area
6,042		19.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-1E: Subcat P-1E**

Runoff = 2.35 cfs @ 12.09 hrs, Volume= 0.176 af, Depth= 5.54"  
 Routed to Pond dmh01 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.040	61	>75% Grass cover, Good, HSG B
0.037	98	Paved parking, HSG B
0.168	98	Paved parking, HSG C
0.138	74	>75% Grass cover, Good, HSG C
0.382	85	Weighted Average
0.178		46.51% Pervious Area
0.204		53.49% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 112

**Summary for Subcatchment P-1F: Subcat P-1F**

Runoff = 10.92 cfs @ 12.09 hrs, Volume= 0.832 af, Depth= 5.89"  
 Routed to Pond DW-1 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.741	74	>75% Grass cover, Good, HSG C
0.492	98	Roofs, HSG C
0.464	98	Paved parking, HSG C
1.697	88	Weighted Average
0.741		43.66% Pervious Area
0.956		56.34% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2A: Subcat P-2A**

Runoff = 8.97 cfs @ 12.09 hrs, Volume= 0.652 af, Depth= 4.41"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.180	98	Roofs, HSG C
0.428	70	Woods, Good, HSG C
1.165	74	>75% Grass cover, Good, HSG C
1.773	75	Weighted Average
1.593		89.86% Pervious Area
0.180		10.14% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2B: Subcat P-2B**

Runoff = 5.34 cfs @ 12.09 hrs, Volume= 0.387 af, Depth= 3.87"  
 Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.522	74	>75% Grass cover, Good, HSG C
0.365	70	Woods, Good, HSG C
0.314	65	Brush, Good, HSG C
1.201	70	Weighted Average
1.201		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 113

**Summary for Subcatchment P-2C: Subcat P-2C**

Runoff = 0.89 cfs @ 12.09 hrs, Volume= 0.068 af, Depth= 6.00"  
 Routed to Pond dmh33 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.085	98	Paved parking, HSG C
0.051	74	>75% Grass cover, Good, HSG C
0.137	89	Weighted Average
0.051		37.60% Pervious Area
0.085		62.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 Min

**Summary for Subcatchment P-2D: Subcat P-2D**

Runoff = 1.58 cfs @ 12.09 hrs, Volume= 0.118 af, Depth= 5.43"  
 Routed to Pond dmh31 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.106	98	Paved parking, HSG C
0.155	74	>75% Grass cover, Good, HSG C
0.260	84	Weighted Average
0.155		59.42% Pervious Area
0.106		40.58% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2E: Subcat P-2E**

Runoff = 14.94 cfs @ 12.09 hrs, Volume= 1.132 af, Depth= 5.77"  
 Routed to Pond DW-7 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
1.068	74	>75% Grass cover, Good, HSG C
0.691	98	Roofs, HSG C
0.595	98	Paved parking, HSG C
2.354	87	Weighted Average
1.068		45.38% Pervious Area
1.286		54.62% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2F: Subcat P-2F**

Runoff = 9.14 cfs @ 12.09 hrs, Volume= 0.682 af, Depth= 5.43"  
 Routed to Pond DW-5 : House Drywell

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 114

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.854	74	>75% Grass cover, Good, HSG C
0.370	98	Roofs, HSG C
0.284	98	Paved parking, HSG C
1.509	84	Weighted Average
0.854		56.63% Pervious Area
0.654		43.37% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-2G: Subcat P-2G

Runoff = 10.85 cfs @ 12.09 hrs, Volume= 0.828 af, Depth= 5.89"  
 Routed to Pond DW-9 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.736	74	>75% Grass cover, Good, HSG C
0.000	65	Brush, Good, HSG C
0.588	98	Roofs, HSG C
0.364	98	Paved parking, HSG C
1.688	88	Weighted Average
0.736		43.60% Pervious Area
0.952		56.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-2H: Subcat P-2H

Runoff = 4.08 cfs @ 12.09 hrs, Volume= 0.324 af, Depth= 6.47"  
 Routed to Pond DW-8 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.136	74	>75% Grass cover, Good, HSG C
0.160	98	Roofs, HSG C
0.304	98	Paved parking, HSG C
0.601	93	Weighted Average
0.136		22.65% Pervious Area
0.465		77.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-2I: Subcat P-2I

Runoff = 0.70 cfs @ 12.09 hrs, Volume= 0.052 af, Depth= 4.86"  
 Routed to Link SP2 : STUDY POINT #2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 115

Area (ac)	CN	Description
0.098	74	>75% Grass cover, Good, HSG C
0.029	98	Paved parking, HSG C
0.127	79	Weighted Average
0.098		77.34% Pervious Area
0.029		22.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, TR-55 Min</b>

**Summary for Subcatchment P-2J: Subcat P-2J**

Runoff = 3.21 cfs @ 12.09 hrs, Volume= 0.233 af, Depth= 4.53"  
 Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.016	70	Woods, Good, HSG C
0.048	98	Roofs, HSG C
0.556	74	>75% Grass cover, Good, HSG C
0.619	76	Weighted Average
0.571		92.27% Pervious Area
0.048		7.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

**Summary for Subcatchment P-3A: Subcat P-3A**

Runoff = 16.71 cfs @ 12.22 hrs, Volume= 1.620 af, Depth= 3.87"  
 Routed to Pond DB-1 : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
2.599	74	>75% Grass cover, Good, HSG C
0.847	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.023	70	Weighted Average
5.023		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
1.3	299	0.3000	3.83		<b>Shallow Concentrated Flow, D-E</b>
					Short Grass Pasture Kv= 7.0 fps
16.1	644	Total			

**Summary for Subcatchment P-3B: Subcat P-3B**

Runoff = 6.34 cfs @ 12.09 hrs, Volume= 0.460 af, Depth= 4.09"  
 Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 116

Area (ac)	CN	Description
0.000	98	Roofs, HSG C
0.172	65	Brush, Good, HSG C
0.274	70	Woods, Good, HSG C
0.905	74	>75% Grass cover, Good, HSG C
1.351	72	Weighted Average
1.351		99.99% Pervious Area
0.000		0.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry,</b>

**Summary for Subcatchment P-3C: Subcat P-3C**

Runoff = 2.55 cfs @ 12.09 hrs, Volume= 0.202 af, Depth= 6.47"  
 Routed to Pond DW-2 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.085	74	>75% Grass cover, Good, HSG C
0.051	98	Roofs, HSG C
0.239	98	Paved parking, HSG C
0.375	93	Weighted Average
0.085		22.77% Pervious Area
0.290		77.23% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

**Summary for Subcatchment P-3D: Subcat P-3D**

Runoff = 11.25 cfs @ 12.09 hrs, Volume= 0.893 af, Depth= 6.47"  
 Routed to Pond DW-3 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.361	74	>75% Grass cover, Good, HSG C
0.725	98	Roofs, HSG C
0.571	98	Paved parking, HSG C
1.657	93	Weighted Average
0.361		21.80% Pervious Area
1.295		78.20% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr-55 min</b>

**Summary for Subcatchment P-3E: Subcat P-3E**

Runoff = 9.44 cfs @ 12.09 hrs, Volume= 0.736 af, Depth= 6.23"  
 Routed to Pond DW-4 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 117

Area (ac)	CN	Description
0.414	74	>75% Grass cover, Good, HSG C
0.552	98	Roofs, HSG C
0.451	98	Paved parking, HSG C
1.417	91	Weighted Average
0.414		29.24% Pervious Area
1.003		70.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-3F: Subcat P-3F**

Runoff = 9.37 cfs @ 12.09 hrs, Volume= 0.730 af, Depth= 6.23"  
 Routed to Pond DW-6 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (ac)	CN	Description
0.388	74	>75% Grass cover, Good, HSG C
0.565	98	Roofs, HSG C
0.452	98	Paved parking, HSG C
1.406	91	Weighted Average
0.388		27.61% Pervious Area
1.018		72.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-4: Subcat P-4**

Runoff = 3.33 cfs @ 12.09 hrs, Volume= 0.242 af, Depth= 4.41"  
 Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

Area (sf)	CN	Description
56	61	>75% Grass cover, Good, HSG B
16,537	74	>75% Grass cover, Good, HSG C
9,257	70	Woods, Good, HSG C
2,814	98	Paved parking, HSG C
28,663	75	Weighted Average
25,849		90.18% Pervious Area
2,814		9.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-5: Subcat P-5**

Runoff = 0.76 cfs @ 12.09 hrs, Volume= 0.055 af, Depth= 4.20"  
 Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 50-year Rainfall=7.30"

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 118

Area (sf)	CN	Description
2,401	70	Woods, Good, HSG C
4,473	74	>75% Grass cover, Good, HSG C
6,874	73	Weighted Average
6,874		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					<b>Direct Entry, TR-55 Min.</b>
5.0	0	Total, Increased to minimum Tc = 6.0 min			

### Summary for Reach R-01: Routing to wetlands

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.


This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 1.351 ac, 0.01% Impervious, Inflow Depth = 4.09" for 50-year event  
Inflow = 6.34 cfs @ 12.09 hrs, Volume= 0.460 af  
Outflow = 2.83 cfs @ 12.30 hrs, Volume= 0.460 af, Atten= 55%, Lag= 12.7 min  
Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Max. Velocity= 0.40 fps, Min. Travel Time= 30.1 min  
Avg. Velocity = 0.14 fps, Avg. Travel Time= 84.9 min

Peak Storage= 5,112 cf @ 12.30 hrs  
Average Depth at Peak Storage= 0.33', Surface Width= 37.96'  
Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush  
Side Slope Z-value= 50.0 '/' Top Width= 105.00'  
Length= 722.0' Slope= 0.1087 '/'  
Inlet Invert= 889.50', Outlet Invert= 811.00'

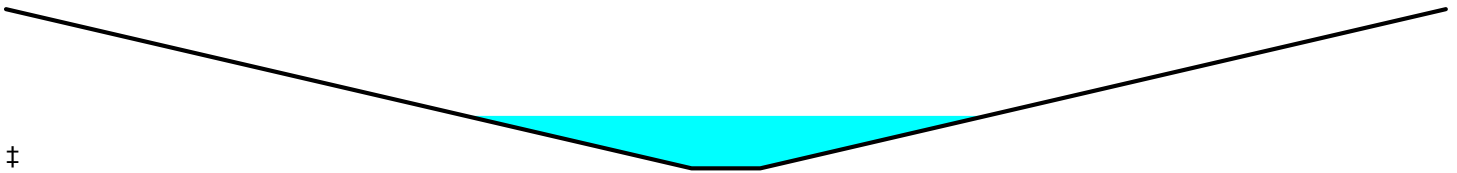

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth > 5.02" for 50-year event  
Inflow = 14.68 cfs @ 12.13 hrs, Volume= 3.318 af  
Outflow = 11.88 cfs @ 12.58 hrs, Volume= 3.316 af, Atten= 19%, Lag= 27.4 min  
Routed to Pond 1P : depression

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Max. Velocity= 0.41 fps, Min. Travel Time= 21.3 min  
Avg. Velocity = 0.16 fps, Avg. Travel Time= 53.9 min

Peak Storage= 15,172 cf @ 12.58 hrs  
Average Depth at Peak Storage= 1.05', Surface Width= 45.12'  
Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 26.65 cfs



**2889-01 - Proposed HydroCAD**


Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 119

10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush  
Side Slope Z-value= 30.0 3.5 '/' Top Width= 60.25'  
Length= 525.0' Slope= 0.0223 '/'  
Inlet Invert= 875.70', Outlet Invert= 864.00'

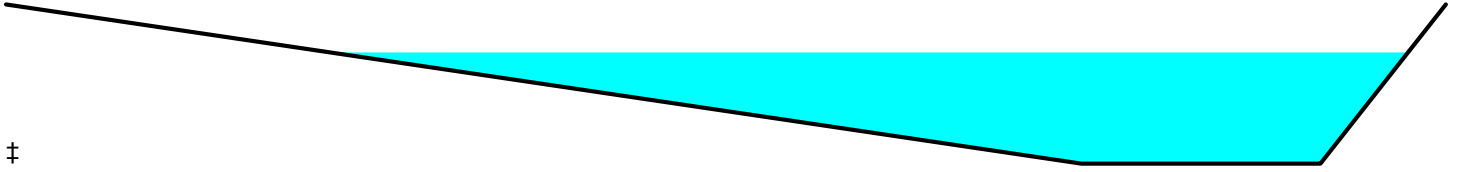**Summary for Pond 1P: depression**

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth > 5.02" for 50-year event  
Inflow = 11.88 cfs @ 12.58 hrs, Volume= 3.316 af  
Outflow = 11.88 cfs @ 12.59 hrs, Volume= 3.316 af, Atten= 0%, Lag= 0.4 min  
Primary = 11.88 cfs @ 12.59 hrs, Volume= 3.316 af  
Routed to Link SP2 : STUDY POINT #2  
Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Peak Elev= 862.69' @ 12.59 hrs Surf.Area= 483 sf Storage= 282 cf  
Flood Elev= 864.00' Surf.Area= 837 sf Storage= 1,133 cf

Plug-Flow detention time= 0.6 min calculated for 3.316 af (100% of inflow)  
Center-of-Mass det. time= 0.5 min ( 917.9 - 917.4 )

Volume	Invert	Avail.Storage	Storage Description		
#1	862.00'	1,133 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
862.00	334	74.0	0	0	334
864.00	837	119.0	1,133	1,133	1,052

Device	Routing	Invert	Outlet Devices
#1	Primary	859.00'	<b>24.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.00' / 858.73' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	862.00'	<b>24.0" Horiz. beehive</b> C= 0.600 Limited to weir flow at low heads
#3	Secondary	863.30'	<b>10.0' long x 5.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

**Primary OutFlow** Max=11.87 cfs @ 12.59 hrs HW=862.69' TW=0.00' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 11.87 cfs of 24.83 cfs potential flow)

↑ **2=beehive** (Weir Controls 11.87 cfs @ 2.72 fps)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=862.00' TW=0.00' (Dynamic Tailwater)

↑ **3=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

**Summary for Pond DB-1: detention**

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth = 4.55" for 50-year event  
Inflow = 43.80 cfs @ 12.13 hrs, Volume= 3.748 af  
Outflow = 13.60 cfs @ 12.56 hrs, Volume= 3.728 af, Atten= 69%, Lag= 25.9 min  
Primary = 13.60 cfs @ 12.56 hrs, Volume= 3.728 af  
Routed to Pond G2 : gabion  
Secondary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af  
Routed to Link SP3 : STUDY POINT #3

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 120

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 814.31' @ 12.56 hrs Surf.Area= 21,563 sf Storage= 61,154 cf  
 Flood Elev= 816.00' Surf.Area= 24,900 sf Storage= 100,504 cf

Plug-Flow detention time= 83.7 min calculated for 3.723 af (99% of inflow)  
 Center-of-Mass det. time= 81.2 min ( 890.7 - 809.6 )

Volume	Invert	Avail.Storage	Storage Description
#1	811.00'	100,504 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
811.00	15,556	576.0	0	0	15,556
812.00	17,303	594.0	16,422	16,422	17,331
813.00	19,115	613.0	18,201	34,623	19,253
814.00	20,984	632.0	20,042	54,665	21,236
815.00	22,910	651.0	21,940	76,605	23,279
816.00	24,900	670.0	23,898	100,504	25,383

Device	Routing	Invert	Outlet Devices
#1	Primary	811.00'	<b>18.0" Round Culvert</b> L= 32.0' Ke= 0.500 Inlet / Outlet Invert= 811.00' / 810.30' S= 0.0219 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf
#2	Device 1	811.00'	<b>8.0" Vert. (2) 8" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	811.90'	<b>12.0" Vert. (2) 12" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	813.20'	<b>24.0" x 24.0" Horiz. 24" Top of Structure</b> C= 0.600 Limited to weir flow at low heads
#5	Secondary	814.40'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.43 2.54 2.70 2.69 2.68 2.68 2.66 2.64 2.64 2.64 2.65 2.65 2.66 2.66 2.68 2.70 2.74

**Primary OutFlow** Max=13.60 cfs @ 12.56 hrs HW=814.30' TW=811.44' (Dynamic Tailwater)

1=Culvert (Inlet Controls 13.60 cfs @ 7.69 fps)  
 2=(2) 8" Orifice (2yr) (Passes < 5.69 cfs potential flow)  
 3=(2) 12" Orifice (10yr) (Passes < 10.43 cfs potential flow)  
 4=24" Top of Structure (Passes < 20.23 cfs potential flow)

**Secondary OutFlow** Max=0.00 cfs @ 0.00 hrs HW=811.00' TW=0.00' (Dynamic Tailwater)

5=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

**Summary for Pond dmh01: dmh**

Inflow Area = 0.382 ac, 53.49% Impervious, Inflow Depth = 5.54" for 50-year event  
 Inflow = 2.35 cfs @ 12.09 hrs, Volume= 0.176 af  
 Outflow = 2.35 cfs @ 12.09 hrs, Volume= 0.176 af, Atten= 0%, Lag= 0.0 min  
 Primary = 2.35 cfs @ 12.09 hrs, Volume= 0.176 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 852.29' @ 12.34 hrs  
 Flood Elev= 855.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	849.34'	<b>12.0" Round Culvert</b> L= 12.0' Ke= 0.500 Inlet / Outlet Invert= 849.34' / 849.22' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.09 hrs HW=851.04' TW=851.16' (Dynamic Tailwater)

1=Culvert ( Controls 0.00 cfs)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 121

**Summary for Pond dmh05: dmh**

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 4.97" for 50-year event  
 Inflow = 10.46 cfs @ 12.11 hrs, Volume= 0.703 af  
 Outflow = 10.46 cfs @ 12.11 hrs, Volume= 0.703 af, Atten= 0%, Lag= 0.0 min  
 Primary = 10.46 cfs @ 12.11 hrs, Volume= 0.703 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 872.27' @ 12.11 hrs  
 Flood Elev= 883.10'

Device	Routing	Invert	Outlet Devices
#1	Primary	868.52'	<b>15.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 868.52' / 865.12' S= 0.0351 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=10.23 cfs @ 12.11 hrs HW=872.14' TW=851.39' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 10.23 cfs @ 8.33 fps)

**Summary for Pond dmh20: dmh**

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 5.13" for 50-year event  
 Inflow = 8.78 cfs @ 12.11 hrs, Volume= 0.645 af  
 Outflow = 8.78 cfs @ 12.11 hrs, Volume= 0.645 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.78 cfs @ 12.11 hrs, Volume= 0.645 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 907.81' @ 12.14 hrs  
 Flood Elev= 907.61'

Device	Routing	Invert	Outlet Devices
#1	Primary	902.74'	<b>15.0" Round Culvert</b> L= 205.0' Ke= 0.500 Inlet / Outlet Invert= 902.74' / 900.30' S= 0.0119 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=7.49 cfs @ 12.11 hrs HW=907.17' TW=903.54' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 7.49 cfs @ 6.10 fps)

**Summary for Pond dmh21: dmh**

Inflow Area = 3.863 ac, 50.23% Impervious, Inflow Depth = 5.06" for 50-year event  
 Inflow = 23.09 cfs @ 12.11 hrs, Volume= 1.630 af  
 Outflow = 23.09 cfs @ 12.11 hrs, Volume= 1.630 af, Atten= 0%, Lag= 0.0 min  
 Primary = 23.09 cfs @ 12.11 hrs, Volume= 1.630 af  
 Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 903.84' @ 12.13 hrs  
 Flood Elev= 905.24'

Device	Routing	Invert	Outlet Devices
#1	Primary	899.55'	<b>24.0" Round Culvert</b> L= 190.0' Ke= 0.500 Inlet / Outlet Invert= 899.55' / 897.65' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=20.93 cfs @ 12.11 hrs HW=903.54' TW=900.88' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 20.93 cfs @ 6.66 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 122

**Summary for Pond dmh23: dmh**

Inflow Area = 5.551 ac, 52.10% Impervious, Inflow Depth = 5.11" for 50-year event  
 Inflow = 33.51 cfs @ 12.11 hrs, Volume= 2.364 af  
 Outflow = 33.51 cfs @ 12.11 hrs, Volume= 2.364 af, Atten= 0%, Lag= 0.0 min  
 Primary = 33.51 cfs @ 12.11 hrs, Volume= 2.364 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 902.10' @ 12.48 hrs  
 Flood Elev= 910.71'

Device	Routing	Invert	Outlet Devices
#1	Primary	897.55'	<b>30.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 897.55' / 897.20' S= 0.0130 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=32.40 cfs @ 12.11 hrs HW=900.88' TW=899.00' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 32.40 cfs @ 6.60 fps)

**Summary for Pond dmh25: dmh**

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 6.07" for 50-year event  
 Inflow = 3.92 cfs @ 12.11 hrs, Volume= 0.304 af  
 Outflow = 3.92 cfs @ 12.11 hrs, Volume= 0.304 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.92 cfs @ 12.11 hrs, Volume= 0.304 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 924.17' @ 12.11 hrs  
 Flood Elev= 930.54'

Device	Routing	Invert	Outlet Devices
#1	Primary	922.60'	<b>12.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 922.60' / 915.84' S= 0.0697 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=3.84 cfs @ 12.11 hrs HW=924.13' TW=898.97' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 3.84 cfs @ 4.89 fps)

**Summary for Pond dmh31: dmh**

Inflow Area = 0.260 ac, 40.58% Impervious, Inflow Depth = 5.43" for 50-year event  
 Inflow = 1.58 cfs @ 12.09 hrs, Volume= 0.118 af  
 Outflow = 1.58 cfs @ 12.09 hrs, Volume= 0.118 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.58 cfs @ 12.09 hrs, Volume= 0.118 af  
 Routed to Pond dmh33 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 876.44' @ 12.09 hrs  
 Flood Elev= 885.77'

Device	Routing	Invert	Outlet Devices
#1	Primary	875.76'	<b>12.0" Round Culvert</b> L= 96.0' Ke= 0.500 Inlet / Outlet Invert= 875.76' / 868.05' S= 0.0803 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.54 cfs @ 12.09 hrs HW=876.42' TW=860.73' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 1.54 cfs @ 2.78 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 123

**Summary for Pond dmh33: dmh**

Inflow Area = 0.397 ac, 48.09% Impervious, Inflow Depth = 5.62" for 50-year event  
 Inflow = 2.47 cfs @ 12.09 hrs, Volume= 0.186 af  
 Outflow = 2.47 cfs @ 12.09 hrs, Volume= 0.186 af, Atten= 0%, Lag= 0.0 min  
 Primary = 2.47 cfs @ 12.09 hrs, Volume= 0.186 af  
 Routed to Pond DS-2b : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 861.71' @ 12.56 hrs  
 Flood Elev= 864.98'

Device	Routing	Invert	Outlet Devices
#1	Primary	859.71'	<b>15.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.71' / 859.36' S= 0.0130 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.31 cfs @ 12.09 hrs HW=860.73' TW=860.72' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 0.31 cfs @ 0.39 fps)

**Summary for Pond dmh50: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 4.81" for 50-year event  
 Inflow = 8.96 cfs @ 12.11 hrs, Volume= 0.564 af  
 Outflow = 8.96 cfs @ 12.11 hrs, Volume= 0.564 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.96 cfs @ 12.11 hrs, Volume= 0.564 af  
 Routed to Pond dmh51 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 930.57' @ 12.11 hrs  
 Flood Elev= 933.94'

Device	Routing	Invert	Outlet Devices
#1	Primary	927.65'	<b>15.0" Round Culvert</b> L= 102.0' Ke= 0.500 Inlet / Outlet Invert= 927.65' / 919.50' S= 0.0799 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=8.77 cfs @ 12.11 hrs HW=930.48' TW=922.23' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 8.77 cfs @ 7.15 fps)

**Summary for Pond dmh51: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 4.81" for 50-year event  
 Inflow = 8.96 cfs @ 12.11 hrs, Volume= 0.564 af  
 Outflow = 8.96 cfs @ 12.11 hrs, Volume= 0.564 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.96 cfs @ 12.11 hrs, Volume= 0.564 af  
 Routed to Pond dmh52 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 922.32' @ 12.11 hrs  
 Flood Elev= 924.04'

Device	Routing	Invert	Outlet Devices
#1	Primary	919.40'	<b>15.0" Round Culvert</b> L= 127.0' Ke= 0.500 Inlet / Outlet Invert= 919.40' / 909.50' S= 0.0780 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=8.77 cfs @ 12.11 hrs HW=922.23' TW=895.35' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 8.77 cfs @ 7.15 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 124

**Summary for Pond dmh52: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 4.81" for 50-year event  
 Inflow = 8.96 cfs @ 12.11 hrs, Volume= 0.564 af  
 Outflow = 8.96 cfs @ 12.11 hrs, Volume= 0.564 af, Atten= 0%, Lag= 0.0 min  
 Primary = 8.96 cfs @ 12.11 hrs, Volume= 0.564 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 895.44' @ 12.11 hrs  
 Flood Elev= 914.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.52'	<b>15.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 892.52' / 887.55' S= 0.0802 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=8.77 cfs @ 12.11 hrs HW=895.35' TW=889.38' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 8.77 cfs @ 7.15 fps)

**Summary for Pond dmh53: dmh**

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 5.43" for 50-year event  
 Inflow = 9.06 cfs @ 12.11 hrs, Volume= 0.641 af  
 Outflow = 9.06 cfs @ 12.11 hrs, Volume= 0.641 af, Atten= 0%, Lag= 0.0 min  
 Primary = 9.06 cfs @ 12.11 hrs, Volume= 0.641 af  
 Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 918.50' @ 12.11 hrs  
 Flood Elev= 921.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	916.46'	<b>18.0" Round Culvert</b> L= 31.0' Ke= 0.500 Inlet / Outlet Invert= 916.46' / 916.16' S= 0.0097 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=8.88 cfs @ 12.11 hrs HW=918.44' TW=907.97' (Dynamic Tailwater)  
**1=Culvert** (Barrel Controls 8.88 cfs @ 5.03 fps)

**Summary for Pond dmh55: dmh**

Inflow Area = 3.074 ac, 74.77% Impervious, Inflow Depth = 5.39" for 50-year event  
 Inflow = 19.84 cfs @ 12.11 hrs, Volume= 1.382 af  
 Outflow = 19.84 cfs @ 12.11 hrs, Volume= 1.382 af, Atten= 0%, Lag= 0.0 min  
 Primary = 19.84 cfs @ 12.11 hrs, Volume= 1.382 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 908.04' @ 12.11 hrs  
 Flood Elev= 911.86'

Device	Routing	Invert	Outlet Devices
#1	Primary	905.32'	<b>24.0" Round Culvert</b> L= 72.0' Ke= 0.500 Inlet / Outlet Invert= 905.32' / 903.80' S= 0.0211 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=19.43 cfs @ 12.11 hrs HW=907.97' TW=905.59' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 19.43 cfs @ 6.19 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 125

**Summary for Pond dmh56: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 5.44" for 50-year event  
 Inflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Outflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af, Atten= 0%, Lag= 0.0 min  
 Primary = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Routed to Pond dmh57 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 905.95' @ 12.14 hrs  
 Flood Elev= 908.47'

Device	Routing	Invert	Outlet Devices
#1	Primary	901.21'	<b>24.0" Round Culvert</b> L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 901.21' / 901.02' S= 0.0095 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=19.06 cfs @ 12.11 hrs HW=905.59' TW=904.00' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 19.06 cfs @ 6.07 fps)

**Summary for Pond dmh57: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 5.44" for 50-year event  
 Inflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Outflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af, Atten= 0%, Lag= 0.0 min  
 Primary = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Routed to Pond dmh58 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 904.09' @ 12.11 hrs  
 Flood Elev= 908.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	900.92'	<b>24.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 900.92' / 896.30' S= 0.0476 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=21.83 cfs @ 12.11 hrs HW=904.00' TW=898.31' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 21.83 cfs @ 6.95 fps)

**Summary for Pond dmh58: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 5.44" for 50-year event  
 Inflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Outflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af, Atten= 0%, Lag= 0.0 min  
 Primary = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Routed to Pond dmh59 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 898.34' @ 12.11 hrs  
 Flood Elev= 901.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	896.20'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 896.20' / 893.43' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=21.83 cfs @ 12.11 hrs HW=898.31' TW=895.58' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 21.83 cfs @ 4.94 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 126

**Summary for Pond dmh59: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 5.44" for 50-year event  
 Inflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Outflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af, Atten= 0%, Lag= 0.0 min  
 Primary = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Routed to Pond dmh60 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 895.63' @ 12.13 hrs  
 Flood Elev= 909.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	893.33'	<b>30.0" Round Culvert</b> L= 82.0' Ke= 0.500 Inlet / Outlet Invert= 893.33' / 892.50' S= 0.0101 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=20.11 cfs @ 12.11 hrs HW=895.58' TW=894.51' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 20.11 cfs @ 5.71 fps)

**Summary for Pond dmh60: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 5.44" for 50-year event  
 Inflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Outflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af, Atten= 0%, Lag= 0.0 min  
 Primary = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Routed to Pond dmh61 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 894.54' @ 12.11 hrs  
 Flood Elev= 901.96'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.40'	<b>30.0" Round Culvert</b> L= 258.0' Ke= 0.500 Inlet / Outlet Invert= 892.40' / 889.43' S= 0.0115 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=21.83 cfs @ 12.11 hrs HW=894.51' TW=891.47' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 21.83 cfs @ 4.94 fps)

**Summary for Pond dmh61: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 5.44" for 50-year event  
 Inflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Outflow = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af, Atten= 0%, Lag= 0.0 min  
 Primary = 22.29 cfs @ 12.11 hrs, Volume= 1.565 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 891.53' @ 12.13 hrs  
 Flood Elev= 898.16'

Device	Routing	Invert	Outlet Devices
#1	Primary	889.33'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 889.33' / 886.55' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=20.25 cfs @ 12.11 hrs HW=891.47' TW=889.38' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 20.25 cfs @ 6.08 fps)



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 127

**Summary for Pond dmh62: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 5.26" for 50-year event  
 Inflow = 31.25 cfs @ 12.11 hrs, Volume= 2.129 af  
 Outflow = 31.25 cfs @ 12.11 hrs, Volume= 2.129 af, Atten= 0%, Lag= 0.0 min  
 Primary = 31.25 cfs @ 12.11 hrs, Volume= 2.129 af  
 Routed to Pond dmh69 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 889.45' @ 12.11 hrs  
 Flood Elev= 902.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	886.45'	<b>30.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 886.45' / 884.91' S= 0.0248 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=30.60 cfs @ 12.11 hrs HW=889.38' TW=815.41' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 30.60 cfs @ 6.23 fps)

**Summary for Pond dmh69: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 5.26" for 50-year event  
 Inflow = 31.25 cfs @ 12.11 hrs, Volume= 2.129 af  
 Outflow = 31.25 cfs @ 12.11 hrs, Volume= 2.129 af, Atten= 0%, Lag= 0.0 min  
 Primary = 31.25 cfs @ 12.11 hrs, Volume= 2.129 af  
 Routed to Pond DB-1 : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 815.48' @ 12.11 hrs  
 Flood Elev= 818.02'

Device	Routing	Invert	Outlet Devices
#1	Primary	812.48'	<b>30.0" Round Culvert</b> L= 29.0' Ke= 0.500 Inlet / Outlet Invert= 812.48' / 811.50' S= 0.0338 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=30.60 cfs @ 12.11 hrs HW=815.41' TW=813.07' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 30.60 cfs @ 6.23 fps)

**Summary for Pond DS-1a: detention**

Inflow Area = 2.795 ac, 46.49% Impervious, Inflow Depth = 4.96" for 50-year event  
 Inflow = 16.51 cfs @ 12.10 hrs, Volume= 1.156 af  
 Outflow = 7.60 cfs @ 12.30 hrs, Volume= 1.156 af, Atten= 54%, Lag= 11.9 min  
 Primary = 7.60 cfs @ 12.30 hrs, Volume= 1.156 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 852.24' @ 12.30 hrs Surf.Area= 4,480 sf Storage= 16,936 cf  
 Flood Elev= 853.00' Surf.Area= 4,505 sf Storage= 19,995 cf

Plug-Flow detention time= 84.3 min calculated for 1.155 af (100% of inflow)  
 Center-of-Mass det. time= 84.4 min ( 884.9 - 800.5 )

Volume	Invert	Avail. Storage	Storage Description
#1A	848.00'	0 cf	<b>112.00'W x 40.00'L x 5.67'H Field A</b> 25,387 cf Overall - 25,387 cf Embedded = 0 cf
#2A	848.00'	19,995 cf	<b>retain_it retain_it 5.0' x 70</b> Inside #1 Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 14 Rows adjusted for 394.8 cf perimeter wall
#3	853.00'	56 cf	<b>4.00'D x 4.45'H CB-9</b>
#4	853.00'	38 cf	<b>4.00'D x 3.00'H CB-8</b>
		20,088 cf	Total Available Storage

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 128

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	847.90'	<b>15.0" Round Culvert</b> L= 129.0' Ke= 0.500 Inlet / Outlet Invert= 847.90' / 846.36' S= 0.0119 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	847.90'	<b>3.0" Vert. 3" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	849.50'	<b>7.0" Vert. 7" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	851.30'	<b>6.0" Vert. 6" Orifice (25yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	851.90'	<b>8.0" Vert. 8" Orifice (50yr) X 3.00</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	852.80'	<b>4.0' long Overflow Weir</b> 2 End Contraction(s) 4.0' Crest Height

**Primary OutFlow** Max=7.59 cfs @ 12.30 hrs HW=852.23' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 7.59 cfs of 9.97 cfs potential flow)
- 2=3" Orifice (2yr) (Orifice Controls 0.97 cfs @ 9.88 fps)
- 3=7" Orifice (10yr) (Orifice Controls 4.02 cfs @ 7.53 fps)
- 4=6" Orifice (25yr) (Orifice Controls 1.56 cfs @ 3.98 fps)
- 5=8" Orifice (50yr) (Orifice Controls 1.04 cfs @ 1.97 fps)
- 6=Overflow Weir ( Controls 0.00 cfs)

**Summary for Pond DS-1b: detention**

Inflow Area = 0.571 ac, 23.27% Impervious, Inflow Depth = 4.75" for 50-year event  
 Inflow = 2.89 cfs @ 12.12 hrs, Volume= 0.226 af  
 Outflow = 0.65 cfs @ 12.56 hrs, Volume= 0.226 af, Atten= 77%, Lag= 26.5 min  
 Primary = 0.65 cfs @ 12.56 hrs, Volume= 0.226 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 861.78' @ 12.56 hrs Surf.Area= 1,536 sf Storage= 3,453 cf  
 Flood Elev= 862.70' Surf.Area= 1,536 sf Storage= 4,684 cf

Plug-Flow detention time= 67.5 min calculated for 0.226 af (100% of inflow)  
 Center-of-Mass det. time= 66.5 min ( 879.6 - 813.1 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.20'	0 cf	<b>64.00'W x 24.00'L x 4.17'H Field A</b> 6,400 cf Overall - 6,400 cf Embedded = 0 cf x 40.0% Voids
#2A	859.20'	4,684 cf	<b>retain_it retain_it 3.5' x 24</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 8 Rows adjusted for 135.1 cf perimeter wall
		4,684 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	859.20'	<b>12.0" Round Culvert</b> L= 100.0' Ke= 0.500 Inlet / Outlet Invert= 859.20' / 858.10' S= 0.0110 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>4.0" Vert. 4" Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>12.0" Vert. Overflow</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.65 cfs @ 12.56 hrs HW=861.78' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 0.65 cfs of 4.79 cfs potential flow)
- 2=4" Orifice (Orifice Controls 0.65 cfs @ 7.48 fps)
- 3=Overflow ( Controls 0.00 cfs)

**Summary for Pond DS-2a: detention**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth = 5.20" for 50-year event  
 Inflow = 37.43 cfs @ 12.11 hrs, Volume= 2.668 af  
 Outflow = 10.53 cfs @ 12.47 hrs, Volume= 2.666 af, Atten= 72%, Lag= 21.5 min  
 Primary = 10.53 cfs @ 12.47 hrs, Volume= 2.666 af  
 Routed to Pond G1 : gabion

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 129

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 901.98' @ 12.47 hrs Surf.Area= 4,704 sf Storage= 48,009 cf  
 Flood Elev= 902.66' Storage= 48,125 cf

Plug-Flow detention time= 107.6 min calculated for 2.662 af (100% of inflow)  
 Center-of-Mass det. time= 107.5 min ( 904.6 - 797.1 )

Volume	Invert	Avail.Storage	Storage Description
#1	892.00'	24,073 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 7 Rows adjusted for 394.8 cf perimeter wall
#2	897.00'	24,052 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 6 Rows adjusted for 415.6 cf perimeter wall
		48,125 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	892.00'	<b>24.0" Round Culvert</b> L= 46.0' Ke= 0.500 Inlet / Outlet Invert= 892.00' / 890.52' S= 0.0322 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	892.00'	<b>4.0" Vert. Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	895.40'	<b>8.0" Vert. Orifice (10yr)</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	898.20'	<b>8.0" Vert. Orifice (25yr)</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	899.90'	<b>4.0" Vert. Orifice (50yr)</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	902.00'	<b>4.0' long Sharp-Crested Weir Overflow (100yr)</b> 2 End Contraction(s)

**Primary OutFlow** Max=10.52 cfs @ 12.47 hrs HW=901.97' TW=878.14' (Dynamic Tailwater)

- 1=Culvert (Passes 10.52 cfs of 45.30 cfs potential flow)
- 2=Orifice (2yr) (Orifice Controls 2.63 cfs @ 15.07 fps)
- 3=Orifice (10yr) (Orifice Controls 4.20 cfs @ 12.02 fps)
- 4=Orifice (25yr) (Orifice Controls 3.11 cfs @ 8.92 fps)
- 5=Orifice (50yr) (Orifice Controls 0.58 cfs @ 6.64 fps)
- 6=Sharp-Crested Weir Overflow (100yr) (Controls 0.00 cfs)

**Summary for Pond DS-2b: detention**

Inflow Area = 2.217 ac, 10.77% Impervious, Inflow Depth = 4.37" for 50-year event  
 Inflow = 11.01 cfs @ 12.09 hrs, Volume= 0.807 af  
 Outflow = 2.48 cfs @ 12.51 hrs, Volume= 0.781 af, Atten= 77%, Lag= 25.3 min  
 Primary = 2.48 cfs @ 12.51 hrs, Volume= 0.781 af  
 Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 861.71' @ 12.51 hrs Surf.Area= 5,632 sf Storage= 13,500 cf  
 Flood Elev= 862.70' Surf.Area= 5,645 sf Storage= 17,438 cf

Plug-Flow detention time= 102.2 min calculated for 0.781 af (97% of inflow)  
 Center-of-Mass det. time= 83.8 min ( 900.1 - 816.3 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.00'	0 cf	<b>88.00'W x 64.00'L x 4.17'H Field A</b> 23,467 cf Overall - 23,467 cf Embedded = 0 cf x 40.0% Voids
#2A	859.00'	17,435 cf	<b>retain_it retain_it 3.5' x 88</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 11 Rows adjusted for 233.3 cf perimeter wall
#3	862.50'	9 cf	<b>4.00'D x 0.70'H Vertical Cone/Cylinder</b>
		17,444 cf	Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 130

Device	Routing	Invert	Outlet Devices
#1	Primary	858.90'	<b>12.0" Round Culvert</b> L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 858.90' / 858.44' S= 0.0153 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>8.0" Vert. Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>4.0' long Sharp-Crested Rectangular Weir</b> 2 End Contraction(s) 0.5' Crest Height
#4	Device 1	863.20'	<b>24.0" x 24.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=2.48 cfs @ 12.51 hrs HW=861.71' TW=0.00' (Dynamic Tailwater)

1=Culvert (Passes 2.48 cfs of 5.75 cfs potential flow)

2=Orifice (Orifice Controls 2.48 cfs @ 7.10 fps)

3=Sharp-Crested Rectangular Weir (Controls 0.00 cfs)

4=Orifice/Grate (Controls 0.00 cfs)

**Summary for Pond DW-1: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 5.89" for 50-year event  
 Inflow = 10.92 cfs @ 12.09 hrs, Volume= 0.832 af  
 Outflow = 10.50 cfs @ 12.11 hrs, Volume= 0.806 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 10.30 hrs, Volume= 0.102 af  
 Primary = 10.46 cfs @ 12.11 hrs, Volume= 0.703 af  
 Routed to Pond dmh05 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 10.30 hrs Surf.Area= 0.031 ac Storage= 0.063 af

Plug-Flow detention time= 84.7 min calculated for 0.805 af (97% of inflow)

Center-of-Mass det. time= 66.6 min ( 851.6 - 785.0 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 14.00 = 0.063 af Total Available Storage			

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 10.30 hrs HW=3.50' (Free Discharge)

1=Exfiltration (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=872.14' (Dynamic Tailwater)

2=Culvert (Controls 0.00 cfs)

**Summary for Pond DW-10: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 131

Inflow Area = 3.168 ac, 18.24% Impervious, Inflow Depth = 4.41" for 50-year event  
 Inflow = 12.85 cfs @ 12.19 hrs, Volume= 1.166 af  
 Outflow = 12.68 cfs @ 12.21 hrs, Volume= 1.155 af, Atten= 1%, Lag= 1.6 min  
 Discarded = 0.02 cfs @ 10.10 hrs, Volume= 0.041 af  
 Primary = 0.19 cfs @ 10.10 hrs, Volume= 0.217 af  
 Routed to Link SP1 : STUDY POINT #1  
 Secondary = 12.47 cfs @ 12.21 hrs, Volume= 0.897 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Primary area = Inflow area x 0.142

Peak Elev= 3.50' @ 10.10 hrs Surf.Area= 0.013 ac Storage= 0.027 af

Plug-Flow detention time= 26.3 min calculated for 1.155 af (99% of inflow)

Center-of-Mass det. time= 20.5 min ( 845.2 - 824.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 6.00 = 0.027 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Secondary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	3.00'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 3.00' / 3.00' S= 0.0000 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.02 cfs @ 10.10 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.02 cfs)**Primary OutFlow** Max=0.19 cfs @ 10.10 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)↑**2=Culvert** (Barrel Controls 0.19 cfs @ 2.14 fps)**Secondary OutFlow** Max=0.00 cfs @ 12.21 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)**Summary for Pond DW-2: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.375 ac, 77.23% Impervious, Inflow Depth = 6.47" for 50-year event  
 Inflow = 2.55 cfs @ 12.09 hrs, Volume= 0.202 af  
 Outflow = 2.46 cfs @ 12.11 hrs, Volume= 0.199 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 8.30 hrs, Volume= 0.016 af  
 Primary = 2.45 cfs @ 12.11 hrs, Volume= 0.183 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 8.30 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 56.9 min calculated for 0.199 af (98% of inflow)

Center-of-Mass det. time= 44.9 min ( 812.6 - 767.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 132

0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 8.30 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=905.59' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-3: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.657 ac, 78.20% Impervious, Inflow Depth = 6.47" for 50-year event  
 Inflow = 11.25 cfs @ 12.09 hrs, Volume= 0.893 af  
 Outflow = 10.84 cfs @ 12.11 hrs, Volume= 0.862 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 9.75 hrs, Volume= 0.122 af  
 Primary = 10.78 cfs @ 12.11 hrs, Volume= 0.741 af  
 Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 9.75 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 95.5 min calculated for 0.862 af (97% of inflow)  
 Center-of-Mass det. time= 74.9 min ( 842.6 - 767.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 9.75 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=907.97' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-4: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 133

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 6.23" for 50-year event  
 Inflow = 9.44 cfs @ 12.09 hrs, Volume= 0.736 af  
 Outflow = 9.09 cfs @ 12.11 hrs, Volume= 0.717 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.03 cfs @ 9.40 hrs, Volume= 0.076 af  
 Primary = 9.06 cfs @ 12.11 hrs, Volume= 0.641 af  
 Routed to Pond dmh53 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 9.40 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 72.2 min calculated for 0.716 af (97% of inflow)  
 Center-of-Mass det. time= 57.3 min ( 832.5 - 775.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 10.00 = 0.045 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 9.40 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.03 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=918.44' (Dynamic Tailwater)↑**2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-5: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 5.43" for 50-year event  
 Inflow = 9.14 cfs @ 12.09 hrs, Volume= 0.682 af  
 Outflow = 8.79 cfs @ 12.11 hrs, Volume= 0.674 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 9.00 hrs, Volume= 0.029 af  
 Primary = 8.78 cfs @ 12.11 hrs, Volume= 0.645 af  
 Routed to Pond dmh20 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 9.00 hrs Surf.Area= 0.009 ac Storage= 0.018 af

Plug-Flow detention time= 32.3 min calculated for 0.674 af (99% of inflow)  
 Center-of-Mass det. time= 25.3 min ( 821.6 - 796.3 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 4.00 = 0.018 af Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 134

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 9.00 hrs HW=3.50' (Free Discharge)↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=907.17' (Dynamic Tailwater)↑ **2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-6: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area =	1.406 ac, 72.39% Impervious, Inflow Depth = 6.23" for 50-year event
Inflow =	9.37 cfs @ 12.09 hrs, Volume= 0.730 af
Outflow =	9.02 cfs @ 12.11 hrs, Volume= 0.696 af, Atten= 4%, Lag= 1.4 min
Discarded =	0.06 cfs @ 10.75 hrs, Volume= 0.132 af
Primary =	8.96 cfs @ 12.11 hrs, Volume= 0.564 af
Routed to Pond dmh50 : dmh	

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 10.75 hrs Surf.Area= 0.040 ac Storage= 0.081 af

Plug-Flow detention time= 122.0 min calculated for 0.695 af (95% of inflow)

Center-of-Mass det. time= 96.1 min ( 871.3 - 775.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 18.00 = 0.081 af Total Available Storage			

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.06 cfs @ 10.75 hrs HW=3.50' (Free Discharge)↑ **1=Exfiltration** (Exfiltration Controls 0.06 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=930.48' (Dynamic Tailwater)↑ **2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-7: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 135

Inflow Area = 2.354 ac, 54.62% Impervious, Inflow Depth = 5.77" for 50-year event  
 Inflow = 14.94 cfs @ 12.09 hrs, Volume= 1.132 af  
 Outflow = 14.37 cfs @ 12.11 hrs, Volume= 1.101 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 10.05 hrs, Volume= 0.117 af  
 Primary = 14.32 cfs @ 12.11 hrs, Volume= 0.985 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 10.05 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 71.8 min calculated for 1.100 af (97% of inflow)  
 Center-of-Mass det. time= 56.5 min ( 844.5 - 788.0 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 10.05 hrs HW=3.50' (Free Discharge)  
 ↑**1=Exfiltration** (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=903.54' (Dynamic Tailwater)  
 ↑**2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-8: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.  
 Storage multiplier added to account for number of dwelling units with subcatchment.  
 Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 6.47" for 50-year event  
 Inflow = 4.08 cfs @ 12.09 hrs, Volume= 0.324 af  
 Outflow = 3.93 cfs @ 12.11 hrs, Volume= 0.320 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 7.15 hrs, Volume= 0.016 af  
 Primary = 3.92 cfs @ 12.11 hrs, Volume= 0.304 af  
 Routed to Pond dmh25 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 7.15 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 36.7 min calculated for 0.319 af (99% of inflow)  
 Center-of-Mass det. time= 30.0 min ( 797.7 - 767.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 136

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 7.15 hrs HW=3.50' (Free Discharge)↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=924.13' (Dynamic Tailwater)↑ **2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-9: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.688 ac, 56.40% Impervious, Inflow Depth = 5.89" for 50-year event  
Inflow = 10.85 cfs @ 12.09 hrs, Volume= 0.828 af  
Outflow = 10.45 cfs @ 12.11 hrs, Volume= 0.809 af, Atten= 4%, Lag= 1.4 min  
Discarded = 0.03 cfs @ 9.60 hrs, Volume= 0.074 af  
Primary = 10.41 cfs @ 12.11 hrs, Volume= 0.735 af  
Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 9.60 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 62.9 min calculated for 0.808 af (98% of inflow)

Center-of-Mass det. time= 49.8 min ( 834.8 - 785.0 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 10.00 = 0.045 af			Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 9.60 hrs HW=3.50' (Free Discharge)↑ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=900.88' (Dynamic Tailwater)↑ **2=Culvert** ( Controls 0.00 cfs)**Summary for Pond G1: gabion**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth > 5.20" for 50-year event  
Inflow = 10.53 cfs @ 12.47 hrs, Volume= 2.666 af  
Outflow = 10.53 cfs @ 12.48 hrs, Volume= 2.666 af, Atten= 0%, Lag= 0.8 min  
Primary = 10.53 cfs @ 12.48 hrs, Volume= 2.666 af  
Routed to Reach R-02 : Routing through wetland/swale

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 137

Peak Elev= 878.14' @ 12.48 hrs Surf.Area= 371 sf Storage= 181 cf  
 Flood Elev= 880.00' Surf.Area= 2 sf Storage= 444 cf

Plug-Flow detention time= 0.1 min calculated for 2.662 af (100% of inflow)  
 Center-of-Mass det. time= 0.1 min ( 904.7 - 904.6 )

Volume	Invert	Avail.Storage	Storage Description
#1	877.50'	442 cf	<b>18.0" Round Pipe Storage</b> L= 250.0'
#2	879.00'	2 cf	<b>1.50'D x 1.00'H Vertical Cone/Cylinder</b>
		444 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	877.50'	<b>2.0" Horiz. invert orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	878.25'	<b>2.0" Vert. spring line orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	880.00'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=10.52 cfs @ 12.48 hrs HW=878.14' TW=876.74' (Dynamic Tailwater)

1=invert orifices (Orifice Controls 10.52 cfs @ 3.86 fps)

2=spring line orifices ( Controls 0.00 cfs)

3=overflow grates ( Controls 0.00 cfs)

### Summary for Pond G2: gabion

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth > 4.53" for 50-year event  
 Inflow = 13.60 cfs @ 12.56 hrs, Volume= 3.728 af  
 Outflow = 13.61 cfs @ 12.59 hrs, Volume= 3.728 af, Atten= 0%, Lag= 1.5 min  
 Primary = 13.61 cfs @ 12.59 hrs, Volume= 3.728 af  
 Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 811.44' @ 12.59 hrs Surf.Area= 103 sf Storage= 115 cf  
 Flood Elev= 811.80' Storage= 141 cf

Plug-Flow detention time= 0.1 min calculated for 3.728 af (100% of inflow)  
 Center-of-Mass det. time= 0.1 min ( 890.8 - 890.7 )

Volume	Invert	Avail.Storage	Storage Description
#1	810.30'	141 cf	<b>18.0" Round Pipe Storage</b> L= 80.0'

Device	Routing	Invert	Outlet Devices
#1	Primary	810.30'	<b>2.0" Horiz. invert orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	811.05'	<b>2.0" Vert. spring line orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	811.80'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=13.60 cfs @ 12.59 hrs HW=811.44' TW=0.00' (Dynamic Tailwater)

1=invert orifices (Orifice Controls 8.96 cfs @ 5.14 fps)

2=spring line orifices (Orifice Controls 4.64 cfs @ 2.66 fps)

3=overflow grates ( Controls 0.00 cfs)

### Summary for Link SP1: STUDY POINT #1

Inflow Area = 6.871 ac, 30.28% Impervious, Inflow Depth = 4.58" for 50-year event  
 Inflow = 21.09 cfs @ 12.23 hrs, Volume= 2.620 af  
 Primary = 21.09 cfs @ 12.23 hrs, Volume= 2.620 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP2: STUDY POINT #2

Inflow Area = 10.269 ac, 37.04% Impervious, Inflow Depth > 4.85" for 50-year event  
 Inflow = 14.47 cfs @ 12.57 hrs, Volume= 4.148 af  
 Primary = 14.47 cfs @ 12.57 hrs, Volume= 4.148 af, Atten= 0%, Lag= 0.0 min

## 2889-01 - Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 50-year Rainfall=7.30"

Printed 12/14/2021

Page 138

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP3: STUDY POINT #3

Inflow Area = 11.229 ac, 32.11% Impervious, Inflow Depth > 4.48" for 50-year event  
Inflow = 16.13 cfs @ 12.49 hrs, Volume= 4.188 af  
Primary = 16.13 cfs @ 12.49 hrs, Volume= 4.188 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP4: STUDY POINT #4

Inflow Area = 0.658 ac, 9.82% Impervious, Inflow Depth = 4.41" for 50-year event  
Inflow = 3.33 cfs @ 12.09 hrs, Volume= 0.242 af  
Primary = 3.33 cfs @ 12.09 hrs, Volume= 0.242 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP5: STUDY POINT #5

Inflow Area = 0.158 ac, 0.00% Impervious, Inflow Depth = 4.20" for 50-year event  
Inflow = 0.76 cfs @ 12.09 hrs, Volume= 0.055 af  
Primary = 0.76 cfs @ 12.09 hrs, Volume= 0.055 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 139

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points  
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN  
 Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

<b>SubcatchmentP-1A: Subcat P-1A</b>	Runoff Area=3.168 ac 18.24% Impervious Runoff Depth=5.70" Flow Length=782' Tc=13.3 min CN=75 Runoff=16.51 cfs 1.504 af
<b>SubcatchmentP-1B: Subcat P-1B</b>	Runoff Area=24,871 sf 23.27% Impervious Runoff Depth=6.06" Flow Length=315' Tc=8.2 min CN=78 Runoff=3.66 cfs 0.288 af
<b>SubcatchmentP-1C: Subcat P-1C</b>	Runoff Area=0.337 ac 20.77% Impervious Runoff Depth=5.70" Tc=6.0 min CN=75 Runoff=2.19 cfs 0.160 af
<b>SubcatchmentP-1D: Subcat P-1D</b>	Runoff Area=31,162 sf 19.39% Impervious Runoff Depth=5.94" Tc=6.0 min CN=77 Runoff=4.82 cfs 0.354 af
<b>SubcatchmentP-1E: Subcat P-1E</b>	Runoff Area=0.382 ac 53.49% Impervious Runoff Depth=6.91" Tc=6.0 min CN=85 Runoff=2.90 cfs 0.220 af
<b>SubcatchmentP-1F: Subcat P-1F</b>	Runoff Area=1.697 ac 56.34% Impervious Runoff Depth=7.27" Tc=6.0 min CN=88 Runoff=13.33 cfs 1.029 af
<b>SubcatchmentP-2A: Subcat P-2A</b>	Runoff Area=1.773 ac 10.14% Impervious Runoff Depth=5.70" Tc=6.0 min CN=75 Runoff=11.51 cfs 0.842 af
<b>SubcatchmentP-2B: Subcat P-2B</b>	Runoff Area=1.201 ac 0.00% Impervious Runoff Depth=5.09" Tc=6.0 min CN=70 Runoff=7.02 cfs 0.509 af
<b>SubcatchmentP-2C: Subcat P-2C</b>	Runoff Area=0.137 ac 62.40% Impervious Runoff Depth=7.39" Tc=6.0 min CN=89 Runoff=1.08 cfs 0.084 af
<b>SubcatchmentP-2D: Subcat P-2D</b>	Runoff Area=0.260 ac 40.58% Impervious Runoff Depth=6.79" Tc=6.0 min CN=84 Runoff=1.95 cfs 0.147 af
<b>SubcatchmentP-2E: Subcat P-2E</b>	Runoff Area=2.354 ac 54.62% Impervious Runoff Depth=7.15" Tc=6.0 min CN=87 Runoff=18.29 cfs 1.403 af
<b>SubcatchmentP-2F: Subcat P-2F</b>	Runoff Area=1.509 ac 43.37% Impervious Runoff Depth=6.79" Tc=6.0 min CN=84 Runoff=11.31 cfs 0.853 af
<b>SubcatchmentP-2G: Subcat P-2G</b>	Runoff Area=1.688 ac 56.40% Impervious Runoff Depth=7.27" Tc=6.0 min CN=88 Runoff=13.25 cfs 1.023 af
<b>SubcatchmentP-2H: Subcat P-2H</b>	Runoff Area=0.601 ac 77.35% Impervious Runoff Depth=7.88" Tc=6.0 min CN=93 Runoff=4.92 cfs 0.394 af
<b>SubcatchmentP-2I: Subcat P-2I</b>	Runoff Area=0.127 ac 22.66% Impervious Runoff Depth=6.18" Tc=6.0 min CN=79 Runoff=0.89 cfs 0.066 af
<b>SubcatchmentP-2J: Subcat P-2J</b>	Runoff Area=0.619 ac 7.73% Impervious Runoff Depth=5.82" Tc=6.0 min CN=76 Runoff=4.09 cfs 0.300 af
<b>SubcatchmentP-3A: Subcat P-3A</b>	Runoff Area=5.023 ac 0.00% Impervious Runoff Depth=5.09" Flow Length=644' Tc=16.1 min CN=70 Runoff=22.00 cfs 2.130 af
<b>SubcatchmentP-3B: Subcat P-3B</b>	Runoff Area=1.351 ac 0.01% Impervious Runoff Depth=5.33" Tc=6.0 min CN=72 Runoff=8.25 cfs 0.600 af
<b>SubcatchmentP-3C: Subcat P-3C</b>	Runoff Area=0.375 ac 77.23% Impervious Runoff Depth=7.88" Tc=6.0 min CN=93 Runoff=3.07 cfs 0.246 af
<b>SubcatchmentP-3D: Subcat P-3D</b>	Runoff Area=1.657 ac 78.20% Impervious Runoff Depth=7.88" Tc=6.0 min CN=93 Runoff=13.56 cfs 1.087 af
<b>SubcatchmentP-3E: Subcat P-3E</b>	Runoff Area=1.417 ac 70.76% Impervious Runoff Depth=7.64" Tc=6.0 min CN=91 Runoff=11.43 cfs 0.902 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 140

**Subcatchment P-3F: Subcat P-3F**

Runoff Area=1.406 ac 72.39% Impervious Runoff Depth=7.64"  
Tc=6.0 min CN=91 Runoff=11.34 cfs 0.895 af

**Subcatchment P-4: Subcat P-4**

Runoff Area=28,663 sf 9.82% Impervious Runoff Depth=5.70"  
Tc=6.0 min CN=75 Runoff=4.27 cfs 0.312 af

**Subcatchment P-5: Subcat P-5**

Runoff Area=6,874 sf 0.00% Impervious Runoff Depth=5.45"  
Tc=6.0 min CN=73 Runoff=0.98 cfs 0.072 af

**Reach R-01: Routing to wetlands**

Avg. Flow Depth=0.38' Max Vel=0.43 fps Inflow=8.25 cfs 0.600 af  
n=0.400 L=722.0' S=0.1087 ' Capacity=43.77 cfs Outflow=3.86 cfs 0.600 af

**Reach R-02: Routing through wetland/swale**

Avg. Flow Depth=1.37' Max Vel=0.48 fps Inflow=58.90 cfs 4.209 af  
n=0.400 L=525.0' S=0.0223 ' Capacity=26.65 cfs Outflow=21.70 cfs 4.208 af

**Pond 1P: depression**

Peak Elev=863.55' Storage=788 cf Inflow=21.70 cfs 4.208 af  
Primary=18.84 cfs 4.150 af Secondary=3.01 cfs 0.058 af Outflow=21.85 cfs 4.207 af

**Pond DB-1: detention**

Peak Elev=814.90' Storage=74,238 cf Inflow=54.64 cfs 4.819 af  
Primary=15.09 cfs 4.571 af Secondary=7.32 cfs 0.228 af Outflow=22.41 cfs 4.799 af

**Pond dmh01: dmh**

Peak Elev=852.98' Inflow=2.90 cfs 0.220 af  
12.0" Round Culvert n=0.013 L=12.0' S=0.0100 ' Outflow=2.90 cfs 0.220 af

**Pond dmh05: dmh**

Peak Elev=873.81' Inflow=12.78 cfs 0.897 af  
15.0" Round Culvert n=0.013 L=97.0' S=0.0351 ' Outflow=12.78 cfs 0.897 af

**Pond dmh20: dmh**

Peak Elev=912.36' Inflow=10.87 cfs 0.816 af  
15.0" Round Culvert n=0.013 L=205.0' S=0.0119 ' Outflow=10.87 cfs 0.816 af

**Pond dmh21: dmh**

Peak Elev=908.13' Inflow=28.42 cfs 2.068 af  
24.0" Round Culvert n=0.013 L=190.0' S=0.0100 ' Outflow=28.42 cfs 2.068 af

**Pond dmh23: dmh**

Peak Elev=907.06' Inflow=41.14 cfs 2.996 af  
30.0" Round Culvert n=0.013 L=27.0' S=0.0130 ' Outflow=41.14 cfs 2.996 af

**Pond dmh25: dmh**

Peak Elev=924.66' Inflow=4.73 cfs 0.374 af  
12.0" Round Culvert n=0.013 L=97.0' S=0.0697 ' Outflow=4.73 cfs 0.374 af

**Pond dmh31: dmh**

Peak Elev=876.53' Inflow=1.95 cfs 0.147 af  
12.0" Round Culvert n=0.013 L=96.0' S=0.0803 ' Outflow=1.95 cfs 0.147 af

**Pond dmh33: dmh**

Peak Elev=862.68' Inflow=3.03 cfs 0.231 af  
15.0" Round Culvert n=0.013 L=27.0' S=0.0130 ' Outflow=3.03 cfs 0.231 af

**Pond dmh50: dmh**

Peak Elev=931.65' Inflow=10.86 cfs 0.725 af  
15.0" Round Culvert n=0.013 L=102.0' S=0.0799 ' Outflow=10.86 cfs 0.725 af

**Pond dmh51: dmh**

Peak Elev=923.40' Inflow=10.86 cfs 0.725 af  
15.0" Round Culvert n=0.013 L=127.0' S=0.0780 ' Outflow=10.86 cfs 0.725 af

**Pond dmh52: dmh**

Peak Elev=896.52' Inflow=10.86 cfs 0.725 af  
15.0" Round Culvert n=0.013 L=62.0' S=0.0802 ' Outflow=10.86 cfs 0.725 af

**Pond dmh53: dmh**

Peak Elev=918.90' Inflow=10.98 cfs 0.805 af  
18.0" Round Culvert n=0.013 L=31.0' S=0.0097 ' Outflow=10.98 cfs 0.805 af

**Pond dmh55: dmh**

Peak Elev=909.30' Inflow=23.98 cfs 1.737 af  
24.0" Round Culvert n=0.013 L=72.0' S=0.0211 ' Outflow=23.98 cfs 1.737 af

**Pond dmh56: dmh**

Peak Elev=907.80' Inflow=26.94 cfs 1.964 af  
24.0" Round Culvert n=0.013 L=20.0' S=0.0095 ' Outflow=26.94 cfs 1.964 af

**Pond dmh57: dmh**

Peak Elev=905.08' Inflow=26.94 cfs 1.964 af  
24.0" Round Culvert n=0.013 L=97.0' S=0.0476 ' Outflow=26.94 cfs 1.964 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 141

<b>Pond dmh58: dmh</b>	Peak Elev=898.74' Inflow=26.94 cfs 1.964 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=26.94 cfs 1.964 af
<b>Pond dmh59: dmh</b>	Peak Elev=896.05' Inflow=26.94 cfs 1.964 af 30.0" Round Culvert n=0.013 L=82.0' S=0.0101 '/' Outflow=26.94 cfs 1.964 af
<b>Pond dmh60: dmh</b>	Peak Elev=894.94' Inflow=26.94 cfs 1.964 af 30.0" Round Culvert n=0.013 L=258.0' S=0.0115 '/' Outflow=26.94 cfs 1.964 af
<b>Pond dmh61: dmh</b>	Peak Elev=892.06' Inflow=26.94 cfs 1.964 af 30.0" Round Culvert n=0.013 L=278.0' S=0.0100 '/' Outflow=26.94 cfs 1.964 af
<b>Pond dmh62: dmh</b>	Peak Elev=890.25' Inflow=37.80 cfs 2.689 af 30.0" Round Culvert n=0.013 L=62.0' S=0.0248 '/' Outflow=37.80 cfs 2.689 af
<b>Pond dmh69: dmh</b>	Peak Elev=816.28' Inflow=37.80 cfs 2.689 af 30.0" Round Culvert n=0.013 L=29.0' S=0.0338 '/' Outflow=37.80 cfs 2.689 af
<b>Pond DS-1a: detention</b>	Peak Elev=852.88' Storage=19,526 cf Inflow=20.38 cfs 1.471 af Outflow=10.65 cfs 1.471 af
<b>Pond DS-1b: detention</b>	Peak Elev=862.60' Storage=4,545 cf Inflow=3.66 cfs 0.288 af Outflow=0.80 cfs 0.288 af
<b>Pond DS-2a: detention</b>	Peak Elev=906.14' Storage=48,125 cf Inflow=45.87 cfs 3.370 af Outflow=54.83 cfs 3.368 af
<b>Pond DS-2b: detention</b>	Peak Elev=862.67' Storage=17,437 cf Inflow=14.14 cfs 1.041 af Outflow=3.88 cfs 1.015 af
<b>Pond DW-1: House Drywell</b>	Peak Elev=3.50' Storage=0.063 af Inflow=13.33 cfs 1.029 af Discarded=0.05 cfs 0.105 af Primary=12.78 cfs 0.897 af Outflow=12.83 cfs 1.002 af
<b>Pond DW-10: House Drywell</b>	Peak Elev=3.50' Storage=0.027 af Inflow=16.51 cfs 1.504 af Discarded=0.02 cfs 0.042 af Primary=0.19 cfs 0.229 af Secondary=16.08 cfs 1.221 af Outflow=16.28 cfs 1.493 af
<b>Pond DW-2: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=3.07 cfs 0.246 af Discarded=0.01 cfs 0.016 af Primary=2.95 cfs 0.227 af Outflow=2.96 cfs 0.243 af
<b>Pond DW-3: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=13.56 cfs 1.087 af Discarded=0.05 cfs 0.125 af Primary=13.01 cfs 0.932 af Outflow=13.06 cfs 1.057 af
<b>Pond DW-4: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=11.43 cfs 0.902 af Discarded=0.03 cfs 0.078 af Primary=10.98 cfs 0.805 af Outflow=11.01 cfs 0.883 af
<b>Pond DW-5: House Drywell</b>	Peak Elev=3.50' Storage=0.018 af Inflow=11.31 cfs 0.853 af Discarded=0.01 cfs 0.030 af Primary=10.87 cfs 0.816 af Outflow=10.88 cfs 0.846 af
<b>Pond DW-6: House Drywell</b>	Peak Elev=3.50' Storage=0.081 af Inflow=11.34 cfs 0.895 af Discarded=0.06 cfs 0.135 af Primary=10.86 cfs 0.725 af Outflow=10.92 cfs 0.860 af
<b>Pond DW-7: House Drywell</b>	Peak Elev=3.50' Storage=0.072 af Inflow=18.29 cfs 1.403 af Discarded=0.05 cfs 0.120 af Primary=17.55 cfs 1.253 af Outflow=17.60 cfs 1.373 af
<b>Pond DW-8: House Drywell</b>	Peak Elev=3.50' Storage=0.009 af Inflow=4.92 cfs 0.394 af Discarded=0.01 cfs 0.016 af Primary=4.73 cfs 0.374 af Outflow=4.73 cfs 0.390 af
<b>Pond DW-9: House Drywell</b>	Peak Elev=3.50' Storage=0.045 af Inflow=13.25 cfs 1.023 af Discarded=0.03 cfs 0.076 af Primary=12.72 cfs 0.928 af Outflow=12.76 cfs 1.004 af
<b>Pond G1: gabion</b>	Peak Elev=880.48' Storage=444 cf Inflow=54.83 cfs 3.368 af Outflow=52.05 cfs 3.368 af
<b>Pond G2: gabion</b>	Peak Elev=811.58' Storage=128 cf Inflow=15.09 cfs 4.571 af Outflow=15.10 cfs 4.571 af

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 142

**Link SP1: STUDY POINT #1**Inflow=28.79 cfs 3.370 af  
Primary=28.79 cfs 3.370 af**Link SP2: STUDY POINT #2**Inflow=25.06 cfs 5.288 af  
Primary=25.06 cfs 5.288 af**Link SP3: STUDY POINT #3**Inflow=25.86 cfs 5.399 af  
Primary=25.86 cfs 5.399 af**Link SP4: STUDY POINT #4**Inflow=4.27 cfs 0.312 af  
Primary=4.27 cfs 0.312 af**Link SP5: STUDY POINT #5**Inflow=0.98 cfs 0.072 af  
Primary=0.98 cfs 0.072 af**Total Runoff Area = 29.185 ac   Runoff Volume = 15.422 af   Average Runoff Depth = 6.34"**  
**67.26% Pervious = 19.630 ac   32.74% Impervious = 9.555 ac**



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 143

**Summary for Subcatchment P-1A: Subcat P-1A**

Runoff = 16.51 cfs @ 12.18 hrs, Volume= 1.504 af, Depth= 5.70"  
 Routed to Pond DW-10 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.059	98	Roofs, HSG B
0.085	98	Paved parking, HSG B
0.168	55	Woods, Good, HSG B
0.183	61	>75% Grass cover, Good, HSG B
1.273	74	>75% Grass cover, Good, HSG C
0.966	70	Woods, Good, HSG C
0.044	98	Paved parking, HSG C
0.390	98	Roofs, HSG C
3.168	75	Weighted Average
2.590		81.76% Pervious Area
0.578		18.24% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.8	55	0.1670	0.09		<b>Sheet Flow,</b> Woods: Dense underbrush n= 0.800 P2= 3.28"
1.1	105	0.0500	1.57		<b>Shallow Concentrated Flow,</b> Short Grass Pasture Kv= 7.0 fps
2.4	622	0.0280	4.24	4.11	<b>Trap/Vee/Rect Channel Flow,</b> Bot.W=1.00' D=0.25' Z= 3.0 & 20.0 ' Top.W=6.75' n= 0.016 Asphalt, rough
13.3	782	Total			

**Summary for Subcatchment P-1B: Subcat P-1B**

Runoff = 3.66 cfs @ 12.12 hrs, Volume= 0.288 af, Depth= 6.06"  
 Routed to Pond DS-1b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (sf)	CN	Description
4,342	98	Paved parking, HSG C
1,445	98	Paved parking, HSG B
3,282	61	>75% Grass cover, Good, HSG B
13,797	74	>75% Grass cover, Good, HSG C
2,004	70	Woods, Good, HSG C
24,871	78	Weighted Average
19,083		76.73% Pervious Area
5,787		23.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.6	50	0.0960	0.13		<b>Sheet Flow, A-B</b> Grass: Bermuda n= 0.410 P2= 3.28"
1.4	183	0.0960	2.17		<b>Shallow Concentrated Flow, B-C</b> Short Grass Pasture Kv= 7.0 fps
0.2	82	0.0840	5.88		<b>Shallow Concentrated Flow, C-D</b> Paved Kv= 20.3 fps
8.2	315	Total			

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 144

**Summary for Subcatchment P-1C: Subcat P-1C**

Runoff = 2.19 cfs @ 12.09 hrs, Volume= 0.160 af, Depth= 5.70"  
 Routed to Link SP1 : STUDY POINT #1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.002	98	Paved parking, HSG C
0.068	98	Paved parking, HSG B
0.111	61	>75% Grass cover, Good, HSG B
0.156	74	>75% Grass cover, Good, HSG C
0.337	75	Weighted Average
0.267		79.23% Pervious Area
0.070		20.77% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

**Summary for Subcatchment P-1D: Subcat P-1D**

Runoff = 4.82 cfs @ 12.09 hrs, Volume= 0.354 af, Depth= 5.94"  
 Routed to Pond DS-1a : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (sf)	CN	Description
4,574	61	>75% Grass cover, Good, HSG B
2,625	98	Paved parking, HSG B
2,222	98	Roofs, HSG C
1,194	98	Paved parking, HSG C
20,546	74	>75% Grass cover, Good, HSG C
31,162	77	Weighted Average
25,121		80.61% Pervious Area
6,042		19.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-1E: Subcat P-1E**

Runoff = 2.90 cfs @ 12.09 hrs, Volume= 0.220 af, Depth= 6.91"  
 Routed to Pond dmh01 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.040	61	>75% Grass cover, Good, HSG B
0.037	98	Paved parking, HSG B
0.168	98	Paved parking, HSG C
0.138	74	>75% Grass cover, Good, HSG C
0.382	85	Weighted Average
0.178		46.51% Pervious Area
0.204		53.49% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 145

**Summary for Subcatchment P-1F: Subcat P-1F**

Runoff = 13.33 cfs @ 12.09 hrs, Volume= 1.029 af, Depth= 7.27"  
 Routed to Pond DW-1 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.741	74	>75% Grass cover, Good, HSG C
0.492	98	Roofs, HSG C
0.464	98	Paved parking, HSG C
1.697	88	Weighted Average
0.741		43.66% Pervious Area
0.956		56.34% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2A: Subcat P-2A**

Runoff = 11.51 cfs @ 12.09 hrs, Volume= 0.842 af, Depth= 5.70"  
 Routed to Reach R-02 : Routing through wetland/swale

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.180	98	Roofs, HSG C
0.428	70	Woods, Good, HSG C
1.165	74	>75% Grass cover, Good, HSG C
1.773	75	Weighted Average
1.593		89.86% Pervious Area
0.180		10.14% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2B: Subcat P-2B**

Runoff = 7.02 cfs @ 12.09 hrs, Volume= 0.509 af, Depth= 5.09"  
 Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.522	74	>75% Grass cover, Good, HSG C
0.365	70	Woods, Good, HSG C
0.314	65	Brush, Good, HSG C
1.201	70	Weighted Average
1.201		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 146

**Summary for Subcatchment P-2C: Subcat P-2C**

Runoff = 1.08 cfs @ 12.09 hrs, Volume= 0.084 af, Depth= 7.39"  
 Routed to Pond dmh33 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.085	98	Paved parking, HSG C
0.051	74	>75% Grass cover, Good, HSG C
0.137	89	Weighted Average
0.051		37.60% Pervious Area
0.085		62.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 Min

**Summary for Subcatchment P-2D: Subcat P-2D**

Runoff = 1.95 cfs @ 12.09 hrs, Volume= 0.147 af, Depth= 6.79"  
 Routed to Pond dmh31 : dmh

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.106	98	Paved parking, HSG C
0.155	74	>75% Grass cover, Good, HSG C
0.260	84	Weighted Average
0.155		59.42% Pervious Area
0.106		40.58% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2E: Subcat P-2E**

Runoff = 18.29 cfs @ 12.09 hrs, Volume= 1.403 af, Depth= 7.15"  
 Routed to Pond DW-7 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
1.068	74	>75% Grass cover, Good, HSG C
0.691	98	Roofs, HSG C
0.595	98	Paved parking, HSG C
2.354	87	Weighted Average
1.068		45.38% Pervious Area
1.286		54.62% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

**Summary for Subcatchment P-2F: Subcat P-2F**

Runoff = 11.31 cfs @ 12.09 hrs, Volume= 0.853 af, Depth= 6.79"  
 Routed to Pond DW-5 : House Drywell

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 147

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.854	74	>75% Grass cover, Good, HSG C
0.370	98	Roofs, HSG C
0.284	98	Paved parking, HSG C
1.509	84	Weighted Average
0.854		56.63% Pervious Area
0.654		43.37% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2G: Subcat P-2G**

Runoff = 13.25 cfs @ 12.09 hrs, Volume= 1.023 af, Depth= 7.27"  
 Routed to Pond DW-9 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.736	74	>75% Grass cover, Good, HSG C
0.000	65	Brush, Good, HSG C
0.588	98	Roofs, HSG C
0.364	98	Paved parking, HSG C
1.688	88	Weighted Average
0.736		43.60% Pervious Area
0.952		56.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2H: Subcat P-2H**

Runoff = 4.92 cfs @ 12.09 hrs, Volume= 0.394 af, Depth= 7.88"  
 Routed to Pond DW-8 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.136	74	>75% Grass cover, Good, HSG C
0.160	98	Roofs, HSG C
0.304	98	Paved parking, HSG C
0.601	93	Weighted Average
0.136		22.65% Pervious Area
0.465		77.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

**Summary for Subcatchment P-2I: Subcat P-2I**

Runoff = 0.89 cfs @ 12.09 hrs, Volume= 0.066 af, Depth= 6.18"  
 Routed to Link SP2 : STUDY POINT #2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 148

Area (ac)	CN	Description
0.098	74	>75% Grass cover, Good, HSG C
0.029	98	Paved parking, HSG C
0.127	79	Weighted Average
0.098		77.34% Pervious Area
0.029		22.66% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, TR-55 Min</b>

**Summary for Subcatchment P-2J: Subcat P-2J**

Runoff = 4.09 cfs @ 12.09 hrs, Volume= 0.300 af, Depth= 5.82"  
Routed to Pond DS-2b : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.016	70	Woods, Good, HSG C
0.048	98	Roofs, HSG C
0.556	74	>75% Grass cover, Good, HSG C
0.619	76	Weighted Average
0.571		92.27% Pervious Area
0.048		7.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

**Summary for Subcatchment P-3A: Subcat P-3A**

Runoff = 22.00 cfs @ 12.22 hrs, Volume= 2.130 af, Depth= 5.09"  
Routed to Pond DB-1 : detention

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
2.599	74	>75% Grass cover, Good, HSG C
0.847	70	Woods, Good, HSG C
1.578	65	Brush, Good, HSG C
5.023	70	Weighted Average
5.023		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.7	50	0.0180	0.07		<b>Sheet Flow, A-B</b>
					Woods: Light underbrush n= 0.400 P2= 3.28"
1.0	91	0.0850	1.46		<b>Shallow Concentrated Flow, B-C</b>
					Woodland Kv= 5.0 fps
1.1	204	0.1800	2.97		<b>Shallow Concentrated Flow, C-D</b>
					Short Grass Pasture Kv= 7.0 fps
1.3	299	0.3000	3.83		<b>Shallow Concentrated Flow, D-E</b>
					Short Grass Pasture Kv= 7.0 fps
16.1	644	Total			

**Summary for Subcatchment P-3B: Subcat P-3B**

Runoff = 8.25 cfs @ 12.09 hrs, Volume= 0.600 af, Depth= 5.33"  
Routed to Reach R-01 : Routing to wetlands

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Type III 24-hr 100-year Rainfall=8.72"

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 149

Area (ac)	CN	Description
0.000	98	Roofs, HSG C
0.172	65	Brush, Good, HSG C
0.274	70	Woods, Good, HSG C
0.905	74	>75% Grass cover, Good, HSG C
1.351	72	Weighted Average
1.351		99.99% Pervious Area
0.000		0.01% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry,</b>

### Summary for Subcatchment P-3C: Subcat P-3C

Runoff = 3.07 cfs @ 12.09 hrs, Volume= 0.246 af, Depth= 7.88"  
 Routed to Pond DW-2 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.085	74	>75% Grass cover, Good, HSG C
0.051	98	Roofs, HSG C
0.239	98	Paved parking, HSG C
0.375	93	Weighted Average
0.085		22.77% Pervious Area
0.290		77.23% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr55 min</b>

### Summary for Subcatchment P-3D: Subcat P-3D

Runoff = 13.56 cfs @ 12.09 hrs, Volume= 1.087 af, Depth= 7.88"  
 Routed to Pond DW-3 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.361	74	>75% Grass cover, Good, HSG C
0.725	98	Roofs, HSG C
0.571	98	Paved parking, HSG C
1.657	93	Weighted Average
0.361		21.80% Pervious Area
1.295		78.20% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					<b>Direct Entry, tr-55 min</b>

### Summary for Subcatchment P-3E: Subcat P-3E

Runoff = 11.43 cfs @ 12.09 hrs, Volume= 0.902 af, Depth= 7.64"  
 Routed to Pond DW-4 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 150

Area (ac)	CN	Description
0.414	74	>75% Grass cover, Good, HSG C
0.552	98	Roofs, HSG C
0.451	98	Paved parking, HSG C
1.417	91	Weighted Average
0.414		29.24% Pervious Area
1.003		70.76% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

### Summary for Subcatchment P-3F: Subcat P-3F

Runoff = 11.34 cfs @ 12.09 hrs, Volume= 0.895 af, Depth= 7.64"  
 Routed to Pond DW-6 : House Drywell

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (ac)	CN	Description
0.388	74	>75% Grass cover, Good, HSG C
0.565	98	Roofs, HSG C
0.452	98	Paved parking, HSG C
1.406	91	Weighted Average
0.388		27.61% Pervious Area
1.018		72.39% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, TR-55 MIN

### Summary for Subcatchment P-4: Subcat P-4

Runoff = 4.27 cfs @ 12.09 hrs, Volume= 0.312 af, Depth= 5.70"  
 Routed to Link SP4 : STUDY POINT #4

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"

Area (sf)	CN	Description
56	61	>75% Grass cover, Good, HSG B
16,537	74	>75% Grass cover, Good, HSG C
9,257	70	Woods, Good, HSG C
2,814	98	Paved parking, HSG C
28,663	75	Weighted Average
25,849		90.18% Pervious Area
2,814		9.82% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, tr55 min

### Summary for Subcatchment P-5: Subcat P-5

Runoff = 0.98 cfs @ 12.09 hrs, Volume= 0.072 af, Depth= 5.45"  
 Routed to Link SP5 : STUDY POINT #5

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-year Rainfall=8.72"



**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
 HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 151

Area (sf)	CN	Description
2,401	70	Woods, Good, HSG C
4,473	74	>75% Grass cover, Good, HSG C
6,874	73	Weighted Average
6,874		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					<b>Direct Entry, TR-55 Min.</b>
5.0	0	Total, Increased to minimum Tc = 6.0 min			

### Summary for Reach R-01: Routing to wetlands

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.


This reach demonstrates a procedure for performing a shallow concentrated flow routing through woods. In this case, the "reach" is defined as a channel with very low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 1.351 ac, 0.01% Impervious, Inflow Depth = 5.33" for 100-year event  
 Inflow = 8.25 cfs @ 12.09 hrs, Volume= 0.600 af  
 Outflow = 3.86 cfs @ 12.28 hrs, Volume= 0.600 af, Atten= 53%, Lag= 11.2 min  
 Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 0.43 fps, Min. Travel Time= 27.8 min  
 Avg. Velocity = 0.15 fps, Avg. Travel Time= 80.4 min

Peak Storage= 6,442 cf @ 12.28 hrs  
 Average Depth at Peak Storage= 0.38' , Surface Width= 42.54'  
 Bank-Full Depth= 1.00' Flow Area= 55.0 sf, Capacity= 43.77 cfs

5.00' x 1.00' deep channel, n= 0.400 Sheet flow: Woods+light brush  
 Side Slope Z-value= 50.0 ' / ' Top Width= 105.00'  
 Length= 722.0' Slope= 0.1087 ' / '  
 Inlet Invert= 889.50', Outlet Invert= 811.00'

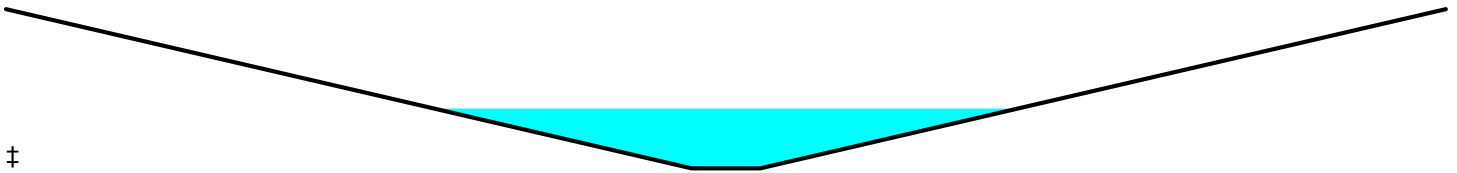

### Summary for Reach R-02: Routing through wetland/swale

A subcatchment performs runoff calculations, including the associated Tc and CN determinations. It does not have any facility for routing an inflow hydrograph from another source. However, a reach may be used to perform this type of specialized routing.

This reach demonstrates a procedure for performing a shallow concentrated flow routing through the wooded wetland/swale adjacent to the stone wall. In this case, the "reach" is defined as a channel with low side slopes. The Manning's value of 0.40 is selected from the table of sheet flow roughness coefficients, which is comparable to the Manning's value for "woods with light underbrush".

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth = 6.37" for 100-year event  
 Inflow = 58.90 cfs @ 12.20 hrs, Volume= 4.209 af  
 Outflow = 21.70 cfs @ 12.37 hrs, Volume= 4.208 af, Atten= 63%, Lag= 10.3 min  
 Routed to Pond 1P : depression

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Max. Velocity= 0.48 fps, Min. Travel Time= 18.2 min  
 Avg. Velocity = 0.17 fps, Avg. Travel Time= 50.8 min

Peak Storage= 23,734 cf @ 12.37 hrs  
 Average Depth at Peak Storage= 1.37' , Surface Width= 55.94'  
 Bank-Full Depth= 1.50' Flow Area= 52.7 sf, Capacity= 26.65 cfs

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.


HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 152

10.00' x 1.50' deep channel, n= 0.400 Sheet flow: Woods+light brush  
 Side Slope Z-value= 30.0 3.5 '/' Top Width= 60.25'  
 Length= 525.0' Slope= 0.0223 '/'  
 Inlet Invert= 875.70', Outlet Invert= 864.00'

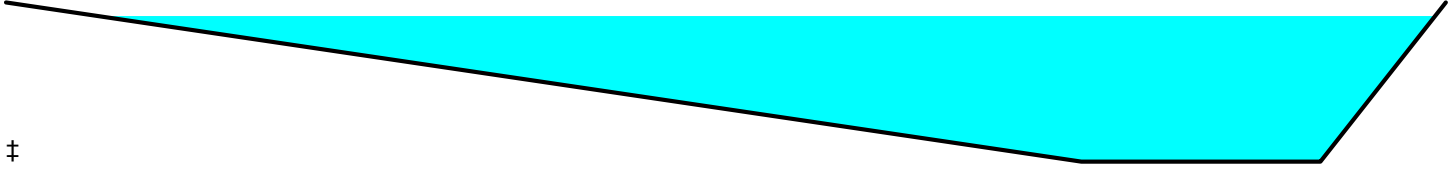**Summary for Pond 1P: depression**

Inflow Area = 7.925 ac, 44.63% Impervious, Inflow Depth > 6.37" for 100-year event  
 Inflow = 21.70 cfs @ 12.37 hrs, Volume= 4.208 af  
 Outflow = 21.85 cfs @ 12.40 hrs, Volume= 4.207 af, Atten= 0%, Lag= 1.9 min  
 Primary = 18.84 cfs @ 12.40 hrs, Volume= 4.150 af  
 Routed to Link SP2 : STUDY POINT #2  
 Secondary = 3.01 cfs @ 12.40 hrs, Volume= 0.058 af  
 Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 863.55' @ 12.40 hrs Surf.Area= 705 sf Storage= 788 cf  
 Flood Elev= 864.00' Surf.Area= 837 sf Storage= 1,133 cf

Plug-Flow detention time= 0.6 min calculated for 4.202 af (100% of inflow)  
 Center-of-Mass det. time= 0.6 min ( 902.1 - 901.5 )

Volume	Invert	Avail.Storage	Storage Description		
#1	862.00'	1,133 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)		
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
862.00	334	74.0	0	0	334
864.00	837	119.0	1,133	1,133	1,052

Device	Routing	Invert	Outlet Devices
#1	Primary	859.00'	<b>24.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.00' / 858.73' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	862.00'	<b>24.0" Horiz. beehive</b> C= 0.600 Limited to weir flow at low heads
#3	Secondary	863.30'	<b>10.0' long x 5.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

**Primary OutFlow** Max=18.84 cfs @ 12.40 hrs HW=863.55' TW=0.00' (Dynamic Tailwater)

↑ **1=Culvert** (Passes 18.84 cfs of 28.50 cfs potential flow)

↑ **2=beehive** (Orifice Controls 18.84 cfs @ 6.00 fps)

**Secondary OutFlow** Max=2.99 cfs @ 12.40 hrs HW=863.55' TW=0.00' (Dynamic Tailwater)

↑ **3=Broad-Crested Rectangular Weir** (Weir Controls 2.99 cfs @ 1.19 fps)

**Summary for Pond DB-1: detention**

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth = 5.85" for 100-year event  
 Inflow = 54.64 cfs @ 12.13 hrs, Volume= 4.819 af  
 Outflow = 22.41 cfs @ 12.48 hrs, Volume= 4.799 af, Atten= 59%, Lag= 21.1 min  
 Primary = 15.09 cfs @ 12.48 hrs, Volume= 4.571 af  
 Routed to Pond G2 : gabion  
 Secondary = 7.32 cfs @ 12.48 hrs, Volume= 0.228 af  
 Routed to Link SP3 : STUDY POINT #3

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 153

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 814.90' @ 12.48 hrs Surf.Area= 22,706 sf Storage= 74,238 cf  
 Flood Elev= 816.00' Surf.Area= 24,900 sf Storage= 100,504 cf

Plug-Flow detention time= 79.8 min calculated for 4.799 af (100% of inflow)  
 Center-of-Mass det. time= 77.1 min ( 881.6 - 804.5 )

Volume	Invert	Avail.Storage	Storage Description
#1	811.00'	100,504 cf	<b>Custom Stage Data (Irregular)</b> Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)
811.00	15,556	576.0	0	0	15,556
812.00	17,303	594.0	16,422	16,422	17,331
813.00	19,115	613.0	18,201	34,623	19,253
814.00	20,984	632.0	20,042	54,665	21,236
815.00	22,910	651.0	21,940	76,605	23,279
816.00	24,900	670.0	23,898	100,504	25,383

Device	Routing	Invert	Outlet Devices
#1	Primary	811.00'	<b>18.0" Round Culvert</b> L= 32.0' Ke= 0.500 Inlet / Outlet Invert= 811.00' / 810.30' S= 0.0219 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf
#2	Device 1	811.00'	<b>8.0" Vert. (2) 8" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	811.90'	<b>12.0" Vert. (2) 12" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	813.20'	<b>24.0" x 24.0" Horiz. 24" Top of Structure</b> C= 0.600 Limited to weir flow at low heads
#5	Secondary	814.40'	<b>8.0' long x 8.0' breadth Broad-Crested Rectangular Weir</b> Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.43 2.54 2.70 2.69 2.68 2.68 2.66 2.64 2.64 2.64 2.65 2.65 2.66 2.66 2.68 2.70 2.74

**Primary OutFlow** Max=15.09 cfs @ 12.48 hrs HW=814.89' TW=811.58' (Dynamic Tailwater)

1=Culvert (Inlet Controls 15.09 cfs @ 8.54 fps)  
 2=(2) 8" Orifice (2yr) (Passes < 6.12 cfs potential flow)  
 3=(2) 12" Orifice (10yr) (Passes < 11.94 cfs potential flow)  
 4=24" Top of Structure (Passes < 25.06 cfs potential flow)

**Secondary OutFlow** Max=7.25 cfs @ 12.48 hrs HW=814.89' TW=0.00' (Dynamic Tailwater)

5=Broad-Crested Rectangular Weir (Weir Controls 7.25 cfs @ 1.84 fps)

**Summary for Pond dmh01: dmh**

Inflow Area = 0.382 ac, 53.49% Impervious, Inflow Depth = 6.91" for 100-year event  
 Inflow = 2.90 cfs @ 12.09 hrs, Volume= 0.220 af  
 Outflow = 2.90 cfs @ 12.09 hrs, Volume= 0.220 af, Atten= 0%, Lag= 0.0 min  
 Primary = 2.90 cfs @ 12.09 hrs, Volume= 0.220 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 852.98' @ 12.29 hrs  
 Flood Elev= 855.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	849.34'	<b>12.0" Round Culvert</b> L= 12.0' Ke= 0.500 Inlet / Outlet Invert= 849.34' / 849.22' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=0.00 cfs @ 12.09 hrs HW=851.92' TW=851.94' (Dynamic Tailwater)

1=Culvert ( Controls 0.00 cfs)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 154

**Summary for Pond dmh05: dmh**

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 6.34" for 100-year event  
 Inflow = 12.78 cfs @ 12.11 hrs, Volume= 0.897 af  
 Outflow = 12.78 cfs @ 12.11 hrs, Volume= 0.897 af, Atten= 0%, Lag= 0.0 min  
 Primary = 12.78 cfs @ 12.11 hrs, Volume= 0.897 af  
 Routed to Pond DS-1a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 873.81' @ 12.11 hrs  
 Flood Elev= 883.10'

Device	Routing	Invert	Outlet Devices
#1	Primary	868.52'	<b>15.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 868.52' / 865.12' S= 0.0351 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=12.51 cfs @ 12.11 hrs HW=873.63' TW=852.19' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 12.51 cfs @ 10.19 fps)

**Summary for Pond dmh20: dmh**

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 6.49" for 100-year event  
 Inflow = 10.87 cfs @ 12.11 hrs, Volume= 0.816 af  
 Outflow = 10.87 cfs @ 12.11 hrs, Volume= 0.816 af, Atten= 0%, Lag= 0.0 min  
 Primary = 10.87 cfs @ 12.11 hrs, Volume= 0.816 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 912.36' @ 12.15 hrs  
 Flood Elev= 907.61'

Device	Routing	Invert	Outlet Devices
#1	Primary	902.74'	<b>15.0" Round Culvert</b> L= 205.0' Ke= 0.500 Inlet / Outlet Invert= 902.74' / 900.30' S= 0.0119 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=8.93 cfs @ 12.11 hrs HW=911.13' TW=905.96' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 8.93 cfs @ 7.28 fps)

**Summary for Pond dmh21: dmh**

Inflow Area = 3.863 ac, 50.23% Impervious, Inflow Depth = 6.43" for 100-year event  
 Inflow = 28.42 cfs @ 12.11 hrs, Volume= 2.068 af  
 Outflow = 28.42 cfs @ 12.11 hrs, Volume= 2.068 af, Atten= 0%, Lag= 0.0 min  
 Primary = 28.42 cfs @ 12.11 hrs, Volume= 2.068 af  
 Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 908.13' @ 12.30 hrs  
 Flood Elev= 905.24'

Device	Routing	Invert	Outlet Devices
#1	Primary	899.55'	<b>24.0" Round Culvert</b> L= 190.0' Ke= 0.500 Inlet / Outlet Invert= 899.55' / 897.65' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=23.95 cfs @ 12.11 hrs HW=905.95' TW=902.46' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 23.95 cfs @ 7.62 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 155

**Summary for Pond dmh23: dmh**

Inflow Area = 5.551 ac, 52.10% Impervious, Inflow Depth = 6.48" for 100-year event  
 Inflow = 41.14 cfs @ 12.11 hrs, Volume= 2.996 af  
 Outflow = 41.14 cfs @ 12.11 hrs, Volume= 2.996 af, Atten= 0%, Lag= 0.0 min  
 Primary = 41.14 cfs @ 12.11 hrs, Volume= 2.996 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 907.06' @ 12.25 hrs  
 Flood Elev= 910.71'

Device	Routing	Invert	Outlet Devices
#1	Primary	897.55'	<b>30.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 897.55' / 897.20' S= 0.0130 ' /' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=30.24 cfs @ 12.11 hrs HW=902.46' TW=900.82' (Dynamic Tailwater)  
 ↑**1=Culvert** (Inlet Controls 30.24 cfs @ 6.16 fps)

**Summary for Pond dmh25: dmh**

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 7.47" for 100-year event  
 Inflow = 4.73 cfs @ 12.11 hrs, Volume= 0.374 af  
 Outflow = 4.73 cfs @ 12.11 hrs, Volume= 0.374 af, Atten= 0%, Lag= 0.0 min  
 Primary = 4.73 cfs @ 12.11 hrs, Volume= 0.374 af  
 Routed to Pond DS-2a : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 924.66' @ 12.11 hrs  
 Flood Elev= 930.54'

Device	Routing	Invert	Outlet Devices
#1	Primary	922.60'	<b>12.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 922.60' / 915.84' S= 0.0697 ' /' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=4.63 cfs @ 12.11 hrs HW=924.60' TW=900.79' (Dynamic Tailwater)  
 ↑**1=Culvert** (Inlet Controls 4.63 cfs @ 5.90 fps)

**Summary for Pond dmh31: dmh**

Inflow Area = 0.260 ac, 40.58% Impervious, Inflow Depth = 6.79" for 100-year event  
 Inflow = 1.95 cfs @ 12.09 hrs, Volume= 0.147 af  
 Outflow = 1.95 cfs @ 12.09 hrs, Volume= 0.147 af, Atten= 0%, Lag= 0.0 min  
 Primary = 1.95 cfs @ 12.09 hrs, Volume= 0.147 af  
 Routed to Pond dmh33 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 876.53' @ 12.09 hrs  
 Flood Elev= 885.77'

Device	Routing	Invert	Outlet Devices
#1	Primary	875.76'	<b>12.0" Round Culvert</b> L= 96.0' Ke= 0.500 Inlet / Outlet Invert= 875.76' / 868.05' S= 0.0803 ' /' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf

**Primary OutFlow** Max=1.90 cfs @ 12.09 hrs HW=876.52' TW=861.09' (Dynamic Tailwater)  
 ↑**1=Culvert** (Inlet Controls 1.90 cfs @ 2.97 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 156

**Summary for Pond dmh33: dmh**

Inflow Area = 0.397 ac, 48.09% Impervious, Inflow Depth = 7.00" for 100-year event  
 Inflow = 3.03 cfs @ 12.09 hrs, Volume= 0.231 af  
 Outflow = 3.03 cfs @ 12.09 hrs, Volume= 0.231 af, Atten= 0%, Lag= 0.0 min  
 Primary = 3.03 cfs @ 12.09 hrs, Volume= 0.231 af  
 Routed to Pond DS-2b : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 862.68' @ 12.54 hrs  
 Flood Elev= 864.98'

Device	Routing	Invert	Outlet Devices
#1	Primary	859.71'	<b>15.0" Round Culvert</b> L= 27.0' Ke= 0.500 Inlet / Outlet Invert= 859.71' / 859.36' S= 0.0130 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=0.00 cfs @ 12.09 hrs HW=861.09' TW=861.21' (Dynamic Tailwater)  
**1=Culvert** ( Controls 0.00 cfs)

**Summary for Pond dmh50: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 6.19" for 100-year event  
 Inflow = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af  
 Outflow = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af, Atten= 0%, Lag= 0.0 min  
 Primary = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af  
 Routed to Pond dmh51 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 931.65' @ 12.11 hrs  
 Flood Elev= 933.94'

Device	Routing	Invert	Outlet Devices
#1	Primary	927.65'	<b>15.0" Round Culvert</b> L= 102.0' Ke= 0.500 Inlet / Outlet Invert= 927.65' / 919.50' S= 0.0799 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=10.64 cfs @ 12.11 hrs HW=931.52' TW=923.27' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 10.64 cfs @ 8.67 fps)

**Summary for Pond dmh51: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 6.19" for 100-year event  
 Inflow = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af  
 Outflow = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af, Atten= 0%, Lag= 0.0 min  
 Primary = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af  
 Routed to Pond dmh52 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 923.40' @ 12.11 hrs  
 Flood Elev= 924.04'

Device	Routing	Invert	Outlet Devices
#1	Primary	919.40'	<b>15.0" Round Culvert</b> L= 127.0' Ke= 0.500 Inlet / Outlet Invert= 919.40' / 909.50' S= 0.0780 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=10.64 cfs @ 12.11 hrs HW=923.27' TW=896.39' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 10.64 cfs @ 8.67 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 157

**Summary for Pond dmh52: dmh**

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 6.19" for 100-year event  
 Inflow = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af  
 Outflow = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af, Atten= 0%, Lag= 0.0 min  
 Primary = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 896.52' @ 12.11 hrs  
 Flood Elev= 914.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.52'	<b>15.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 892.52' / 887.55' S= 0.0802 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

**Primary OutFlow** Max=10.64 cfs @ 12.11 hrs HW=896.39' TW=890.15' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 10.64 cfs @ 8.67 fps)

**Summary for Pond dmh53: dmh**

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 6.82" for 100-year event  
 Inflow = 10.98 cfs @ 12.11 hrs, Volume= 0.805 af  
 Outflow = 10.98 cfs @ 12.11 hrs, Volume= 0.805 af, Atten= 0%, Lag= 0.0 min  
 Primary = 10.98 cfs @ 12.11 hrs, Volume= 0.805 af  
 Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 918.90' @ 12.11 hrs  
 Flood Elev= 921.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	916.46'	<b>18.0" Round Culvert</b> L= 31.0' Ke= 0.500 Inlet / Outlet Invert= 916.46' / 916.16' S= 0.0097 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

**Primary OutFlow** Max=10.75 cfs @ 12.11 hrs HW=918.85' TW=908.91' (Dynamic Tailwater)  
**1=Culvert** (Barrel Controls 10.75 cfs @ 6.08 fps)

**Summary for Pond dmh55: dmh**

Inflow Area = 3.074 ac, 74.77% Impervious, Inflow Depth = 6.78" for 100-year event  
 Inflow = 23.98 cfs @ 12.11 hrs, Volume= 1.737 af  
 Outflow = 23.98 cfs @ 12.11 hrs, Volume= 1.737 af, Atten= 0%, Lag= 0.0 min  
 Primary = 23.98 cfs @ 12.11 hrs, Volume= 1.737 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 909.30' @ 12.16 hrs  
 Flood Elev= 911.86'

Device	Routing	Invert	Outlet Devices
#1	Primary	905.32'	<b>24.0" Round Culvert</b> L= 72.0' Ke= 0.500 Inlet / Outlet Invert= 905.32' / 903.80' S= 0.0211 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=19.28 cfs @ 12.11 hrs HW=908.91' TW=907.28' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 19.28 cfs @ 6.14 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 158

**Summary for Pond dmh56: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 6.83" for 100-year event  
 Inflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Outflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af, Atten= 0%, Lag= 0.0 min  
 Primary = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Routed to Pond dmh57 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 907.80' @ 12.14 hrs  
 Flood Elev= 908.47'

Device	Routing	Invert	Outlet Devices
#1	Primary	901.21'	<b>24.0" Round Culvert</b> L= 20.0' Ke= 0.500 Inlet / Outlet Invert= 901.21' / 901.02' S= 0.0095 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=23.03 cfs @ 12.11 hrs HW=907.28' TW=904.96' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 23.03 cfs @ 7.33 fps)

**Summary for Pond dmh57: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 6.83" for 100-year event  
 Inflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Outflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af, Atten= 0%, Lag= 0.0 min  
 Primary = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Routed to Pond dmh58 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 905.08' @ 12.11 hrs  
 Flood Elev= 908.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	900.92'	<b>24.0" Round Culvert</b> L= 97.0' Ke= 0.500 Inlet / Outlet Invert= 900.92' / 896.30' S= 0.0476 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf

**Primary OutFlow** Max=26.39 cfs @ 12.11 hrs HW=904.96' TW=898.69' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 26.39 cfs @ 8.40 fps)

**Summary for Pond dmh58: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 6.83" for 100-year event  
 Inflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Outflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af, Atten= 0%, Lag= 0.0 min  
 Primary = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Routed to Pond dmh59 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 898.74' @ 12.11 hrs  
 Flood Elev= 901.46'

Device	Routing	Invert	Outlet Devices
#1	Primary	896.20'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 896.20' / 893.43' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=26.38 cfs @ 12.11 hrs HW=898.69' TW=895.94' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 26.38 cfs @ 5.38 fps)



**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 159

**Summary for Pond dmh59: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 6.83" for 100-year event  
 Inflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Outflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af, Atten= 0%, Lag= 0.0 min  
 Primary = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Routed to Pond dmh60 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 896.05' @ 12.14 hrs  
 Flood Elev= 909.31'

Device	Routing	Invert	Outlet Devices
#1	Primary	893.33'	<b>30.0" Round Culvert</b> L= 82.0' Ke= 0.500 Inlet / Outlet Invert= 893.33' / 892.50' S= 0.0101 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=23.40 cfs @ 12.11 hrs HW=895.94' TW=894.89' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 23.40 cfs @ 5.68 fps)

**Summary for Pond dmh60: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 6.83" for 100-year event  
 Inflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Outflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af, Atten= 0%, Lag= 0.0 min  
 Primary = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Routed to Pond dmh61 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 894.94' @ 12.11 hrs  
 Flood Elev= 901.96'

Device	Routing	Invert	Outlet Devices
#1	Primary	892.40'	<b>30.0" Round Culvert</b> L= 258.0' Ke= 0.500 Inlet / Outlet Invert= 892.40' / 889.43' S= 0.0115 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=26.38 cfs @ 12.11 hrs HW=894.89' TW=891.90' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 26.38 cfs @ 5.38 fps)

**Summary for Pond dmh61: dmh**

Inflow Area = 3.449 ac, 75.04% Impervious, Inflow Depth = 6.83" for 100-year event  
 Inflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Outflow = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af, Atten= 0%, Lag= 0.0 min  
 Primary = 26.94 cfs @ 12.11 hrs, Volume= 1.964 af  
 Routed to Pond dmh62 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 892.06' @ 12.14 hrs  
 Flood Elev= 898.16'

Device	Routing	Invert	Outlet Devices
#1	Primary	889.33'	<b>30.0" Round Culvert</b> L= 278.0' Ke= 0.500 Inlet / Outlet Invert= 889.33' / 886.55' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=23.07 cfs @ 12.11 hrs HW=891.90' TW=890.15' (Dynamic Tailwater)  
**1=Culvert** (Outlet Controls 23.07 cfs @ 5.68 fps)

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 160

**Summary for Pond dmh62: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 6.65" for 100-year event  
 Inflow = 37.80 cfs @ 12.11 hrs, Volume= 2.689 af  
 Outflow = 37.80 cfs @ 12.11 hrs, Volume= 2.689 af, Atten= 0%, Lag= 0.0 min  
 Primary = 37.80 cfs @ 12.11 hrs, Volume= 2.689 af  
 Routed to Pond dmh69 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 890.25' @ 12.11 hrs  
 Flood Elev= 902.00'

Device	Routing	Invert	Outlet Devices
#1	Primary	886.45'	<b>30.0" Round Culvert</b> L= 62.0' Ke= 0.500 Inlet / Outlet Invert= 886.45' / 884.91' S= 0.0248 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=37.03 cfs @ 12.11 hrs HW=890.15' TW=816.18' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 37.03 cfs @ 7.54 fps)

**Summary for Pond dmh69: dmh**

Inflow Area = 4.855 ac, 74.27% Impervious, Inflow Depth = 6.65" for 100-year event  
 Inflow = 37.80 cfs @ 12.11 hrs, Volume= 2.689 af  
 Outflow = 37.80 cfs @ 12.11 hrs, Volume= 2.689 af, Atten= 0%, Lag= 0.0 min  
 Primary = 37.80 cfs @ 12.11 hrs, Volume= 2.689 af  
 Routed to Pond DB-1 : detention

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 816.28' @ 12.11 hrs  
 Flood Elev= 818.02'

Device	Routing	Invert	Outlet Devices
#1	Primary	812.48'	<b>30.0" Round Culvert</b> L= 29.0' Ke= 0.500 Inlet / Outlet Invert= 812.48' / 811.50' S= 0.0338 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 4.91 sf

**Primary OutFlow** Max=37.03 cfs @ 12.11 hrs HW=816.18' TW=813.55' (Dynamic Tailwater)  
**1=Culvert** (Inlet Controls 37.03 cfs @ 7.54 fps)

**Summary for Pond DS-1a: detention**

Inflow Area = 2.795 ac, 46.49% Impervious, Inflow Depth = 6.32" for 100-year event  
 Inflow = 20.38 cfs @ 12.10 hrs, Volume= 1.471 af  
 Outflow = 10.65 cfs @ 12.26 hrs, Volume= 1.471 af, Atten= 48%, Lag= 9.4 min  
 Primary = 10.65 cfs @ 12.26 hrs, Volume= 1.471 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 852.88' @ 12.26 hrs Surf.Area= 4,480 sf Storage= 19,526 cf  
 Flood Elev= 853.00' Surf.Area= 4,505 sf Storage= 19,995 cf

Plug-Flow detention time= 77.8 min calculated for 1.469 af (100% of inflow)  
 Center-of-Mass det. time= 77.9 min ( 873.2 - 795.2 )

Volume	Invert	Avail. Storage	Storage Description
#1A	848.00'	0 cf	<b>112.00'W x 40.00'L x 5.67'H Field A</b> 25,387 cf Overall - 25,387 cf Embedded = 0 cf
#2A	848.00'	19,995 cf	<b>retain_it retain_it 5.0' x 70</b> Inside #1 Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 14 Rows adjusted for 394.8 cf perimeter wall
#3	853.00'	56 cf	<b>4.00'D x 4.45'H CB-9</b>
#4	853.00'	38 cf	<b>4.00'D x 3.00'H CB-8</b>
		20,088 cf	Total Available Storage

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 161

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	847.90'	<b>15.0" Round Culvert</b> L= 129.0' Ke= 0.500 Inlet / Outlet Invert= 847.90' / 846.36' S= 0.0119 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf
#2	Device 1	847.90'	<b>3.0" Vert. 3" Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	849.50'	<b>7.0" Vert. 7" Orifice (10yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	851.30'	<b>6.0" Vert. 6" Orifice (25yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	851.90'	<b>8.0" Vert. 8" Orifice (50yr) X 3.00</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	852.80'	<b>4.0' long Overflow Weir</b> 2 End Contraction(s) 4.0' Crest Height

**Primary OutFlow** Max=10.64 cfs @ 12.26 hrs HW=852.87' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Barrel Controls 10.64 cfs @ 8.67 fps)
- 2=3" Orifice (2yr) (Passes < 1.04 cfs potential flow)
- 3=7" Orifice (10yr) (Passes < 4.52 cfs potential flow)
- 4=6" Orifice (25yr) (Passes < 2.18 cfs potential flow)
- 5=8" Orifice (50yr) (Passes < 4.04 cfs potential flow)
- 6=Overflow Weir (Passes < 0.27 cfs potential flow)

**Summary for Pond DS-1b: detention**

Inflow Area = 0.571 ac, 23.27% Impervious, Inflow Depth = 6.06" for 100-year event  
 Inflow = 3.66 cfs @ 12.12 hrs, Volume= 0.288 af  
 Outflow = 0.80 cfs @ 12.56 hrs, Volume= 0.288 af, Atten= 78%, Lag= 26.9 min  
 Primary = 0.80 cfs @ 12.56 hrs, Volume= 0.288 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 862.60' @ 12.56 hrs Surf.Area= 1,536 sf Storage= 4,545 cf  
 Flood Elev= 862.70' Surf.Area= 1,536 sf Storage= 4,684 cf

Plug-Flow detention time= 71.9 min calculated for 0.288 af (100% of inflow)  
 Center-of-Mass det. time= 71.7 min ( 877.9 - 806.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.20'	0 cf	<b>64.00'W x 24.00'L x 4.17'H Field A</b> 6,400 cf Overall - 6,400 cf Embedded = 0 cf x 40.0% Voids
#2A	859.20'	4,684 cf	<b>retain_it retain_it 3.5' x 24</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 8 Rows adjusted for 135.1 cf perimeter wall
		4,684 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Primary	859.20'	<b>12.0" Round Culvert</b> L= 100.0' Ke= 0.500 Inlet / Outlet Invert= 859.20' / 858.10' S= 0.0110 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>4.0" Vert. 4" Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>12.0" Vert. Overflow</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=0.79 cfs @ 12.56 hrs HW=862.59' TW=0.00' (Dynamic Tailwater)

- 1=Culvert (Passes 0.79 cfs of 5.47 cfs potential flow)
- 2=4" Orifice (Orifice Controls 0.75 cfs @ 8.65 fps)
- 3=Overflow (Orifice Controls 0.04 cfs @ 1.04 fps)

**Summary for Pond DS-2a: detention**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth = 6.57" for 100-year event  
 Inflow = 45.87 cfs @ 12.11 hrs, Volume= 3.370 af  
 Outflow = 54.83 cfs @ 12.20 hrs, Volume= 3.368 af, Atten= 0%, Lag= 5.3 min  
 Primary = 54.83 cfs @ 12.20 hrs, Volume= 3.368 af  
 Routed to Pond G1 : gabion

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 162

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 906.14' @ 12.20 hrs Storage= 48,125 cf

Flood Elev= 902.66' Storage= 48,125 cf

Plug-Flow detention time= 98.1 min calculated for 3.368 af (100% of inflow)

Center-of-Mass det. time= 97.6 min ( 889.4 - 791.8 )

Volume	Invert	Avail.Storage	Storage Description
#1	892.00'	24,073 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 7 Rows adjusted for 394.8 cf perimeter wall
#2	897.00'	24,052 cf	<b>retain_it retain_it 5.0' x 84</b> Inside= 84.0"W x 60.0"H => 36.41 sf x 8.00'L = 291.3 cf Outside= 96.0"W x 68.0"H => 45.33 sf x 8.00'L = 362.7 cf 6 Rows adjusted for 415.6 cf perimeter wall
		48,125 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	892.00'	<b>24.0" Round Culvert</b> L= 46.0' Ke= 0.500 Inlet / Outlet Invert= 892.00' / 890.52' S= 0.0322 ' / Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 3.14 sf
#2	Device 1	892.00'	<b>4.0" Vert. Orifice (2yr) X 2.00</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	895.40'	<b>8.0" Vert. Orifice (10yr)</b> C= 0.600 Limited to weir flow at low heads
#4	Device 1	898.20'	<b>8.0" Vert. Orifice (25yr)</b> C= 0.600 Limited to weir flow at low heads
#5	Device 1	899.90'	<b>4.0" Vert. Orifice (50yr)</b> C= 0.600 Limited to weir flow at low heads
#6	Device 1	902.00'	<b>4.0' long Sharp-Crested Weir Overflow (100yr)</b> 2 End Contraction(s)

**Primary OutFlow** Max=54.83 cfs @ 12.20 hrs HW=906.14' TW=880.48' (Dynamic Tailwater)

- 1=Culvert (Inlet Controls 54.83 cfs @ 17.45 fps)  
 2=Orifice (2yr) (Passes < 3.14 cfs potential flow)  
 3=Orifice (10yr) (Passes < 5.42 cfs potential flow)  
 4=Orifice (25yr) (Passes < 4.63 cfs potential flow)  
 5=Orifice (50yr) (Passes < 1.04 cfs potential flow)  
 6=Sharp-Crested Weir Overflow (100yr) (Passes < 87.32 cfs potential flow)

**Summary for Pond DS-2b: detention**

Inflow Area = 2.217 ac, 10.77% Impervious, Inflow Depth = 5.63" for 100-year event

Inflow = 14.14 cfs @ 12.09 hrs, Volume= 1.041 af

Outflow = 3.88 cfs @ 12.49 hrs, Volume= 1.015 af, Atten= 73%, Lag= 24.0 min

Primary = 3.88 cfs @ 12.49 hrs, Volume= 1.015 af

Routed to Link SP2 : STUDY POINT #2

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 862.67' @ 12.49 hrs Surf.Area= 5,645 sf Storage= 17,437 cf

Flood Elev= 862.70' Surf.Area= 5,645 sf Storage= 17,438 cf

Plug-Flow detention time= 98.9 min calculated for 1.013 af (97% of inflow)

Center-of-Mass det. time= 85.1 min ( 894.5 - 809.5 )

Volume	Invert	Avail.Storage	Storage Description
#1A	859.00'	0 cf	<b>88.00"W x 64.00"L x 4.17"H Field A</b> 23,467 cf Overall - 23,467 cf Embedded = 0 cf x 40.0% Voids
#2A	859.00'	17,435 cf	<b>retain_it retain_it 3.5' x 88</b> Inside #1 Inside= 84.0"W x 42.0"H => 25.10 sf x 8.00'L = 200.8 cf Outside= 96.0"W x 50.0"H => 33.33 sf x 8.00'L = 266.7 cf 11 Rows adjusted for 233.3 cf perimeter wall
#3	862.50'	9 cf	<b>4.00'D x 0.70'H Vertical Cone/Cylinder</b>
		17,444 cf	Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 163

Device	Routing	Invert	Outlet Devices
#1	Primary	858.90'	<b>12.0" Round Culvert</b> L= 30.0' Ke= 0.500 Inlet / Outlet Invert= 858.90' / 858.44' S= 0.0153 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#2	Device 1	859.20'	<b>8.0" Vert. Orifice</b> C= 0.600 Limited to weir flow at low heads
#3	Device 1	862.50'	<b>4.0' long Sharp-Crested Rectangular Weir</b> 2 End Contraction(s) 0.5' Crest Height
#4	Device 1	863.20'	<b>24.0" x 24.0" Horiz. Orifice/Grate</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=3.77 cfs @ 12.49 hrs HW=862.65' TW=0.00' (Dynamic Tailwater)

1=Culvert (Passes 3.77 cfs of 6.82 cfs potential flow)

2=Orifice (Orifice Controls 2.97 cfs @ 8.50 fps)

3=Sharp-Crested Rectangular Weir (Weir Controls 0.80 cfs @ 1.32 fps)

4=Orifice/Grate ( Controls 0.00 cfs)

**Summary for Pond DW-1: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.697 ac, 56.34% Impervious, Inflow Depth = 7.27" for 100-year event  
 Inflow = 13.33 cfs @ 12.09 hrs, Volume= 1.029 af  
 Outflow = 12.83 cfs @ 12.11 hrs, Volume= 1.002 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 9.60 hrs, Volume= 0.105 af  
 Primary = 12.78 cfs @ 12.11 hrs, Volume= 0.897 af  
 Routed to Pond dmh05 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 9.60 hrs Surf.Area= 0.031 ac Storage= 0.063 af

Plug-Flow detention time= 71.3 min calculated for 1.001 af (97% of inflow)

Center-of-Mass det. time= 56.4 min ( 835.9 - 779.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 14.00 = 0.063 af Total Available Storage			

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 9.60 hrs HW=3.50' (Free Discharge)

1=Exfiltration (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=873.63' (Dynamic Tailwater)

2=Culvert ( Controls 0.00 cfs)

**Summary for Pond DW-10: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 164

Inflow Area = 3.168 ac, 18.24% Impervious, Inflow Depth = 5.70" for 100-year event  
 Inflow = 16.51 cfs @ 12.18 hrs, Volume= 1.504 af  
 Outflow = 16.28 cfs @ 12.21 hrs, Volume= 1.493 af, Atten= 1%, Lag= 1.6 min  
 Discarded = 0.02 cfs @ 9.45 hrs, Volume= 0.042 af  
 Primary = 0.19 cfs @ 9.45 hrs, Volume= 0.229 af  
 Routed to Link SP1 : STUDY POINT #1  
 Secondary = 16.08 cfs @ 12.21 hrs, Volume= 1.221 af  
 Routed to Link SP1 : STUDY POINT #1

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Primary area = Inflow area x 0.142

Peak Elev= 3.50' @ 9.45 hrs Surf.Area= 0.013 ac Storage= 0.027 af

Plug-Flow detention time= 21.4 min calculated for 1.493 af (99% of inflow)

Center-of-Mass det. time= 16.9 min ( 834.3 - 817.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 6.00 = 0.027 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Secondary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	3.00'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 3.00' / 3.00' S= 0.0000 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.02 cfs @ 9.45 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.02 cfs)**Primary OutFlow** Max=0.19 cfs @ 9.45 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)↑**2=Culvert** (Barrel Controls 0.19 cfs @ 2.14 fps)**Secondary OutFlow** Max=0.00 cfs @ 12.21 hrs HW=3.50' TW=0.00' (Dynamic Tailwater)**Summary for Pond DW-2: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.375 ac, 77.23% Impervious, Inflow Depth = 7.88" for 100-year event  
 Inflow = 3.07 cfs @ 12.09 hrs, Volume= 0.246 af  
 Outflow = 2.96 cfs @ 12.11 hrs, Volume= 0.243 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 7.50 hrs, Volume= 0.016 af  
 Primary = 2.95 cfs @ 12.11 hrs, Volume= 0.227 af  
 Routed to Pond dmh56 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 7.50 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 47.7 min calculated for 0.242 af (98% of inflow)

Center-of-Mass det. time= 38.7 min ( 801.9 - 763.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 165

0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 7.50 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=907.28' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-3: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.657 ac, 78.20% Impervious, Inflow Depth = 7.88" for 100-year event  
Inflow = 13.56 cfs @ 12.09 hrs, Volume= 1.087 af  
Outflow = 13.06 cfs @ 12.11 hrs, Volume= 1.057 af, Atten= 4%, Lag= 1.4 min  
Discarded = 0.05 cfs @ 9.05 hrs, Volume= 0.125 af  
Primary = 13.01 cfs @ 12.11 hrs, Volume= 0.932 af  
Routed to Pond dmh55 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Peak Elev= 3.50' @ 9.05 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 81.8 min calculated for 1.057 af (97% of inflow)  
Center-of-Mass det. time= 64.4 min ( 827.6 - 763.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf

0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 9.05 hrs HW=3.50' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 0.05 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=908.91' (Dynamic Tailwater)

↑**2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-4: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 166

Inflow Area = 1.417 ac, 70.76% Impervious, Inflow Depth = 7.64" for 100-year event  
 Inflow = 11.43 cfs @ 12.09 hrs, Volume= 0.902 af  
 Outflow = 11.01 cfs @ 12.11 hrs, Volume= 0.883 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.03 cfs @ 8.70 hrs, Volume= 0.078 af  
 Primary = 10.98 cfs @ 12.11 hrs, Volume= 0.805 af  
 Routed to Pond dmh53 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 8.70 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 61.3 min calculated for 0.881 af (98% of inflow)  
 Center-of-Mass det. time= 49.1 min ( 819.3 - 770.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 10.00 = 0.045 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 8.70 hrs HW=3.50' (Free Discharge)  
 ↑ **1=Exfiltration** (Exfiltration Controls 0.03 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=918.85' (Dynamic Tailwater)  
 ↑ **2=Culvert** ( Controls 0.00 cfs)

**Summary for Pond DW-5: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.  
 Storage multiplier added to account for number of dwelling units with subcatchment.  
 Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.509 ac, 43.37% Impervious, Inflow Depth = 6.79" for 100-year event  
 Inflow = 11.31 cfs @ 12.09 hrs, Volume= 0.853 af  
 Outflow = 10.88 cfs @ 12.11 hrs, Volume= 0.846 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 8.25 hrs, Volume= 0.030 af  
 Primary = 10.87 cfs @ 12.11 hrs, Volume= 0.816 af  
 Routed to Pond dmh20 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 8.25 hrs Surf.Area= 0.009 ac Storage= 0.018 af

Plug-Flow detention time= 26.1 min calculated for 0.845 af (99% of inflow)  
 Center-of-Mass det. time= 21.4 min ( 811.5 - 790.1 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 4.00 = 0.018 af Total Available Storage

Storage Group A created with Chamber Wizard



**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 167

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 8.25 hrs HW=3.50' (Free Discharge)

↑ **1=Exfiltration** (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=911.13' (Dynamic Tailwater)

↑ **2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-6: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.406 ac, 72.39% Impervious, Inflow Depth = 7.64" for 100-year event  
Inflow = 11.34 cfs @ 12.09 hrs, Volume= 0.895 af  
Outflow = 10.92 cfs @ 12.11 hrs, Volume= 0.860 af, Atten= 4%, Lag= 1.4 min  
Discarded = 0.06 cfs @ 10.10 hrs, Volume= 0.135 af  
Primary = 10.86 cfs @ 12.11 hrs, Volume= 0.725 af  
Routed to Pond dmh50 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 10.10 hrs Surf.Area= 0.040 ac Storage= 0.081 af

Plug-Flow detention time= 104.8 min calculated for 0.860 af (96% of inflow)

Center-of-Mass det. time= 82.0 min ( 852.2 - 770.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 18.00 = 0.081 af			Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.06 cfs @ 10.10 hrs HW=3.50' (Free Discharge)

↑ **1=Exfiltration** (Exfiltration Controls 0.06 cfs)

**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=931.52' (Dynamic Tailwater)

↑ **2=Culvert** ( Controls 0.00 cfs)

### Summary for Pond DW-7: House Drywell

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 168

Inflow Area = 2.354 ac, 54.62% Impervious, Inflow Depth = 7.15" for 100-year event  
 Inflow = 18.29 cfs @ 12.09 hrs, Volume= 1.403 af  
 Outflow = 17.60 cfs @ 12.11 hrs, Volume= 1.373 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.05 cfs @ 9.35 hrs, Volume= 0.120 af  
 Primary = 17.55 cfs @ 12.11 hrs, Volume= 1.253 af  
 Routed to Pond dmh21 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 9.35 hrs Surf.Area= 0.035 ac Storage= 0.072 af

Plug-Flow detention time= 61.3 min calculated for 1.373 af (98% of inflow)  
 Center-of-Mass det. time= 47.9 min ( 830.1 - 782.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 16.00 = 0.072 af Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/' Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.05 cfs @ 9.35 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.05 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=905.95' (Dynamic Tailwater)↑**2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-8: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 0.601 ac, 77.35% Impervious, Inflow Depth = 7.88" for 100-year event  
 Inflow = 4.92 cfs @ 12.09 hrs, Volume= 0.394 af  
 Outflow = 4.73 cfs @ 12.11 hrs, Volume= 0.390 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.01 cfs @ 6.40 hrs, Volume= 0.016 af  
 Primary = 4.73 cfs @ 12.11 hrs, Volume= 0.374 af  
 Routed to Pond dmh25 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
 Peak Elev= 3.50' @ 6.40 hrs Surf.Area= 0.004 ac Storage= 0.009 af

Plug-Flow detention time= 31.2 min calculated for 0.390 af (99% of inflow)  
 Center-of-Mass det. time= 25.8 min ( 789.0 - 763.2 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal Inside #1</b> Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
			0.005 af x 2.00 = 0.009 af Total Available Storage

Storage Group A created with Chamber Wizard

**2889-01 - Proposed HydroCAD**

Prepared by Allen &amp; Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 169

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.01 cfs @ 6.40 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.01 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=924.60' (Dynamic Tailwater)↑**2=Culvert** ( Controls 0.00 cfs)**Summary for Pond DW-9: House Drywell**

System sized based on standard 1,000g drywell at each dwelling unit.

Storage multiplier added to account for number of dwelling units with subcatchment.

Area multiplier adjusted to the account for the percentage of roof area within subcatchment.

Inflow Area = 1.688 ac, 56.40% Impervious, Inflow Depth = 7.27" for 100-year event  
 Inflow = 13.25 cfs @ 12.09 hrs, Volume= 1.023 af  
 Outflow = 12.76 cfs @ 12.11 hrs, Volume= 1.004 af, Atten= 4%, Lag= 1.4 min  
 Discarded = 0.03 cfs @ 8.90 hrs, Volume= 0.076 af  
 Primary = 12.72 cfs @ 12.11 hrs, Volume= 0.928 af  
 Routed to Pond dmh23 : dmh

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Peak Elev= 3.50' @ 8.90 hrs Surf.Area= 0.022 ac Storage= 0.045 af

Plug-Flow detention time= 53.0 min calculated for 1.002 af (98% of inflow)

Center-of-Mass det. time= 42.3 min ( 821.8 - 779.4 )

Volume	Invert	Avail.Storage	Storage Description
#1A	0.00'	0.002 af	<b>7.67'W x 12.50'L x 3.50'H Field A</b> 0.008 af Overall - 0.004 af Embedded = 0.004 af x 40.0% Voids
#2A	0.67'	0.003 af	<b>Shea Dry Well 1000gal</b> Inside #1 Inside= 62.0"W x 30.0"H => 12.86 sf x 10.00'L = 128.6 cf Outside= 68.0"W x 34.0"H => 15.80 sf x 10.50'L = 165.9 cf
0.005 af x 10.00 = 0.045 af			Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#0	Primary	3.50'	<b>Automatic Storage Overflow</b> (Discharged without head)
#1	Discarded	0.00'	<b>0.600 in/hr Exfiltration over Wetted area</b>
#2	Primary	2.50'	<b>4.0" Round Culvert</b> L= 10.0' Ke= 0.500 Inlet / Outlet Invert= 2.50' / 2.40' S= 0.0100 '/ Cc= 0.900 n= 0.010 PVC, smooth interior, Flow Area= 0.09 sf

**Discarded OutFlow** Max=0.03 cfs @ 8.90 hrs HW=3.50' (Free Discharge)↑**1=Exfiltration** (Exfiltration Controls 0.03 cfs)**Primary OutFlow** Max=0.00 cfs @ 12.11 hrs HW=3.50' TW=902.45' (Dynamic Tailwater)↑**2=Culvert** ( Controls 0.00 cfs)**Summary for Pond G1: gabion**

Inflow Area = 6.152 ac, 54.57% Impervious, Inflow Depth = 6.57" for 100-year event  
 Inflow = 54.83 cfs @ 12.20 hrs, Volume= 3.368 af  
 Outflow = 52.05 cfs @ 12.20 hrs, Volume= 3.368 af, Atten= 5%, Lag= 0.1 min  
 Primary = 52.05 cfs @ 12.20 hrs, Volume= 3.368 af  
 Routed to Reach R-02 : Routing through wetland/swale

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**2889-01 - Proposed HydroCAD**

Prepared by Allen & Major Associates, Inc.  
HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 170

Peak Elev= 880.48' @ 12.20 hrs Surf.Area= 2 sf Storage= 444 cf  
Flood Elev= 880.00' Surf.Area= 2 sf Storage= 444 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)  
Center-of-Mass det. time= 0.1 min ( 889.5 - 889.4 )

Volume	Invert	Avail.Storage	Storage Description
#1	877.50'	442 cf	<b>18.0" Round Pipe Storage</b> L= 250.0'
#2	879.00'	2 cf	<b>1.50'D x 1.00'H Vertical Cone/Cylinder</b>
		444 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Primary	877.50'	<b>2.0" Horiz. invert orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	878.25'	<b>2.0" Vert. spring line orifices X 125.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	880.00'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=49.34 cfs @ 12.20 hrs HW=880.41' TW=876.88' (Dynamic Tailwater)

- 1=invert orifices (Orifice Controls 22.39 cfs @ 8.21 fps)
- 2=spring line orifices (Orifice Controls 18.91 cfs @ 6.94 fps)
- 3=overflow grates (Weir Controls 8.03 cfs @ 2.09 fps)

**Summary for Pond G2: gabion**

Inflow Area = 9.878 ac, 36.50% Impervious, Inflow Depth > 5.55" for 100-year event  
Inflow = 15.09 cfs @ 12.48 hrs, Volume= 4.571 af  
Outflow = 15.10 cfs @ 12.49 hrs, Volume= 4.571 af, Atten= 0%, Lag= 0.5 min  
Primary = 15.10 cfs @ 12.49 hrs, Volume= 4.571 af  
Routed to Link SP3 : STUDY POINT #3

Routing by Dyn-Stor-Ind method, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs  
Peak Elev= 811.58' @ 12.49 hrs Surf.Area= 85 sf Storage= 128 cf  
Flood Elev= 811.80' Storage= 141 cf

Plug-Flow detention time= 0.1 min calculated for 4.564 af (100% of inflow)  
Center-of-Mass det. time= 0.1 min ( 888.1 - 888.0 )

Volume	Invert	Avail.Storage	Storage Description
#1	810.30'	141 cf	<b>18.0" Round Pipe Storage</b> L= 80.0'

Device	Routing	Invert	Outlet Devices
#1	Primary	810.30'	<b>2.0" Horiz. invert orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#2	Primary	811.05'	<b>2.0" Vert. spring line orifices X 80.00</b> C= 0.600 Limited to weir flow at low heads
#3	Primary	811.80'	<b>18.0" Horiz. overflow grates X 2.00</b> C= 0.600 Limited to weir flow at low heads

**Primary OutFlow** Max=15.10 cfs @ 12.49 hrs HW=811.58' TW=0.00' (Dynamic Tailwater)

- 1=invert orifices (Orifice Controls 9.50 cfs @ 5.44 fps)
- 2=spring line orifices (Orifice Controls 5.60 cfs @ 3.21 fps)
- 3=overflow grates ( Controls 0.00 cfs)

**Summary for Link SP1: STUDY POINT #1**

Inflow Area = 6.871 ac, 30.28% Impervious, Inflow Depth = 5.89" for 100-year event  
Inflow = 28.79 cfs @ 12.21 hrs, Volume= 3.370 af  
Primary = 28.79 cfs @ 12.21 hrs, Volume= 3.370 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

**Summary for Link SP2: STUDY POINT #2**

Inflow Area = 10.269 ac, 37.04% Impervious, Inflow Depth > 6.18" for 100-year event  
Inflow = 25.06 cfs @ 12.42 hrs, Volume= 5.288 af  
Primary = 25.06 cfs @ 12.42 hrs, Volume= 5.288 af, Atten= 0%, Lag= 0.0 min

## 2889-01 - Proposed HydroCAD

Prepared by Allen & Major Associates, Inc.

HydroCAD® 10.10-6a s/n 02881 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 100-year Rainfall=8.72"

Printed 12/14/2021

Page 171

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP3: STUDY POINT #3

Inflow Area = 11.229 ac, 32.11% Impervious, Inflow Depth > 5.77" for 100-year event  
Inflow = 25.86 cfs @ 12.47 hrs, Volume= 5.399 af  
Primary = 25.86 cfs @ 12.47 hrs, Volume= 5.399 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP4: STUDY POINT #4

Inflow Area = 0.658 ac, 9.82% Impervious, Inflow Depth = 5.70" for 100-year event  
Inflow = 4.27 cfs @ 12.09 hrs, Volume= 0.312 af  
Primary = 4.27 cfs @ 12.09 hrs, Volume= 0.312 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

### Summary for Link SP5: STUDY POINT #5

Inflow Area = 0.158 ac, 0.00% Impervious, Inflow Depth = 5.45" for 100-year event  
Inflow = 0.98 cfs @ 12.09 hrs, Volume= 0.072 af  
Primary = 0.98 cfs @ 12.09 hrs, Volume= 0.072 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs



## **Proposed Watershed Plan**





REV	DATE	DESCRIPTION
-----	------	-------------

APPLICANT:

MKEP 770 LLC  
265 SUNRISE HIGHWAY, SUITE 1368  
ROCKVILLE CENTER, NY 11570

PROJECT NO.	2889-01	DATE:	06-23-21
-------------	---------	-------	----------



THIS DRAWING HAS BEEN PREPARED IN DIGITAL FORMAT. CLIENT/CUSTOMER'S REPRESENTATIVE OR CONSULTANTS MAY BE PROVIDED COPIES OF DRAWINGS AND SPECIFICATIONS FOR HIS/HER INFORMATION AND/OR SPECIFIC USE ON THIS PROJECT. DUE TO THE POTENTIAL THAT THE PROVIDED INFORMATION MAY BE MODIFIED UNINTENTIONALLY OR OTHERWISE, ALLEN & MAJOR ASSOCIATES, INC. MAY REMOVE ALL INDICATION OF THE DOCUMENT'S AUTHORSHIP ON THE DIGITAL MEDIA. PRINTED REPRESENTATIONS OR PORTABLE DOCUMENT FORMAT OF THE DRAWINGS AND SPECIFICATIONS ISSUED SHALL BE THE ONLY RECORD COPIES OF ALLEN & MAJOR ASSOCIATES, INC.'S WORK PRODUCT.









**SECTION 6.0 -  
APPENDIX**





## Rainfall Data

# Extreme Precipitation Tables

## Northeast Regional Climate Center

Data represents point estimates calculated from partial duration series. All precipitation amounts are displayed in inches.

Smoothing	Yes
State	Massachusetts
Location	
Longitude	71.892 degrees West
Latitude	42.243 degrees North
Elevation	0 feet
Date/Time	Tue, 22 Jun 2021 15:07:34 -0400

## Extreme Precipitation Estimates

	5min	10min	15min	30min	60min	120min		1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
1yr	0.27	0.42	0.52	0.69	0.86	1.08	1yr	0.74	1.06	1.26	1.60	2.05	2.63	2.89	1yr	2.33	2.78	3.18	3.86	4.48	1yr
2yr	0.35	0.53	0.66	0.87	1.10	1.39	2yr	0.95	1.26	1.61	2.03	2.55	3.23	3.49	2yr	2.86	3.35	3.86	4.57	5.20	2yr
5yr	0.41	0.63	0.80	1.06	1.36	1.74	5yr	1.18	1.57	2.02	2.56	3.22	4.07	4.44	5yr	3.60	4.27	4.89	5.72	6.44	5yr
10yr	0.46	0.72	0.91	1.23	1.60	2.06	10yr	1.38	1.85	2.41	3.06	3.85	4.85	5.34	10yr	4.29	5.13	5.85	6.79	7.57	10yr
25yr	0.54	0.85	1.09	1.50	1.98	2.58	25yr	1.71	2.29	3.03	3.85	4.87	6.12	6.81	25yr	5.42	6.55	7.42	8.52	9.38	25yr
50yr	0.60	0.96	1.23	1.73	2.34	3.07	50yr	2.02	2.70	3.62	4.62	5.83	7.30	8.20	50yr	6.46	7.89	8.89	10.12	11.03	50yr
100yr	0.69	1.11	1.43	2.02	2.75	3.64	100yr	2.38	3.18	4.30	5.51	6.96	8.72	9.89	100yr	7.72	9.51	10.66	12.02	12.98	100yr
200yr	0.77	1.26	1.64	2.35	3.25	4.33	200yr	2.80	3.75	5.13	6.58	8.32	10.42	11.93	200yr	9.23	11.47	12.77	14.29	15.28	200yr
500yr	0.92	1.52	1.98	2.88	4.04	5.44	500yr	3.49	4.66	6.47	8.32	10.54	13.20	15.31	500yr	11.69	14.72	16.24	17.97	18.96	500yr

## Lower Confidence Limits

	5min	10min	15min	30min	60min	120min		1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
1yr	0.21	0.32	0.39	0.52	0.64	0.97	1yr	0.55	0.95	1.11	1.47	1.90	2.35	2.50	1yr	2.08	2.40	2.63	3.26	4.07	1yr
2yr	0.34	0.52	0.64	0.87	1.07	1.25	2yr	0.93	1.23	1.43	1.89	2.43	3.13	3.38	2yr	2.77	3.25	3.74	4.42	5.02	2yr
5yr	0.38	0.59	0.73	1.01	1.28	1.49	5yr	1.10	1.46	1.71	2.23	2.85	3.79	4.11	5yr	3.35	3.95	4.52	5.26	5.90	5yr
10yr	0.42	0.65	0.81	1.13	1.46	1.70	10yr	1.26	1.67	1.93	2.53	3.21	4.37	4.75	10yr	3.87	4.57	5.21	5.99	6.63	10yr
25yr	0.49	0.75	0.93	1.33	1.75	2.03	25yr	1.51	1.99	2.29	3.00	3.78	5.30	5.93	25yr	4.69	5.71	6.30	7.22	7.81	25yr
50yr	0.55	0.83	1.04	1.49	2.01	2.32	50yr	1.73	2.27	2.61	3.40	4.27	6.16	6.95	50yr	5.45	6.68	7.27	8.28	8.82	50yr
100yr	0.62	0.93	1.17	1.68	2.31	2.65	100yr	1.99	2.59	2.98	3.87	4.83	7.14	8.18	100yr	6.32	7.87	8.41	9.51	9.94	100yr
200yr	0.69	1.04	1.32	1.91	2.66	3.03	200yr	2.30	2.96	3.39	4.42	5.48	8.31	9.69	200yr	7.35	9.32	9.73	10.91	11.21	200yr
500yr	0.82	1.22	1.56	2.27	3.23	3.63	500yr	2.79	3.55	4.04	5.28	6.49	10.15	12.12	500yr	8.98	11.65	12.49	13.16	13.12	500yr

## Upper Confidence Limits

	5min	10min	15min	30min	60min	120min		1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
1yr	0.31	0.47	0.58	0.78	0.96	1.18	1yr	0.83	1.15	1.37	1.75	2.31	2.87	3.16	1yr	2.54	3.04	3.47	4.16	4.84	1yr
2yr	0.36	0.55	0.68	0.92	1.14	1.33	2yr	0.98	1.30	1.53	2.00	2.57	3.34	3.62	2yr	2.96	3.49	4.00	4.75	5.44	2yr
5yr	0.43	0.67	0.83	1.14	1.44	1.73	5yr	1.25	1.69	1.99	2.55	3.22	4.38	4.82	5yr	3.88	4.64	5.29	6.23	7.05	5yr
10yr	0.50	0.77	0.96	1.34	1.73	2.10	10yr	1.49	2.05	2.42	3.07	3.83	5.39	5.96	10yr	4.77	5.73	6.52	7.65	8.59	10yr
25yr	0.62	0.94	1.17	1.68	2.21	2.73	25yr	1.90	2.66	3.14	3.90	4.82	7.07	7.87	25yr	6.26	7.57	8.63	9.92	11.06	25yr
50yr	0.72	1.10	1.37	1.97	2.65	3.32	50yr	2.29	3.24	3.83	4.69	5.73	8.70	9.73	50yr	7.70	9.36	10.66	12.16	13.48	50yr
100yr	0.85	1.29	1.61	2.33	3.19	4.04	100yr	2.75	3.95	4.67	5.64	6.82	10.68	12.04	100yr	9.45	11.58	13.17	14.89	16.44	100yr
200yr	1.00	1.50	1.90	2.75	3.84	4.92	200yr	3.32	4.81	5.70	6.77	8.11	13.14	14.90	200yr	11.63	14.33	16.27	18.23	20.04	200yr
500yr	1.25	1.85	2.38	3.46	4.93	6.39	500yr	4.25	6.25	7.42	8.63	10.19	17.25	19.70	500yr	15.26	18.95	20.84	23.81	26.04	500yr



## Manning's Number Tables

### Manning's Roughness Coefficients ("n")

Conduit	Manning's Coefficients
<b>Closed Conduits</b>	
Asbestos-Cement Pipe	0.011 to 0.015
Brick	0.013 to 0.017
Cast Iron Pipe	
Cement-lined and seal-coated	0.011 to 0.015
Concrete (Monolithic)	
Smooth forms	0.012 to 0.014
Rough forms	0.015 to 0.017
Concrete Pipe	0.011 to 0.015
Corrugated-Metal Pipe (1/2 - STUL 34470 2 1/2-inch corrgrtn.)	
Plain	0.022 to 0.026
Paved invert	0.018 to 0.022
Spun asphalt-lined	0.011 to 0.015
Plastic Pipe (Smooth)	0.011 to 0.015
Vitrified Clay	
Pipes	0.011 to 0.015
Liner channels	0.013 to 0.017
<b>Open Channels</b>	
Lined Channels	
Asphalt	0.013 to 0.017
Brick	0.012 to 0.018
Concrete	0.011 to 0.020
Rubble or riprap	0.020 to 0.035
Vegetal	0.030 to 0.040
Excavated or Dredged	
Earth, straight and uniform	0.020 to 0.030
Earth, winding, fairly uniform	0.025 to 0.040
Rock	0.030 to 0.045
Unmaintained	0.050 to 0.140
Natural Channels (minor streams, top width at flood state < 100 feet)	
Fairly regular section	0.030 to 0.070
Irregular section with pools	0.040 to 0.100

Source: Design and Construction of Sanitary and Storm Sewers, American Society of Civil Engineers and the Water Pollution Control Federation, 1969.



## Soils Map



United States  
Department of  
Agriculture

**NRCS**

Natural  
Resources  
Conservation  
Service

A product of the National  
Cooperative Soil Survey,  
a joint effort of the United  
States Department of  
Agriculture and other  
Federal agencies, State  
agencies including the  
Agricultural Experiment  
Stations, and local  
participants

# Custom Soil Resource Report for Worcester County, Massachusetts, Southern Part





# Preface

---

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist ([http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2\\_053951](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951)).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

# Contents

---

<b>Preface</b> .....	2
<b>How Soil Surveys Are Made</b> .....	5
<b>Soil Map</b> .....	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	12
Map Unit Descriptions.....	12
Worcester County, Massachusetts, Southern Part.....	15
70B—Ridgebury fine sandy loam, 3 to 8 percent slopes.....	15
71B—Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony.....	16
73A—Whitman fine sandy loam, 0 to 3 percent slopes, extremely stony... ..	18
305B—Paxton fine sandy loam, 3 to 8 percent slopes.....	19
305C—Paxton fine sandy loam, 8 to 15 percent slopes.....	21
305D—Paxton fine sandy loam, 15 to 25 percent slopes.....	22
312B—Woodbridge fine sandy loam, 0 to 8 percent slopes, extremely stony.....	24
407C—Charlton fine sandy loam, 8 to 15 percent slopes, extremely stony.....	25
420B—Canton fine sandy loam, 3 to 8 percent slopes.....	27
651—Udorthents, smoothed.....	28
<b>Soil Information for All Uses</b> .....	30
Soil Properties and Qualities.....	30
Soil Physical Properties.....	30
Saturated Hydraulic Conductivity (Ksat).....	30
Soil Qualities and Features.....	35
Hydrologic Soil Group.....	35
<b>References</b> .....	40

# How Soil Surveys Are Made

---

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

## Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.

# Soil Map

---

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.




# Custom Soil Resource Report Soil Map





## MAP LEGEND

### Area of Interest (AOI)

 Area of Interest (AOI)

### Soils


 Soil Map Unit Polygons


 Soil Map Unit Lines


 Soil Map Unit Points

### Special Point Features

 Blowout

 Borrow Pit

 Clay Spot

 Closed Depression

 Gravel Pit

 Gravelly Spot

 Landfill

 Lava Flow

 Marsh or swamp

 Mine or Quarry

 Miscellaneous Water


 Perennial Water

 Rock Outcrop


 Saline Spot

 Sandy Spot

 Severely Eroded Spot


 Sinkhole


 Slide or Slip

 Sodic Spot

 Spoil Area

 Stony Spot


 Very Stony Spot

 Wet Spot

 Other

 Special Line Features

### Water Features

 Streams and Canals


### Transportation

 Rails


 Interstate Highways

 US Routes

 Major Roads

 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service

Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Worcester County, Massachusetts, Southern Part

Survey Area Data: Version 13, Jun 11, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Apr 8, 2011—Jul 9, 2019

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background

## MAP LEGEND

## MAP INFORMATION

imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
70B	Ridgebury fine sandy loam, 3 to 8 percent slopes	14.9	15.2%
71B	Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony	0.5	0.5%
73A	Whitman fine sandy loam, 0 to 3 percent slopes, extremely stony	0.6	0.6%
305B	Paxton fine sandy loam, 3 to 8 percent slopes	10.6	10.8%
305C	Paxton fine sandy loam, 8 to 15 percent slopes	16.6	16.9%
305D	Paxton fine sandy loam, 15 to 25 percent slopes	30.1	30.7%
312B	Woodbridge fine sandy loam, 0 to 8 percent slopes, extremely stony	8.6	8.7%
407C	Charlton fine sandy loam, 8 to 15 percent slopes, extremely stony	2.9	3.0%
420B	Canton fine sandy loam, 3 to 8 percent slopes	12.9	13.2%
651	Udorthents, smoothed	0.2	0.2%
<b>Totals for Area of Interest</b>		<b>97.9</b>	<b>100.0%</b>

## Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called

noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can

## Custom Soil Resource Report

be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

## Worcester County, Massachusetts, Southern Part

### 70B—Ridgebury fine sandy loam, 3 to 8 percent slopes

#### Map Unit Setting

*National map unit symbol:* 2xffw

*Elevation:* 0 to 1,030 feet

*Mean annual precipitation:* 36 to 71 inches

*Mean annual air temperature:* 39 to 55 degrees F

*Frost-free period:* 140 to 240 days

*Farmland classification:* Not prime farmland

#### Map Unit Composition

*Ridgebury and similar soils:* 85 percent

*Minor components:* 15 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### Description of Ridgebury

##### Setting

*Landform:* Ground moraines, depressions, drumlins, drainageways, hills

*Landform position (two-dimensional):* Toeslope, footslope

*Landform position (three-dimensional):* Head slope, base slope

*Down-slope shape:* Concave

*Across-slope shape:* Concave

*Parent material:* Coarse-loamy lodgment till derived from gneiss, granite, and/or schist

##### Typical profile

*Oe - 0 to 1 inches:* moderately decomposed plant material

*A - 1 to 6 inches:* fine sandy loam

*Bw - 6 to 10 inches:* sandy loam

*Bg - 10 to 19 inches:* gravelly sandy loam

*Cd - 19 to 66 inches:* gravelly sandy loam

##### Properties and qualities

*Slope:* 3 to 8 percent

*Depth to restrictive feature:* 15 to 35 inches to densic material

*Drainage class:* Poorly drained

*Runoff class:* Very high

*Capacity of the most limiting layer to transmit water (Ksat):* Very low to moderately low (0.00 to 0.14 in/hr)

*Depth to water table:* About 0 to 6 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)

*Available water capacity:* Low (about 3.0 inches)

##### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 4w

*Hydrologic Soil Group:* D

*Ecological site:* F144AY009CT - Wet Till Depressions

*Hydric soil rating:* Yes

## Minor Components

### Woodbridge

*Percent of map unit:* 8 percent  
*Landform:* Drumlins, hills, ground moraines  
*Landform position (two-dimensional):* Footslope, summit, backslope  
*Landform position (three-dimensional):* Crest, side slope  
*Down-slope shape:* Convex  
*Across-slope shape:* Linear  
*Hydric soil rating:* No

### Scituate

*Percent of map unit:* 4 percent  
*Landform:* Drumlins, hills, ground moraines  
*Landform position (two-dimensional):* Summit, footslope, backslope  
*Landform position (three-dimensional):* Crest, side slope  
*Down-slope shape:* Linear, convex  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

### Whitman

*Percent of map unit:* 3 percent  
*Landform:* Depressions, drainageways, hills, ground moraines, drumlins  
*Landform position (two-dimensional):* Toeslope  
*Landform position (three-dimensional):* Base slope  
*Down-slope shape:* Concave  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

## 71B—Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony

### Map Unit Setting

*National map unit symbol:* 2w69c  
*Elevation:* 0 to 1,290 feet  
*Mean annual precipitation:* 36 to 71 inches  
*Mean annual air temperature:* 39 to 55 degrees F  
*Frost-free period:* 140 to 240 days  
*Farmland classification:* Not prime farmland

### Map Unit Composition

*Ridgebury, extremely stony, and similar soils:* 80 percent  
*Minor components:* 20 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

### Description of Ridgebury, Extremely Stony

#### Setting

*Landform:* Depressions, drumlins, drainageways, hills, ground moraines  
*Landform position (two-dimensional):* Toeslope, footslope  
*Landform position (three-dimensional):* Base slope, head slope

## Custom Soil Resource Report

*Down-slope shape:* Concave

*Across-slope shape:* Concave

*Parent material:* Coarse-loamy lodgment till derived from gneiss, granite, and/or schist

### Typical profile

*Oe - 0 to 1 inches:* moderately decomposed plant material

*A - 1 to 6 inches:* fine sandy loam

*Bw - 6 to 10 inches:* sandy loam

*Bg - 10 to 19 inches:* gravelly sandy loam

*Cd - 19 to 66 inches:* gravelly sandy loam

### Properties and qualities

*Slope:* 3 to 8 percent

*Surface area covered with cobbles, stones or boulders:* 9.0 percent

*Depth to restrictive feature:* 15 to 35 inches to densic material

*Drainage class:* Poorly drained

*Runoff class:* Very high

*Capacity of the most limiting layer to transmit water (Ksat):* Very low to moderately low (0.00 to 0.14 in/hr)

*Depth to water table:* About 0 to 6 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)

*Available water capacity:* Low (about 3.0 inches)

### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 7s

*Hydrologic Soil Group:* D

*Ecological site:* F144AY009CT - Wet Till Depressions

*Hydric soil rating:* Yes

### Minor Components

#### Woodbridge, extremely stony

*Percent of map unit:* 10 percent

*Landform:* Drumlins, hills, ground moraines

*Landform position (two-dimensional):* Footslope, summit, backslope

*Landform position (three-dimensional):* Crest, side slope

*Down-slope shape:* Convex

*Across-slope shape:* Linear

*Hydric soil rating:* No

#### Whitman, extremely stony

*Percent of map unit:* 8 percent

*Landform:* Depressions

*Down-slope shape:* Concave

*Across-slope shape:* Concave

*Hydric soil rating:* Yes

#### Paxton, extremely stony

*Percent of map unit:* 2 percent

*Landform:* Drumlins, hills, ground moraines

*Landform position (two-dimensional):* Shoulder, summit, backslope

*Landform position (three-dimensional):* Crest, side slope

*Down-slope shape:* Linear, convex



## Custom Soil Resource Report

*Across-slope shape:* Convex, linear  
*Hydric soil rating:* No

### **73A—Whitman fine sandy loam, 0 to 3 percent slopes, extremely stony**

#### **Map Unit Setting**

*National map unit symbol:* 2w695  
*Elevation:* 0 to 1,580 feet  
*Mean annual precipitation:* 36 to 71 inches  
*Mean annual air temperature:* 39 to 55 degrees F  
*Frost-free period:* 140 to 240 days  
*Farmland classification:* Not prime farmland

#### **Map Unit Composition**

*Whitman, extremely stony, and similar soils:* 81 percent  
*Minor components:* 19 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### **Description of Whitman, Extremely Stony**

##### **Setting**

*Landform:* Depressions, drainageways, hills, ground moraines, drumlins  
*Landform position (two-dimensional):* Toeslope  
*Landform position (three-dimensional):* Base slope  
*Down-slope shape:* Concave  
*Across-slope shape:* Concave  
*Parent material:* Coarse-loamy lodgment till derived from gneiss, granite, and/or schist

##### **Typical profile**

*Oi - 0 to 1 inches:* peat  
*A - 1 to 10 inches:* fine sandy loam  
*Bg - 10 to 17 inches:* gravelly fine sandy loam  
*Cdg - 17 to 61 inches:* fine sandy loam

##### **Properties and qualities**

*Slope:* 0 to 3 percent  
*Surface area covered with cobbles, stones or boulders:* 9.0 percent  
*Depth to restrictive feature:* 7 to 38 inches to densic material  
*Drainage class:* Very poorly drained  
*Runoff class:* Negligible  
*Capacity of the most limiting layer to transmit water (Ksat):* Very low to moderately low (0.00 to 0.14 in/hr)  
*Depth to water table:* About 0 to 6 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* Frequent  
*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)  
*Available water capacity:* Low (about 3.0 inches)

##### **Interpretive groups**

*Land capability classification (irrigated):* None specified

## Custom Soil Resource Report

*Land capability classification (nonirrigated): 7s*  
*Hydrologic Soil Group: D*  
*Ecological site: F144AY041MA - Very Wet Till Depressions*  
*Hydric soil rating: Yes*

### Minor Components

#### **Ridgebury, extremely stony**

*Percent of map unit: 10 percent*  
*Landform: Drainageways, hills, ground moraines, depressions, drumlins*  
*Landform position (two-dimensional): Toeslope, footslope*  
*Landform position (three-dimensional): Base slope, head slope*  
*Down-slope shape: Concave*  
*Across-slope shape: Concave*  
*Hydric soil rating: Yes*

#### **Scarboro**

*Percent of map unit: 5 percent*  
*Landform: Outwash deltas, outwash terraces, depressions, drainageways*  
*Landform position (three-dimensional): Tread*  
*Down-slope shape: Concave*  
*Across-slope shape: Concave*  
*Hydric soil rating: Yes*

#### **Swansea**

*Percent of map unit: 3 percent*  
*Landform: Swamps, bogs, marshes*  
*Down-slope shape: Concave*  
*Across-slope shape: Concave*  
*Hydric soil rating: Yes*

#### **Woodbridge, extremely stony**

*Percent of map unit: 1 percent*  
*Landform: Hills, ground moraines, drumlins*  
*Landform position (two-dimensional): Backslope, footslope, summit*  
*Landform position (three-dimensional): Side slope, crest*  
*Down-slope shape: Concave*  
*Across-slope shape: Linear*  
*Hydric soil rating: No*

## **305B—Paxton fine sandy loam, 3 to 8 percent slopes**

### **Map Unit Setting**

*National map unit symbol: 2t2qp*  
*Elevation: 0 to 1,570 feet*  
*Mean annual precipitation: 36 to 71 inches*  
*Mean annual air temperature: 39 to 55 degrees F*  
*Frost-free period: 140 to 240 days*  
*Farmland classification: All areas are prime farmland*

### Map Unit Composition

*Paxton and similar soils: 80 percent*

*Minor components: 20 percent*

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### Description of Paxton

#### Setting

*Landform: Ground moraines, hills, drumlins*

*Landform position (two-dimensional): Backslope, summit, shoulder*

*Landform position (three-dimensional): Side slope, crest, nose slope*

*Down-slope shape: Linear, convex*

*Across-slope shape: Convex*

*Parent material: Coarse-loamy lodgment till derived from gneiss, granite, and/or schist*

#### Typical profile

*Ap - 0 to 8 inches: fine sandy loam*

*Bw1 - 8 to 15 inches: fine sandy loam*

*Bw2 - 15 to 26 inches: fine sandy loam*

*Cd - 26 to 65 inches: gravelly fine sandy loam*

#### Properties and qualities

*Slope: 3 to 8 percent*

*Depth to restrictive feature: 18 to 39 inches to densic material*

*Drainage class: Well drained*

*Runoff class: Medium*

*Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately low (0.00 to 0.14 in/hr)*

*Depth to water table: About 18 to 37 inches*

*Frequency of flooding: None*

*Frequency of ponding: None*

*Maximum salinity: Nonsaline (0.0 to 1.9 mmhos/cm)*

*Available water capacity: Low (about 3.1 inches)*

#### Interpretive groups

*Land capability classification (irrigated): None specified*

*Land capability classification (nonirrigated): 2s*

*Hydrologic Soil Group: C*

*Ecological site: F144AY007CT - Well Drained Dense Till Uplands*

*Hydric soil rating: No*

### Minor Components

#### Woodbridge

*Percent of map unit: 9 percent*

*Landform: Hills, drumlins, ground moraines*

*Landform position (two-dimensional): Backslope, footslope, summit*

*Landform position (three-dimensional): Side slope*

*Down-slope shape: Concave*

*Across-slope shape: Linear*

*Hydric soil rating: No*

#### Ridgebury

*Percent of map unit: 6 percent*

*Landform: Drainageways, hills, ground moraines, depressions*

## Custom Soil Resource Report

*Landform position (two-dimensional):* Backslope, footslope, toeslope

*Landform position (three-dimensional):* Head slope, base slope, dip

*Down-slope shape:* Concave

*Across-slope shape:* Concave

*Hydric soil rating:* Yes

### **Charlton**

*Percent of map unit:* 5 percent

*Landform:* Hills

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Hydric soil rating:* No

## **305C—Paxton fine sandy loam, 8 to 15 percent slopes**

### **Map Unit Setting**

*National map unit symbol:* 2w66y

*Elevation:* 0 to 1,320 feet

*Mean annual precipitation:* 36 to 71 inches

*Mean annual air temperature:* 39 to 55 degrees F

*Frost-free period:* 140 to 240 days

*Farmland classification:* Farmland of statewide importance

### **Map Unit Composition**

*Paxton and similar soils:* 85 percent

*Minor components:* 15 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### **Description of Paxton**

#### **Setting**

*Landform:* Drumlins, hills, ground moraines

*Landform position (two-dimensional):* Backslope

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Linear, convex

*Across-slope shape:* Convex

*Parent material:* Coarse-loamy lodgment till derived from gneiss, granite, and/or schist

#### **Typical profile**

*Ap - 0 to 8 inches:* fine sandy loam

*Bw1 - 8 to 15 inches:* fine sandy loam

*Bw2 - 15 to 26 inches:* fine sandy loam

*Cd - 26 to 65 inches:* gravelly fine sandy loam

#### **Properties and qualities**

*Slope:* 8 to 15 percent

*Depth to restrictive feature:* 20 to 39 inches to densic material

*Drainage class:* Well drained

*Runoff class:* Medium

## Custom Soil Resource Report

*Capacity of the most limiting layer to transmit water (Ksat):* Very low to moderately low (0.00 to 0.14 in/hr)

*Depth to water table:* About 18 to 37 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)

*Available water capacity:* Low (about 4.1 inches)

### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 3e

*Hydrologic Soil Group:* C

*Ecological site:* F144AY007CT - Well Drained Dense Till Uplands

*Hydric soil rating:* No

### Minor Components

#### Charlton

*Percent of map unit:* 7 percent

*Landform:* Hills

*Landform position (two-dimensional):* Backslope

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Convex

*Across-slope shape:* Convex

*Hydric soil rating:* No

#### Woodbridge

*Percent of map unit:* 6 percent

*Landform:* Ground moraines, drumlins, hills

*Landform position (two-dimensional):* Backslope, footslope, summit

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Concave

*Across-slope shape:* Linear

*Hydric soil rating:* No

#### Ridgebury

*Percent of map unit:* 2 percent

*Landform:* Depressions, drainageways, drumlins, hills, ground moraines

*Landform position (two-dimensional):* Toeslope, footslope

*Landform position (three-dimensional):* Base slope, head slope

*Down-slope shape:* Concave, linear

*Across-slope shape:* Concave, linear

*Hydric soil rating:* Yes

## 305D—Paxton fine sandy loam, 15 to 25 percent slopes

### Map Unit Setting

*National map unit symbol:* 2w67j

*Elevation:* 0 to 1,450 feet

*Mean annual precipitation:* 36 to 71 inches

*Mean annual air temperature:* 39 to 55 degrees F

## Custom Soil Resource Report

*Frost-free period:* 140 to 240 days

*Farmland classification:* Not prime farmland

### Map Unit Composition

*Paxton and similar soils:* 85 percent

*Minor components:* 15 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### Description of Paxton

#### Setting

*Landform:* Hills, ground moraines, drumlins

*Landform position (two-dimensional):* Backslope

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Linear, convex

*Across-slope shape:* Convex

*Parent material:* Coarse-loamy lodgment till derived from gneiss, granite, and/or schist

#### Typical profile

*Ap - 0 to 8 inches:* fine sandy loam

*Bw1 - 8 to 15 inches:* fine sandy loam

*Bw2 - 15 to 26 inches:* fine sandy loam

*Cd - 26 to 65 inches:* gravelly fine sandy loam

#### Properties and qualities

*Slope:* 15 to 25 percent

*Depth to restrictive feature:* 20 to 39 inches to densic material

*Drainage class:* Well drained

*Runoff class:* High

*Capacity of the most limiting layer to transmit water (Ksat):* Very low to moderately low (0.00 to 0.14 in/hr)

*Depth to water table:* About 18 to 37 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Maximum salinity:* Nonsaline (0.0 to 1.9 mmhos/cm)

*Available water capacity:* Low (about 4.1 inches)

#### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 4e

*Hydrologic Soil Group:* C

*Ecological site:* F144AY007CT - Well Drained Dense Till Uplands

*Hydric soil rating:* No

### Minor Components

#### Charlton

*Percent of map unit:* 8 percent

*Landform:* Hills

*Landform position (two-dimensional):* Backslope

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Convex

*Across-slope shape:* Convex

*Hydric soil rating:* No

**Woodbridge**

*Percent of map unit:* 6 percent  
*Landform:* Ground moraines, drumlins, hills  
*Landform position (two-dimensional):* Backslope  
*Landform position (three-dimensional):* Side slope  
*Down-slope shape:* Concave  
*Across-slope shape:* Linear  
*Hydric soil rating:* No

**Ridgebury**

*Percent of map unit:* 1 percent  
*Landform:* Drumlins, drainageways, hills, ground moraines, depressions  
*Landform position (two-dimensional):* Toeslope, footslope  
*Landform position (three-dimensional):* Base slope, head slope  
*Down-slope shape:* Concave, linear  
*Across-slope shape:* Concave, linear  
*Hydric soil rating:* Yes

**312B—Woodbridge fine sandy loam, 0 to 8 percent slopes, extremely stony**

**Map Unit Setting**

*National map unit symbol:* 2t2qs  
*Elevation:* 0 to 1,580 feet  
*Mean annual precipitation:* 36 to 71 inches  
*Mean annual air temperature:* 39 to 55 degrees F  
*Frost-free period:* 140 to 240 days  
*Farmland classification:* Not prime farmland

**Map Unit Composition**

*Woodbridge, extremely stony, and similar soils:* 82 percent  
*Minor components:* 18 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

**Description of Woodbridge, Extremely Stony**

**Setting**

*Landform:* Drumlins, hills, ground moraines  
*Landform position (two-dimensional):* Backslope, footslope, summit  
*Landform position (three-dimensional):* Side slope  
*Down-slope shape:* Concave  
*Across-slope shape:* Linear  
*Parent material:* Coarse-loamy lodgment till derived from gneiss, granite, and/or schist

**Typical profile**

*Oe - 0 to 2 inches:* moderately decomposed plant material  
*A - 2 to 9 inches:* fine sandy loam  
*Bw1 - 9 to 20 inches:* fine sandy loam  
*Bw2 - 20 to 32 inches:* fine sandy loam

## Custom Soil Resource Report

*Cd - 32 to 67 inches: gravelly fine sandy loam*

### Properties and qualities

*Slope: 0 to 8 percent*

*Surface area covered with cobbles, stones or boulders: 9.0 percent*

*Depth to restrictive feature: 20 to 43 inches to densic material*

*Drainage class: Moderately well drained*

*Runoff class: Medium*

*Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately low (0.00 to 0.14 in/hr)*

*Depth to water table: About 19 to 27 inches*

*Frequency of flooding: None*

*Frequency of ponding: None*

*Maximum salinity: Nonsaline (0.0 to 1.9 mmhos/cm)*

*Available water capacity: Low (about 4.0 inches)*

### Interpretive groups

*Land capability classification (irrigated): None specified*

*Land capability classification (nonirrigated): 7s*

*Hydrologic Soil Group: C/D*

*Ecological site: F144AY037MA - Moist Dense Till Uplands*

*Hydric soil rating: No*

### Minor Components

#### Paxton, extremely stony

*Percent of map unit: 10 percent*

*Landform: Drumlins, hills, ground moraines*

*Landform position (two-dimensional): Shoulder, backslope, summit*

*Landform position (three-dimensional): Crest, side slope*

*Down-slope shape: Linear, convex*

*Across-slope shape: Convex, linear*

*Hydric soil rating: No*

#### Ridgebury, extremely stony

*Percent of map unit: 8 percent*

*Landform: Ground moraines, depressions, drumlins, drainageways, hills*

*Landform position (two-dimensional): Toeslope*

*Landform position (three-dimensional): Head slope, base slope*

*Down-slope shape: Concave*

*Across-slope shape: Concave*

*Hydric soil rating: Yes*

## 407C—Charlton fine sandy loam, 8 to 15 percent slopes, extremely stony

### Map Unit Setting

*National map unit symbol: 9bd8*

*Elevation: 280 to 920 feet*

*Mean annual precipitation: 32 to 50 inches*

*Mean annual air temperature: 45 to 50 degrees F*



## Custom Soil Resource Report

*Frost-free period:* 145 to 240 days

*Farmland classification:* Not prime farmland

### Map Unit Composition

*Charlton and similar soils:* 75 percent

*Minor components:* 25 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### Description of Charlton

#### Setting

*Landform:* Hills, ridges

*Landform position (two-dimensional):* Backslope

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Linear

*Across-slope shape:* Convex

*Parent material:* Friable coarse-loamy eolian deposits over friable coarse-loamy basal till derived from granite and gneiss

#### Typical profile

*H1 - 0 to 8 inches:* fine sandy loam

*H2 - 8 to 34 inches:* fine sandy loam

*H3 - 34 to 65 inches:* sandy loam

#### Properties and qualities

*Slope:* 8 to 15 percent

*Surface area covered with cobbles, stones or boulders:* 9.0 percent

*Depth to restrictive feature:* More than 80 inches

*Drainage class:* Well drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* Moderately high to high  
(0.60 to 6.00 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Available water capacity:* Moderate (about 7.8 inches)

#### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 7s

*Hydrologic Soil Group:* A

*Ecological site:* F144AY034CT - Well Drained Till Uplands

*Hydric soil rating:* No

### Minor Components

#### Paxton

*Percent of map unit:* 10 percent

*Hydric soil rating:* No

#### Canton

*Percent of map unit:* 10 percent

*Hydric soil rating:* No

#### Woodbridge

*Percent of map unit:* 5 percent

*Hydric soil rating:* No

## **420B—Canton fine sandy loam, 3 to 8 percent slopes**

### **Map Unit Setting**

*National map unit symbol:* 2w81b

*Elevation:* 0 to 1,180 feet

*Mean annual precipitation:* 36 to 71 inches

*Mean annual air temperature:* 39 to 55 degrees F

*Frost-free period:* 140 to 240 days

*Farmland classification:* All areas are prime farmland

### **Map Unit Composition**

*Canton and similar soils:* 80 percent

*Minor components:* 20 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### **Description of Canton**

#### **Setting**

*Landform:* Moraines, hills, ridges

*Landform position (two-dimensional):* Backslope, shoulder, summit

*Landform position (three-dimensional):* Side slope, crest, nose slope

*Down-slope shape:* Linear, convex

*Across-slope shape:* Convex

*Parent material:* Coarse-loamy over sandy melt-out till derived from gneiss, granite, and/or schist

#### **Typical profile**

*Ap - 0 to 7 inches:* fine sandy loam

*Bw1 - 7 to 15 inches:* fine sandy loam

*Bw2 - 15 to 26 inches:* gravelly fine sandy loam

*2C - 26 to 65 inches:* gravelly loamy sand

#### **Properties and qualities**

*Slope:* 3 to 8 percent

*Depth to restrictive feature:* 19 to 39 inches to strongly contrasting textural stratification

*Drainage class:* Well drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* Moderately low to high (0.14 to 14.17 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Available water capacity:* Very low (about 2.7 inches)

#### **Interpretive groups**

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 2s

*Hydrologic Soil Group:* B

*Ecological site:* F144AY034CT - Well Drained Till Uplands

*Hydric soil rating:* No

**Minor Components**

**Scituate**

*Percent of map unit:* 10 percent  
*Landform:* Drumlins, hills, ground moraines  
*Landform position (two-dimensional):* Foothills, backslope, summit  
*Landform position (three-dimensional):* Crest, side slope  
*Down-slope shape:* Linear, convex  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

**Montauk**

*Percent of map unit:* 5 percent  
*Landform:* Drumlins, hills, ground moraines, moraines  
*Landform position (two-dimensional):* Backslope, shoulder, summit  
*Landform position (three-dimensional):* Side slope, crest  
*Down-slope shape:* Linear, convex  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

**Charlton**

*Percent of map unit:* 4 percent  
*Landform:* Hills, ground moraines, ridges  
*Landform position (two-dimensional):* Backslope, shoulder, summit  
*Landform position (three-dimensional):* Crest, side slope  
*Down-slope shape:* Linear, convex  
*Across-slope shape:* Convex  
*Hydric soil rating:* No

**Swansea**

*Percent of map unit:* 1 percent  
*Landform:* Marshes, kettles, swamps, bogs, depressions  
*Down-slope shape:* Concave  
*Across-slope shape:* Concave  
*Hydric soil rating:* Yes

**651—Udorthents, smoothed**

**Map Unit Setting**

*National map unit symbol:* 9bfc  
*Elevation:* 0 to 3,000 feet  
*Mean annual precipitation:* 32 to 50 inches  
*Mean annual air temperature:* 45 to 50 degrees F  
*Frost-free period:* 145 to 240 days  
*Farmland classification:* Not prime farmland

**Map Unit Composition**

*Udorthents and similar soils:* 80 percent  
*Urban land:* 20 percent

## Custom Soil Resource Report

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### **Description of Udorthents**

#### **Setting**

*Parent material:* Made land over firm coarse-loamy basal till and/or dense coarse-loamy lodgment till

#### **Typical profile**

*H1 - 0 to 6 inches:* variable

*H2 - 6 to 60 inches:* variable

#### **Properties and qualities**

*Slope:* 0 to 25 percent

*Depth to restrictive feature:* More than 80 inches

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* Moderately low to very high (0.06 to 20.00 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

#### **Interpretive groups**

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 6s

*Hydrologic Soil Group:* A

*Hydric soil rating:* No

# **Soil Information for All Uses**

---

## **Soil Properties and Qualities**

The Soil Properties and Qualities section includes various soil properties and qualities displayed as thematic maps with a summary table for the soil map units in the selected area of interest. A single value or rating for each map unit is generated by aggregating the interpretive ratings of individual map unit components. This aggregation process is defined for each property or quality.

## **Soil Physical Properties**

Soil Physical Properties are measured or inferred from direct observations in the field or laboratory. Examples of soil physical properties include percent clay, organic matter, saturated hydraulic conductivity, available water capacity, and bulk density.

### **Saturated Hydraulic Conductivity (Ksat)**

Saturated hydraulic conductivity (Ksat) refers to the ease with which pores in a saturated soil transmit water. The estimates are expressed in terms of micrometers per second. They are based on soil characteristics observed in the field, particularly structure, porosity, and texture. Saturated hydraulic conductivity is considered in the design of soil drainage systems and septic tank absorption fields.


For each soil layer, this attribute is actually recorded as three separate values in the database. A low value and a high value indicate the range of this attribute for the soil component. A "representative" value indicates the expected value of this attribute for the component. For this soil property, only the representative value is used.

The numeric Ksat values have been grouped according to standard Ksat class limits.



# Custom Soil Resource Report

## Map—Saturated Hydraulic Conductivity (Ksat)

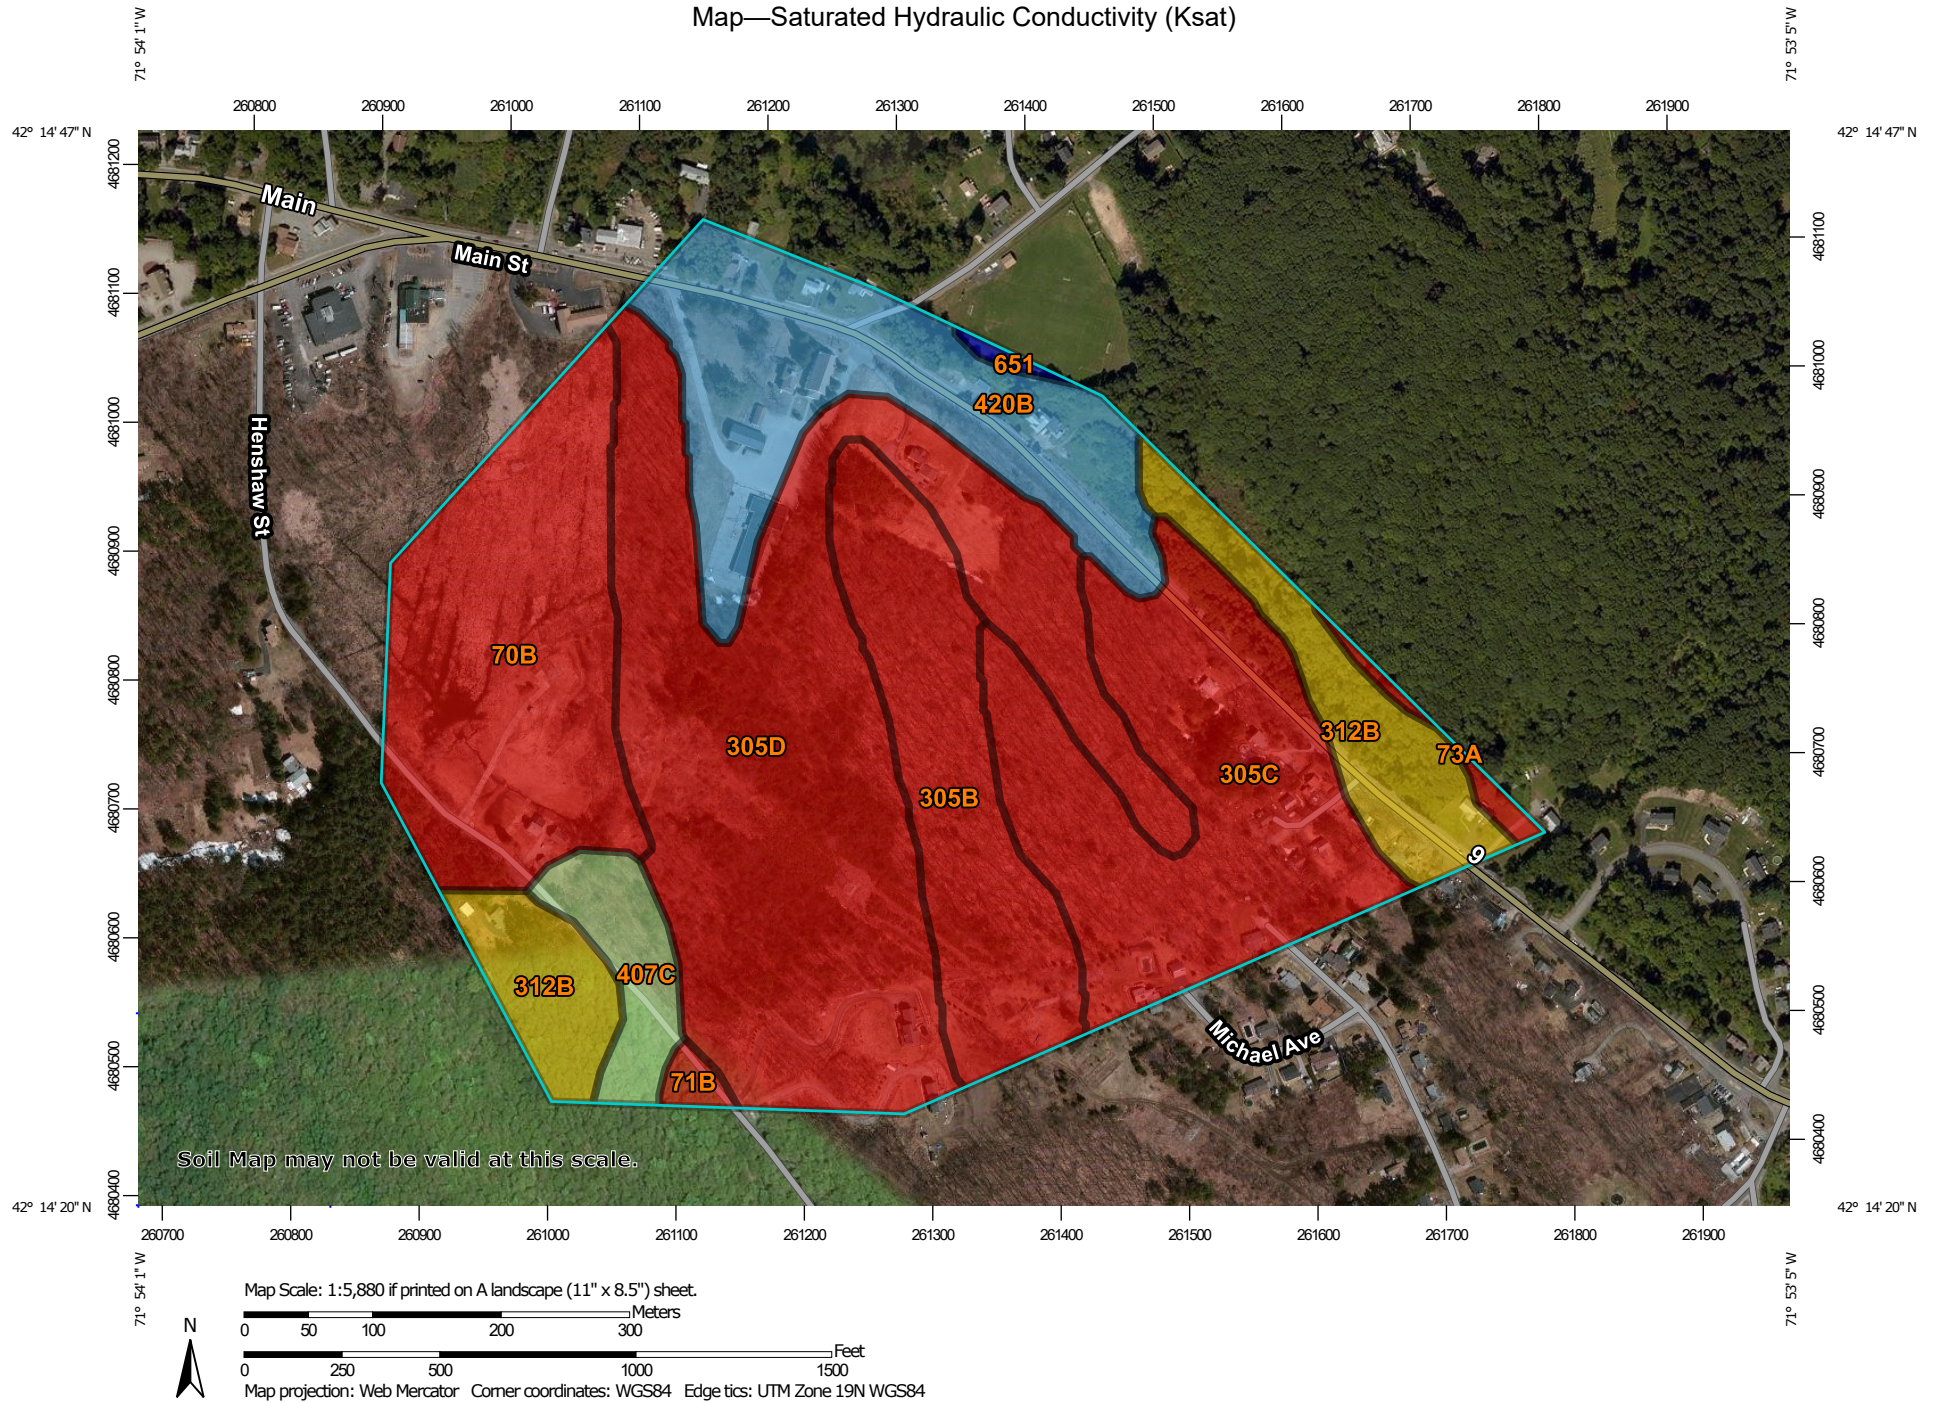







## MAP LEGEND

### Area of Interest (AOI)







 Area of Interest (AOI)

### Soils







#### Soil Rating Polygons

  $\leq 4.5628$   
  $> 4.5628$  and  $\leq 7.4641$   
  $> 7.4641$  and  $\leq 23.2900$   
  $> 23.2900$  and  $\leq 46.0000$   
  $> 46.0000$  and  $\leq 70.7800$   
 Not rated or not available


#### Soil Rating Lines

  $\leq 4.5628$   
  $> 4.5628$  and  $\leq 7.4641$   
  $> 7.4641$  and  $\leq 23.2900$   
  $> 23.2900$  and  $\leq 46.0000$   
  $> 46.0000$  and  $\leq 70.7800$   
 Not rated or not available






#### Soil Rating Points

  $\leq 4.5628$   
  $> 4.5628$  and  $\leq 7.4641$   
  $> 7.4641$  and  $\leq 23.2900$   
  $> 23.2900$  and  $\leq 46.0000$   
  $> 46.0000$  and  $\leq 70.7800$   
 Not rated or not available


### Water Features

 Streams and Canals

### Transportation

 Rails  
 Interstate Highways  
 US Routes  
 Major Roads  
 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Worcester County, Massachusetts, Southern Part  
 Survey Area Data: Version 13, Jun 11, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Apr 8, 2011—Jul 9, 2019

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background

## MAP LEGEND

## MAP INFORMATION

imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.



**Table—Saturated Hydraulic Conductivity (Ksat)**

Map unit symbol	Map unit name	Rating (micrometers per second)	Acres in AOI	Percent of AOI
70B	Ridgebury fine sandy loam, 3 to 8 percent slopes	4.5628	14.9	15.2%
71B	Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony	4.5628	0.5	0.5%
73A	Whitman fine sandy loam, 0 to 3 percent slopes, extremely stony	4.5559	0.6	0.6%
305B	Paxton fine sandy loam, 3 to 8 percent slopes	4.0600	10.6	10.8%
305C	Paxton fine sandy loam, 8 to 15 percent slopes	4.0600	16.6	16.9%
305D	Paxton fine sandy loam, 15 to 25 percent slopes	4.0600	30.1	30.7%
312B	Woodbridge fine sandy loam, 0 to 8 percent slopes, extremely stony	7.4641	8.6	8.7%
407C	Charlton fine sandy loam, 8 to 15 percent slopes, extremely stony	23.2900	2.9	3.0%
420B	Canton fine sandy loam, 3 to 8 percent slopes	46.0000	12.9	13.2%
651	Udorthents, smoothed	70.7800	0.2	0.2%
<b>Totals for Area of Interest</b>			<b>97.9</b>	<b>100.0%</b>

**Rating Options—Saturated Hydraulic Conductivity (Ksat)***Units of Measure:* micrometers per second*Aggregation Method:* Dominant Component*Component Percent Cutoff:* None Specified*Tie-break Rule:* Fastest*Interpret Nulls as Zero:* No*Layer Options (Horizon Aggregation Method):* Depth Range (Weighted Average)*Top Depth:* 0*Bottom Depth:* 100*Units of Measure:* Inches

## Soil Qualities and Features

Soil qualities are behavior and performance attributes that are not directly measured, but are inferred from observations of dynamic conditions and from soil properties. Example soil qualities include natural drainage, and frost action. Soil features are attributes that are not directly part of the soil. Example soil features include slope and depth to restrictive layer. These features can greatly impact the use and management of the soil.

## Hydrologic Soil Group

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.


Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

# Custom Soil Resource Report Map—Hydrologic Soil Group

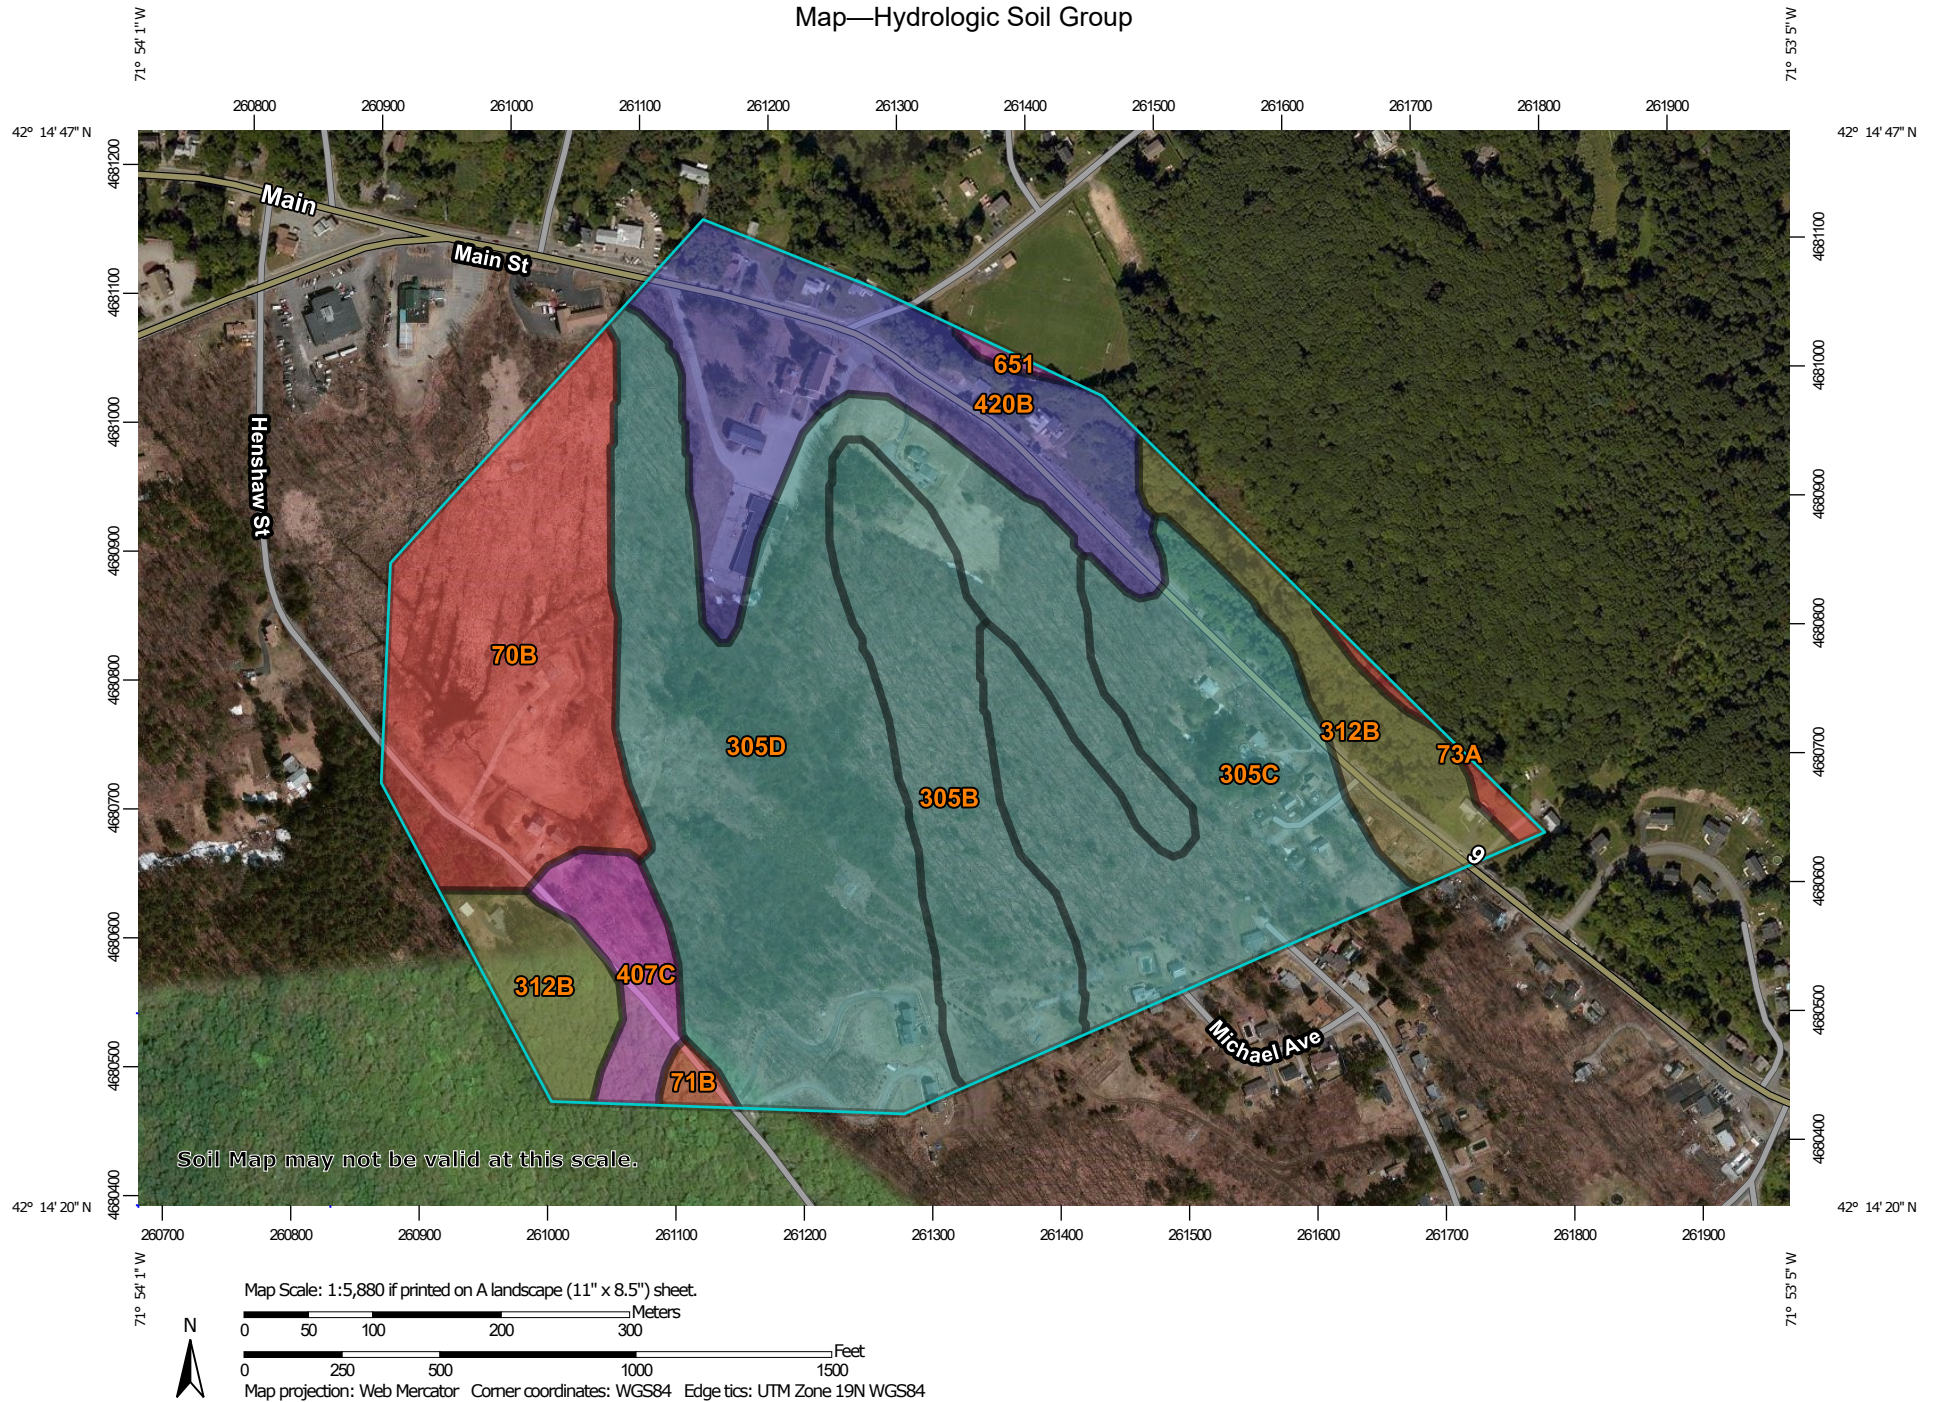

## MAP LEGEND

### Area of Interest (AOI)









 Area of Interest (AOI)

### Soils

#### Soil Rating Polygons





 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Lines


 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Points






 A  
 A/D  
 B  
 B/D

 C  
 C/D  
 D  
 Not rated or not available

### Water Features

 Streams and Canals

### Transportation

 Rails  
 Interstate Highways  
 US Routes  
 Major Roads  
 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Worcester County, Massachusetts, Southern Part  
 Survey Area Data: Version 13, Jun 11, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Apr 8, 2011—Jul 9, 2019

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background

## MAP LEGEND

## MAP INFORMATION

imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.



**Table—Hydrologic Soil Group**

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
70B	Ridgebury fine sandy loam, 3 to 8 percent slopes	D	14.9	15.2%
71B	Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony	D	0.5	0.5%
73A	Whitman fine sandy loam, 0 to 3 percent slopes, extremely stony	D	0.6	0.6%
305B	Paxton fine sandy loam, 3 to 8 percent slopes	C	10.6	10.8%
305C	Paxton fine sandy loam, 8 to 15 percent slopes	C	16.6	16.9%
305D	Paxton fine sandy loam, 15 to 25 percent slopes	C	30.1	30.7%
312B	Woodbridge fine sandy loam, 0 to 8 percent slopes, extremely stony	C/D	8.6	8.7%
407C	Charlton fine sandy loam, 8 to 15 percent slopes, extremely stony	A	2.9	3.0%
420B	Canton fine sandy loam, 3 to 8 percent slopes	B	12.9	13.2%
651	Udorthents, smoothed	A	0.2	0.2%
<b>Totals for Area of Interest</b>			<b>97.9</b>	<b>100.0%</b>

**Rating Options—Hydrologic Soil Group***Aggregation Method: Dominant Condition**Component Percent Cutoff: None Specified**Tie-break Rule: Higher*

# References

---

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_054262](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262)
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053577](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577)
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053580](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580)
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2\\_053374](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374)
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

## Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2\\_054242](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242)

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053624](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624)

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. [http://www.nrcs.usda.gov/Internet/FSE\\_DOCUMENTS/nrcs142p2\\_052290.pdf](http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf)





## Water Quality Flow Calculations

**Project:** Skyview Estates Residential Subdivision  
**Location:** Leicester, MA  
**Prepared For:** Allen & Major Associates



**Purpose:** To calculate the water quality flow rate (WQF) over a given site area. In this situation the WQF is derived from the first 1" of runoff from the contributing impervious surface.

**Reference:** Massachusetts Dept. of Environmental Protection Wetlands Program / United States Department of Agriculture Natural Resources Conservation Service TR-55 Manual

**Procedure:** Determine unit peak discharge using Figure 1 or 2. Figure 2 is in tabular form so is preferred. Using the  $t_c$ , read the unit peak discharge ( $q_u$ ) from Figure 1 or Table in Figure 2.  $q_u$  is expressed in the following units: cfs/mi<sup>2</sup>/watershed inches (csm/in).

Compute Q Rate using the following equation:

$$Q = (q_u) (A) (WQV)$$

where:

Q = flow rate associated with first 1" of runoff

$q_u$  = the unit peak discharge, in csm/in.

A = impervious surface drainage area (in square miles)

WQV = water quality volume in watershed inches (1" in this case)

Structure Name	Impv. (acres)	A (miles <sup>2</sup> )	$t_c$ (min)	$t_c$ (hr)	WQV (in)	$q_u$ (csm/in.)	Q (cfs)
CB-21A	0.42	0.0006484	6.0	0.100	1.00	774.00	0.50
CB-22A	0.36	0.0005625	6.0	0.100	1.00	774.00	0.44
CB-22B	0.23	0.0003641	6.0	0.100	1.00	774.00	0.28
CB-23A	0.24	0.0003703	6.0	0.100	1.00	774.00	0.29
CB-23B	0.19	0.0002953	6.0	0.100	1.00	774.00	0.23
CB-24A	0.43	0.0006781	6.0	0.100	1.00	774.00	0.52
CB-24B	0.23	0.0003656	6.0	0.100	1.00	774.00	0.28
CB-26	0.39	0.0006047	6.0	0.100	1.00	774.00	0.47

**Project:** Skyview Estates Residential Subdivision  
**Location:** Leicester, MA  
**Prepared For:** Allen & Major Associates



**Purpose:** To calculate the water quality flow rate (WQF) over a given site area. In this situation the WQF is derived from the first 1" of runoff from the contributing impervious surface.

**Reference:** Massachusetts Dept. of Environmental Protection Wetlands Program / United States Department of Agriculture Natural Resources Conservation Service TR-55 Manual

**Procedure:** Determine unit peak discharge using Figure 1 or 2. Figure 2 is in tabular form so is preferred. Using the  $t_c$ , read the unit peak discharge ( $q_u$ ) from Figure 1 or Table in Figure 2.  $q_u$  is expressed in the following units: cfs/mi<sup>2</sup>/watershed inches (csm/in).

Compute Q Rate using the following equation:

$$Q = (q_u) (A) (WQV)$$

where:

Q = flow rate associated with first 1" of runoff

$q_u$  = the unit peak discharge, in csm/in.

A = impervious surface drainage area (in square miles)

WQV = water quality volume in watershed inches (1" in this case)

Structure Name	Impv. (acres)	A (miles <sup>2</sup> )	$t_c$ (min)	$t_c$ (hr)	WQV (in)	$q_u$ (csm/in.)	Q (cfs)
DMH-02	0.70	0.0010969	6.0	0.100	1.00	774.00	0.85
DMH-05	0.35	0.0005422	6.0	0.100	1.00	774.00	0.42
DMH-06	0.26	0.0004016	6.0	0.100	1.00	774.00	0.31
DMH-11	0.34	0.0005281	6.0	0.100	1.00	774.00	0.41
DMH-20	0.60	0.0009406	6.0	0.100	1.00	774.00	0.73
DMH-30	1.10	0.0017172	6.0	0.100	1.00	774.00	1.33



## WQU Sizing

**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD**

**SKYVIEW ESTATES RESIDENTIAL SUBDIVISION  
LEICESTER, MA**

Area **0.42 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **2015-4**

Unit Site Designation **CB-21A**  
Rainfall Station # **70**

CDS Treatment Capacity **1.4 cfs**

<u>Rainfall Intensity<sup>1</sup> (in/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (cfs)</u>	<u>Treated Flowrate (cfs)</u>	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.6
0.08	24.6%	39.7%	0.03	0.03	23.5
0.12	13.7%	53.4%	0.04	0.04	13.0
0.16	9.4%	62.8%	0.06	0.06	8.9
0.20	6.6%	69.5%	0.07	0.07	6.2
0.24	5.2%	74.7%	0.09	0.09	4.9
0.28	4.8%	79.5%	0.10	0.10	4.4
0.32	3.1%	82.6%	0.12	0.12	2.9
0.36	2.7%	85.3%	0.13	0.13	2.5
0.40	2.1%	87.4%	0.15	0.15	1.9
0.48	2.5%	89.9%	0.18	0.18	2.2
0.56	2.0%	91.9%	0.21	0.21	1.8
0.64	1.4%	93.3%	0.24	0.24	1.2
0.72	1.0%	94.3%	0.27	0.27	0.8
0.80	1.1%	95.4%	0.30	0.30	0.9
1.00	1.6%	97.1%	0.37	0.37	1.3
1.20	0.9%	98.0%	0.45	0.45	0.7
1.40	0.6%	98.6%	0.52	0.52	0.4
1.60	0.5%	99.1%	0.60	0.60	0.3
1.80	0.5%	99.6%	0.67	0.67	0.3
0.00	0.0%	99.6%	0.00	0.00	0.0
					92.7
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>92.7%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

# CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION BASED ON THE RATIONAL RAINFALL METHOD

## SKYVIEW ESTATES RESIDENTIAL SUBDIVISION LEICESTER, MA

Area **0.36 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **1515-3**

Unit Site Designation **CB-22A**  
Rainfall Station # **70**

CDS Treatment Capacity **1.0 cfs**

<u>Rainfall Intensity<sup>1</sup></u> (in/hr)	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> (cfs)	<u>Treated Flowrate</u> (cfs)	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.6
0.08	24.6%	39.7%	0.03	0.03	23.5
0.12	13.7%	53.4%	0.04	0.04	13.0
0.16	9.4%	62.8%	0.05	0.05	8.8
0.20	6.6%	69.5%	0.06	0.06	6.2
0.24	5.2%	74.7%	0.08	0.08	4.8
0.28	4.8%	79.5%	0.09	0.09	4.4
0.32	3.1%	82.6%	0.10	0.10	2.8
0.36	2.7%	85.3%	0.12	0.12	2.4
0.40	2.1%	87.4%	0.13	0.13	1.9
0.48	2.5%	89.9%	0.16	0.16	2.1
0.56	2.0%	91.9%	0.18	0.18	1.7
0.64	1.4%	93.3%	0.21	0.21	1.2
0.72	1.0%	94.3%	0.23	0.23	0.8
0.80	1.1%	95.4%	0.26	0.26	0.9
1.00	1.6%	97.1%	0.32	0.32	1.2
1.20	0.9%	98.0%	0.39	0.39	0.7
1.40	0.6%	98.6%	0.45	0.45	0.4
1.60	0.5%	99.1%	0.52	0.52	0.3
1.80	0.5%	99.6%	0.58	0.58	0.3
0.00	0.0%	99.6%	0.00	0.00	0.0
					91.8
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>91.8%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD**

**SKYVIEW ESTATES RESIDENTIAL SUBDIVISION  
LEICESTER, MA**

Area **0.23 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **1515-3**

Unit Site Designation **CB-22B**  
Rainfall Station # **70**

CDS Treatment Capacity **1.0 cfs**

<u>Rainfall Intensity<sup>1</sup></u> (in/hr)	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> (cfs)	<u>Treated Flowrate</u> (cfs)	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.6
0.08	24.6%	39.7%	0.02	0.02	23.6
0.12	13.7%	53.4%	0.03	0.03	13.1
0.16	9.4%	62.8%	0.03	0.03	8.9
0.20	6.6%	69.5%	0.04	0.04	6.3
0.24	5.2%	74.7%	0.05	0.05	4.9
0.28	4.8%	79.5%	0.06	0.06	4.5
0.32	3.1%	82.6%	0.07	0.07	2.9
0.36	2.7%	85.3%	0.08	0.08	2.5
0.40	2.1%	87.4%	0.08	0.08	1.9
0.48	2.5%	89.9%	0.10	0.10	2.2
0.56	2.0%	91.9%	0.12	0.12	1.8
0.64	1.4%	93.3%	0.13	0.13	1.3
0.72	1.0%	94.3%	0.15	0.15	0.9
0.80	1.1%	95.4%	0.17	0.17	0.9
1.00	1.6%	97.1%	0.21	0.21	1.4
1.20	0.9%	98.0%	0.25	0.25	0.7
1.40	0.6%	98.6%	0.29	0.29	0.5
1.60	0.5%	99.1%	0.34	0.34	0.4
1.80	0.5%	99.6%	0.38	0.38	0.3
0.00	0.0%	99.6%	0.00	0.00	0.0
					93.6
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>93.6%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD**

**SKYVIEW ESTATES RESIDENTIAL SUBDIVISION  
LEICESTER, MA**

Area **0.24 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **1515-3**

Unit Site Designation **CB-23A**  
Rainfall Station # **70**

CDS Treatment Capacity **1.0 cfs**

<u>Rainfall Intensity<sup>1</sup> (in/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (cfs)</u>	<u>Treated Flowrate (cfs)</u>	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.6
0.08	24.6%	39.7%	0.02	0.02	23.6
0.12	13.7%	53.4%	0.03	0.03	13.1
0.16	9.4%	62.8%	0.03	0.03	8.9
0.20	6.6%	69.5%	0.04	0.04	6.3
0.24	5.2%	74.7%	0.05	0.05	4.9
0.28	4.8%	79.5%	0.06	0.06	4.5
0.32	3.1%	82.6%	0.07	0.07	2.9
0.36	2.7%	85.3%	0.08	0.08	2.5
0.40	2.1%	87.4%	0.09	0.09	1.9
0.48	2.5%	89.9%	0.10	0.10	2.2
0.56	2.0%	91.9%	0.12	0.12	1.8
0.64	1.4%	93.3%	0.14	0.14	1.3
0.72	1.0%	94.3%	0.15	0.15	0.9
0.80	1.1%	95.4%	0.17	0.17	0.9
1.00	1.6%	97.1%	0.21	0.21	1.4
1.20	0.9%	98.0%	0.26	0.26	0.7
1.40	0.6%	98.6%	0.30	0.30	0.5
1.60	0.5%	99.1%	0.34	0.34	0.4
1.80	0.5%	99.6%	0.38	0.38	0.3
0.00	0.0%	99.6%	0.00	0.00	0.0
					93.5
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>93.5%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.



# CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION BASED ON THE RATIONAL RAINFALL METHOD

## SKYVIEW ESTATES RESIDENTIAL SUBDIVISION LEICESTER, MA

Area **0.43 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **1515-3**

Unit Site Designation **CB-24A**  
Rainfall Station # **70**

CDS Treatment Capacity **1.0 cfs**

<u>Rainfall Intensity<sup>1</sup></u> (in/hr)	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> (cfs)	<u>Treated Flowrate</u> (cfs)	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.02	0.02	14.6
0.08	24.6%	39.7%	0.03	0.03	23.4
0.12	13.7%	53.4%	0.05	0.05	12.9
0.16	9.4%	62.8%	0.06	0.06	8.7
0.20	6.6%	69.5%	0.08	0.08	6.1
0.24	5.2%	74.7%	0.09	0.09	4.8
0.28	4.8%	79.5%	0.11	0.11	4.3
0.32	3.1%	82.6%	0.12	0.12	2.8
0.36	2.7%	85.3%	0.14	0.14	2.4
0.40	2.1%	87.4%	0.16	0.16	1.8
0.48	2.5%	89.9%	0.19	0.19	2.1
0.56	2.0%	91.9%	0.22	0.22	1.7
0.64	1.4%	93.3%	0.25	0.25	1.1
0.72	1.0%	94.3%	0.28	0.28	0.8
0.80	1.1%	95.4%	0.31	0.31	0.8
1.00	1.6%	97.1%	0.39	0.39	1.2
1.20	0.9%	98.0%	0.47	0.47	0.6
1.40	0.6%	98.6%	0.55	0.55	0.4
1.60	0.5%	99.1%	0.62	0.62	0.3
1.80	0.5%	99.6%	0.70	0.70	0.2
0.00	0.0%	99.6%	0.00	0.00	0.0
					90.8
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>90.8%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD**

**SKYVIEW ESTATES RESIDENTIAL SUBDIVISION  
LEICESTER, MA**

Area **0.23 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **1515-3**

Unit Site Designation **CB-24B**  
Rainfall Station # **70**

CDS Treatment Capacity **1.0 cfs**

<u>Rainfall Intensity<sup>1</sup> (in/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (cfs)</u>	<u>Treated Flowrate (cfs)</u>	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.6
0.08	24.6%	39.7%	0.02	0.02	23.6
0.12	13.7%	53.4%	0.03	0.03	13.1
0.16	9.4%	62.8%	0.03	0.03	8.9
0.20	6.6%	69.5%	0.04	0.04	6.3
0.24	5.2%	74.7%	0.05	0.05	4.9
0.28	4.8%	79.5%	0.06	0.06	4.5
0.32	3.1%	82.6%	0.07	0.07	2.9
0.36	2.7%	85.3%	0.08	0.08	2.5
0.40	2.1%	87.4%	0.08	0.08	1.9
0.48	2.5%	89.9%	0.10	0.10	2.2
0.56	2.0%	91.9%	0.12	0.12	1.8
0.64	1.4%	93.3%	0.13	0.13	1.3
0.72	1.0%	94.3%	0.15	0.15	0.9
0.80	1.1%	95.4%	0.17	0.17	0.9
1.00	1.6%	97.1%	0.21	0.21	1.4
1.20	0.9%	98.0%	0.25	0.25	0.7
1.40	0.6%	98.6%	0.29	0.29	0.5
1.60	0.5%	99.1%	0.34	0.34	0.4
1.80	0.5%	99.6%	0.38	0.38	0.3
0.00	0.0%	99.6%	0.00	0.00	0.0
					93.6
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>93.6%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD**

**SKYVIEW ESTATES RESIDENTIAL SUBDIVISION  
LEICESTER, MA**

Area **0.19 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **1515-3**

Unit Site Designation **CB-23B**  
Rainfall Station # **70**

CDS Treatment Capacity **1.0 cfs**

<u>Rainfall Intensity<sup>1</sup></u> (in/hr)	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> (cfs)	<u>Treated Flowrate</u> (cfs)	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.7
0.08	24.6%	39.7%	0.01	0.01	23.7
0.12	13.7%	53.4%	0.02	0.02	13.1
0.16	9.4%	62.8%	0.03	0.03	9.0
0.20	6.6%	69.5%	0.03	0.03	6.3
0.24	5.2%	74.7%	0.04	0.04	4.9
0.28	4.8%	79.5%	0.05	0.05	4.5
0.32	3.1%	82.6%	0.05	0.05	2.9
0.36	2.7%	85.3%	0.06	0.06	2.5
0.40	2.1%	87.4%	0.07	0.07	1.9
0.48	2.5%	89.9%	0.08	0.08	2.3
0.56	2.0%	91.9%	0.10	0.10	1.8
0.64	1.4%	93.3%	0.11	0.11	1.3
0.72	1.0%	94.3%	0.12	0.12	0.9
0.80	1.1%	95.4%	0.14	0.14	0.9
1.00	1.6%	97.1%	0.17	0.17	1.4
1.20	0.9%	98.0%	0.20	0.20	0.8
1.40	0.6%	98.6%	0.24	0.24	0.5
1.60	0.5%	99.1%	0.27	0.27	0.4
1.80	0.5%	99.6%	0.31	0.31	0.4
0.00	0.0%	99.6%	0.00	0.00	0.0
					94.2
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>94.2%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

# CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION BASED ON THE RATIONAL RAINFALL METHOD

## SKYVIEW ESTATES RESIDENTIAL SUBDIVISION LEICESTER, MA

Area **0.39 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **2015-4**

Unit Site Designation **CB-26**  
Rainfall Station # **70**

CDS Treatment Capacity **1.4 cfs**

<u>Rainfall Intensity<sup>1</sup></u> (in/hr)	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate</u> (cfs)	<u>Treated Flowrate</u> (cfs)	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.6
0.08	24.6%	39.7%	0.03	0.03	23.6
0.12	13.7%	53.4%	0.04	0.04	13.0
0.16	9.4%	62.8%	0.06	0.06	8.9
0.20	6.6%	69.5%	0.07	0.07	6.2
0.24	5.2%	74.7%	0.08	0.08	4.9
0.28	4.8%	79.5%	0.10	0.10	4.4
0.32	3.1%	82.6%	0.11	0.11	2.9
0.36	2.7%	85.3%	0.13	0.13	2.5
0.40	2.1%	87.4%	0.14	0.14	1.9
0.48	2.5%	89.9%	0.17	0.17	2.2
0.56	2.0%	91.9%	0.20	0.20	1.8
0.64	1.4%	93.3%	0.22	0.22	1.2
0.72	1.0%	94.3%	0.25	0.25	0.9
0.80	1.1%	95.4%	0.28	0.28	0.9
1.00	1.6%	97.1%	0.35	0.35	1.3
1.20	0.9%	98.0%	0.42	0.42	0.7
1.40	0.6%	98.6%	0.49	0.49	0.4
1.60	0.5%	99.1%	0.56	0.56	0.3
1.80	0.5%	99.6%	0.63	0.63	0.3
0.00	0.0%	99.6%	0.00	0.00	0.0
					93.0
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>93.0%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

# **CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION BASED ON THE RATIONAL RAINFALL METHOD**

## **SKYVIEW ESTATES RESIDENTIAL SUBDIVISION LEICESTER, MA**

Area **0.70 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **2015-4**

Unit Site Designation **DMH-02**  
Rainfall Station # **70**

CDS Treatment Capacity **1.4 cfs**

<u>Rainfall Intensity<sup>1</sup> (in/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (cfs)</u>	<u>Treated Flowrate (cfs)</u>	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.03	0.03	14.5
0.08	24.6%	39.7%	0.05	0.05	23.3
0.12	13.7%	53.4%	0.08	0.08	12.8
0.16	9.4%	62.8%	0.10	0.10	8.7
0.20	6.6%	69.5%	0.13	0.13	6.0
0.24	5.2%	74.7%	0.15	0.15	4.7
0.28	4.8%	79.5%	0.18	0.18	4.2
0.32	3.1%	82.6%	0.20	0.20	2.7
0.36	2.7%	85.3%	0.23	0.23	2.3
0.40	2.1%	87.4%	0.25	0.25	1.8
0.48	2.5%	89.9%	0.30	0.30	2.0
0.56	2.0%	91.9%	0.35	0.35	1.6
0.64	1.4%	93.3%	0.40	0.40	1.1
0.72	1.0%	94.3%	0.45	0.45	0.8
0.80	1.1%	95.4%	0.51	0.51	0.8
1.00	1.6%	97.1%	0.63	0.63	1.1
1.20	0.9%	98.0%	0.76	0.76	0.6
1.40	0.6%	98.6%	0.88	0.88	0.3
1.60	0.5%	99.1%	1.01	1.01	0.2
1.80	0.5%	99.6%	1.14	1.14	0.2
0.00	0.0%	99.6%	0.00	0.00	0.0
					89.9
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>89.9%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD**

**SKYVIEW ESTATES RESIDENTIAL SUBDIVISION  
LEICESTER, MA**

Area **0.35 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **1515-3**

Unit Site Designation **DMH-05**  
Rainfall Station # **70**

CDS Treatment Capacity **1.0 cfs**

<u>Rainfall Intensity<sup>1</sup> (in/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (cfs)</u>	<u>Treated Flowrate (cfs)</u>	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.6
0.08	24.6%	39.7%	0.02	0.02	23.5
0.12	13.7%	53.4%	0.04	0.04	13.0
0.16	9.4%	62.8%	0.05	0.05	8.8
0.20	6.6%	69.5%	0.06	0.06	6.2
0.24	5.2%	74.7%	0.07	0.07	4.8
0.28	4.8%	79.5%	0.09	0.09	4.4
0.32	3.1%	82.6%	0.10	0.10	2.8
0.36	2.7%	85.3%	0.11	0.11	2.4
0.40	2.1%	87.4%	0.12	0.12	1.9
0.48	2.5%	89.9%	0.15	0.15	2.1
0.56	2.0%	91.9%	0.17	0.17	1.7
0.64	1.4%	93.3%	0.20	0.20	1.2
0.72	1.0%	94.3%	0.22	0.22	0.8
0.80	1.1%	95.4%	0.25	0.25	0.9
1.00	1.6%	97.1%	0.31	0.31	1.3
1.20	0.9%	98.0%	0.37	0.37	0.7
1.40	0.6%	98.6%	0.44	0.44	0.4
1.60	0.5%	99.1%	0.50	0.50	0.3
1.80	0.5%	99.6%	0.56	0.56	0.3
0.00	0.0%	99.6%	0.00	0.00	0.0
					92.0
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>92.0%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

# **CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION BASED ON THE RATIONAL RAINFALL METHOD**

## **SKYVIEW ESTATES RESIDENTIAL SUBDIVISION LEICESTER, MA**

Area **0.26 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **1515-3**

Unit Site Designation **DMH-06**  
Rainfall Station # **70**

CDS Treatment Capacity **1.0 cfs**

<u>Rainfall Intensity<sup>1</sup> (in/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (cfs)</u>	<u>Treated Flowrate (cfs)</u>	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.6
0.08	24.6%	39.7%	0.02	0.02	23.6
0.12	13.7%	53.4%	0.03	0.03	13.1
0.16	9.4%	62.8%	0.04	0.04	8.9
0.20	6.6%	69.5%	0.05	0.05	6.2
0.24	5.2%	74.7%	0.06	0.06	4.9
0.28	4.8%	79.5%	0.06	0.06	4.4
0.32	3.1%	82.6%	0.07	0.07	2.9
0.36	2.7%	85.3%	0.08	0.08	2.5
0.40	2.1%	87.4%	0.09	0.09	1.9
0.48	2.5%	89.9%	0.11	0.11	2.2
0.56	2.0%	91.9%	0.13	0.13	1.8
0.64	1.4%	93.3%	0.15	0.15	1.2
0.72	1.0%	94.3%	0.17	0.17	0.9
0.80	1.1%	95.4%	0.19	0.19	0.9
1.00	1.6%	97.1%	0.23	0.23	1.3
1.20	0.9%	98.0%	0.28	0.28	0.7
1.40	0.6%	98.6%	0.32	0.32	0.5
1.60	0.5%	99.1%	0.37	0.37	0.4
1.80	0.5%	99.6%	0.42	0.42	0.3
0.00	0.0%	99.6%	0.00	0.00	0.0
					93.2
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>93.2%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

# **CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION BASED ON THE RATIONAL RAINFALL METHOD**

## **SKYVIEW ESTATES RESIDENTIAL SUBDIVISION LEICESTER, MA**

Area **0.34 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **1515-3**

Unit Site Designation **DMH-11**  
Rainfall Station # **70**

CDS Treatment Capacity **1.0 cfs**

<u>Rainfall Intensity<sup>1</sup> (in/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (cfs)</u>	<u>Treated Flowrate (cfs)</u>	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.01	0.01	14.6
0.08	24.6%	39.7%	0.02	0.02	23.5
0.12	13.7%	53.4%	0.04	0.04	13.0
0.16	9.4%	62.8%	0.05	0.05	8.8
0.20	6.6%	69.5%	0.06	0.06	6.2
0.24	5.2%	74.7%	0.07	0.07	4.8
0.28	4.8%	79.5%	0.09	0.09	4.4
0.32	3.1%	82.6%	0.10	0.10	2.8
0.36	2.7%	85.3%	0.11	0.11	2.4
0.40	2.1%	87.4%	0.12	0.12	1.9
0.48	2.5%	89.9%	0.15	0.15	2.2
0.56	2.0%	91.9%	0.17	0.17	1.7
0.64	1.4%	93.3%	0.19	0.19	1.2
0.72	1.0%	94.3%	0.22	0.22	0.8
0.80	1.1%	95.4%	0.24	0.24	0.9
1.00	1.6%	97.1%	0.30	0.30	1.3
1.20	0.9%	98.0%	0.37	0.37	0.7
1.40	0.6%	98.6%	0.43	0.43	0.4
1.60	0.5%	99.1%	0.49	0.49	0.3
1.80	0.5%	99.6%	0.55	0.55	0.3
0.00	0.0%	99.6%	0.00	0.00	0.0
					92.1
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>92.1%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.



**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION  
BASED ON THE RATIONAL RAINFALL METHOD**

**SKYVIEW ESTATES RESIDENTIAL SUBDIVISION  
LEICESTER, MA**

Area **0.60 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **2015-4**

Unit Site Designation **DMH-20**  
Rainfall Station # **70**

CDS Treatment Capacity **1.4 cfs**

<u>Rainfall Intensity<sup>1</sup> (in/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (cfs)</u>	<u>Treated Flowrate (cfs)</u>	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.02	0.02	14.6
0.08	24.6%	39.7%	0.04	0.04	23.4
0.12	13.7%	53.4%	0.07	0.07	12.9
0.16	9.4%	62.8%	0.09	0.09	8.8
0.20	6.6%	69.5%	0.11	0.11	6.1
0.24	5.2%	74.7%	0.13	0.13	4.8
0.28	4.8%	79.5%	0.15	0.15	4.3
0.32	3.1%	82.6%	0.17	0.17	2.8
0.36	2.7%	85.3%	0.20	0.20	2.4
0.40	2.1%	87.4%	0.22	0.22	1.8
0.48	2.5%	89.9%	0.26	0.26	2.1
0.56	2.0%	91.9%	0.30	0.30	1.7
0.64	1.4%	93.3%	0.35	0.35	1.1
0.72	1.0%	94.3%	0.39	0.39	0.8
0.80	1.1%	95.4%	0.43	0.43	0.8
1.00	1.6%	97.1%	0.54	0.54	1.2
1.20	0.9%	98.0%	0.65	0.65	0.6
1.40	0.6%	98.6%	0.76	0.76	0.4
1.60	0.5%	99.1%	0.87	0.87	0.3
1.80	0.5%	99.6%	0.98	0.98	0.2
0.00	0.0%	99.6%	0.00	0.00	0.0
					90.9
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.6%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>90.9%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.

# **CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION BASED ON THE RATIONAL RAINFALL METHOD**

## **SKYVIEW ESTATES RESIDENTIAL SUBDIVISION LEICESTER, MA**

Area **1.10 ac**  
Weighted C **0.9**  
 $t_c$  **6 min**  
CDS Model **2015-5**

Unit Site Designation **DMH-30**  
Rainfall Station # **70**

CDS Treatment Capacity **1.4 cfs**

<u>Rainfall Intensity<sup>1</sup> (in/hr)</u>	<u>Percent Rainfall Volume<sup>1</sup></u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (cfs)</u>	<u>Treated Flowrate (cfs)</u>	<u>Incremental Removal (%)</u>
0.04	15.1%	15.1%	0.04	0.04	14.4
0.08	24.6%	39.7%	0.08	0.08	22.9
0.12	13.7%	53.4%	0.12	0.12	12.5
0.16	9.4%	62.8%	0.16	0.16	8.4
0.20	6.6%	69.5%	0.20	0.20	5.8
0.24	5.2%	74.7%	0.24	0.24	4.5
0.28	4.8%	79.5%	0.28	0.28	4.0
0.32	3.1%	82.6%	0.32	0.32	2.6
0.36	2.7%	85.3%	0.36	0.36	2.2
0.40	2.1%	87.4%	0.40	0.40	1.6
0.48	2.5%	89.9%	0.47	0.47	1.8
0.56	2.0%	91.9%	0.55	0.55	1.4
0.64	1.4%	93.3%	0.63	0.63	0.9
0.72	1.0%	94.3%	0.71	0.71	0.6
0.80	1.1%	95.4%	0.79	0.79	0.6
1.00	1.6%	97.1%	0.99	0.99	0.8
1.20	0.9%	98.0%	1.19	1.19	0.4
1.40	0.6%	98.6%	1.38	1.38	0.2
1.60	0.5%	99.1%	1.58	1.40	0.1
1.80	0.5%	99.6%	1.78	1.40	0.1
0.00	0.0%	99.6%	0.00	0.00	0.0
					86.0
Removal Efficiency Adjustment <sup>2</sup> =					0.0%
Predicted % Annual Rainfall Treated =					99.4%
<b>Predicted Net Annual Load Removal Efficiency =</b>					<b>86.0%</b>

1 - Based on 14 years of 15-minute rainfall data from NCDC Station 2107, East Brimfield Lake, Worcester County, MA

2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.



## Stormwater Pipe Sizing Calculation





## DRAINAGE PIPE DESIGN ANALYSIS

Manning's Formula

$$V = 1.486/n \cdot R^{2/3} \cdot S^{1/2}$$

$$Q = V \cdot A$$

(25-Year storm)

Where: V is the velocity in Ft/sec.

n is Manning's coefficient of friction

R is the Hydraulic Radius

S is the slope of the pipe

Where: Area =  $\pi \cdot (R/12)^2$

Wetted Perimeter =  $2 \cdot \pi \cdot R/12$

A&M Job No. 2889-01

Date: 12/14/2021

Project Location:

Skyview Estates

Main Street

Leicester, MA

Prepared For:

MKEP 770 LLC

265 Sunrise Highway, Suite 1368

Rockville Center, NY 11570

Start	Q <sub>design</sub> (cfs)	n	Diameter (inches)	A (ft <sup>2</sup> )	Wp (ft)	R (ft)	S (feet/foot)	Q <sub>full</sub> (cfs)	Q <sub>full</sub> ≥ Q <sub>design</sub>	V <sub>full</sub> (ft/s)	Q <sub>d</sub> /Q <sub>f</sub>	Results Fig. 4-4A	V <sub>design</sub> (ft/s)	2 ft/s ≤ V <sub>design</sub> ≤ 10 ft/s
1P	8.76	0.013	24	3.14	6.28	0.50	0.010	22.62	OK	7.20	0.39	0.91	6.55	OK
DB-1	11.63	0.013	18	1.77	4.71	0.38	0.022	15.55	OK	8.80	0.75	1.10	9.68	OK
dmh01	1.90	0.013	12	0.79	3.14	0.25	0.010	3.56	OK	4.54	0.53	1.01	4.58	OK
dmh05	8.51	0.013	15	1.23	3.93	0.31	0.035	12.10	OK	9.86	0.70	1.08	10.65	WAIVER REQUESTED
dmh20	7.04	0.013	15	1.23	3.93	0.31	0.012	7.05	OK	5.74	1.00	1.15	6.60	OK
dmh21	18.65	0.013	24	3.14	6.28	0.50	0.010	22.62	OK	7.20	0.82	1.12	8.07	OK
dmh23	27.13	0.013	30	4.91	7.85	0.63	0.013	46.77	OK	9.53	0.58	1.03	9.81	OK
dmh25	3.25	0.013	12	0.79	3.14	0.25	0.070	9.41	OK	11.98	0.35	0.89	10.66	WAIVER REQUESTED
dmh31	1.27	0.013	12	0.79	3.14	0.25	0.080	10.10	OK	12.85	0.13	0.64	8.23	OK
dmh33	1.99	0.013	15	1.23	3.93	0.31	0.013	7.37	OK	6.00	0.27	0.83	4.98	OK
dmh50	7.37	0.013	15	1.23	3.93	0.31	0.080	18.26	OK	14.88	0.40	0.93	13.84	WAIVER REQUESTED
dmh51	7.46	0.013	15	1.23	3.93	0.31	0.078	18.04	OK	14.70	0.41	0.94	13.82	WAIVER REQUESTED
dmh52	16.38	0.013	15	1.23	3.93	0.31	0.080	18.29	OK	14.91	0.90	1.13	16.85	WAIVER REQUESTED
dmh53	7.46	0.013	18	1.77	4.71	0.38	0.010	10.35	OK	5.85	0.72	1.09	6.38	OK
dmh55	16.38	0.013	24	3.14	6.28	0.50	0.021	32.86	OK	10.46	0.50	0.99	10.36	WAIVER REQUESTED
dmh56	18.41	0.013	24	3.14	6.28	0.50	0.010	22.05	OK	7.02	0.83	1.12	7.86	OK
dmh57	18.41	0.013	24	3.14	6.28	0.50	0.048	49.36	OK	15.71	0.37	0.89	13.98	WAIVER REQUESTED
dmh58	18.41	0.013	30	4.91	7.85	0.63	0.010	41.02	OK	8.36	0.45	0.95	7.94	OK
dmh59	18.41	0.013	30	4.91	7.85	0.63	0.010	41.22	OK	8.40	0.45	0.95	7.98	OK
dmh60	18.41	0.013	30	4.91	7.85	0.63	0.012	43.99	OK	8.96	0.42	0.94	8.42	OK
dmh61	18.41	0.013	30	4.91	7.85	0.63	0.010	41.02	OK	8.36	0.45	0.95	7.94	OK
dmh62	25.78	0.013	30	4.91	7.85	0.63	0.025	64.59	OK	13.16	0.40	0.93	12.24	WAIVER REQUESTED
dmh69	25.78	0.013	30	4.91	7.85	0.63	0.034	75.41	OK	15.36	0.34	0.88	13.52	WAIVER REQUESTED
DS-1a	4.75	0.013	15	1.23	3.93	0.31	0.012	7.05	OK	5.74	0.67	1.07	6.14	OK
DS-1b	0.56	0.013	12	0.79	3.14	0.25	0.011	3.74	OK	4.76	0.15	0.68	3.24	OK
DS-2a	8.04	0.013	24	3.14	6.28	0.50	0.032	40.59	OK	12.92	0.20	0.76	9.82	OK
DS-2b	2.07	0.013	12	0.79	3.14	0.25	0.015	4.41	OK	5.61	0.47	0.97	5.44	OK





## MADEP Calculations



Project No.	2889-01	Sheet	1
Project Description	Skyview Estates		
	Leicester, MA		
Calculated By	SM	Date	09/28/21
Checked By	MAM		

**These calculations provide the TSS removal rate of the stormwater management system for runoff directed to the open detention basin**

Stormwater Management BMP	TSS Removal rate	
Parking Lot Sweeping	5%	
Hooded Catch Basins	25%	
Proprietary Device (CDS Unit)	80%	
Average Annual Load	= 100%	
Parking Lot Sweeping	= 5%	Removal Rate
	95%	TSS Load Remains
TSS Load Remaining	= 95%	
Hooded Catch Basins	= 25%	Removal Rate
	71.3%	TSS Load Remains
TSS Load Remaining	= 71.3%	
Proprietary Device (CDS Unit)	= 80%	Removal Rate
	14.3%	% TSS Load Remains

$$\begin{array}{rclcl}
 \text{Percentage of TSS Remaining} & - & \text{Initial TSS Load} & = & \text{Final TSS Removal Rate} \\
 100\% & - & 14.3\% & = & 85.8\%
 \end{array}$$

For this drainage area, this system as designed will remove an estimated 86% of the annual TSS load and therefore will meet the TSS removal standard.





Project No.	2889-01	Sheet	2
Project Description	Skyview Estates		
	Leicester, MA		
Calculated By	SM	Date	09/28/21
Checked By	MAM		

**These calculations provide the TSS removal rate of the stormwater management system for runoff directed to the retain-it detention systems**

Stormwater Management BMP	TSS Removal rate	
Parking Lot Sweeping	5%	
Hooded Catch Basins	25%	
Retain-It Advanced Sedimentation	80%	
Average Annual Load	= 100%	
Parking Lot Sweeping	= 5%	Removal Rate
	95%	TSS Load Remains
TSS Load Remaining	= 95%	
Hooded Catch Basins	= 25%	Removal Rate
	71.3%	TSS Load Remains
TSS Load Remaining	= 71.3%	
Retain-It Advanced Sedimentation	= 80%	Removal Rate
	14.3%	% TSS Load Remains

$$\begin{array}{rclcl}
 \text{Percentage of TSS Remaining} & - & \text{Initial TSS Load} & = & \text{Final TSS Removal Rate} \\
 100\% & - & 14.3\% & = & 85.8\%
 \end{array}$$

For this drainage area, this system as designed will remove an estimated 86% of the annual TSS load and therefore will meet the TSS removal standard.



Project No.	2889-01	Sheet	1 of 1
Project Description	Skyview Estates		
	Leicester, MA		
Calculated By	JG	Date	12/14/21
Checked By	MAM		

### **Standard # 3: Groundwater Recharge**

Proposed recharge system: Dry Well

In accordance with *MADEP – Volume 2, Technical Guide for Compliance with Massachusetts Stormwater Management Standards*, dated January 2008

A soils require a Volume to recharge of	<b>0.60</b>	<b>inches</b>
B soils require a Volume to recharge of	<b>0.35</b>	<b>inches</b>
C soils require a Volume to recharge of	<b>0.25</b>	<b>inches</b>
D soils require a Volume to recharge of	<b>0.10</b>	<b>inches</b>

Impervious area within: A-soils =	0	sf	Weighted Groundwater Recharge Depth	=	<b>0.25</b>	<b>in</b>
Impervious area within: B-soils =	14,898	sf				
Impervious area within: C-soils =	401,275	sf				
Impervious area within: D-soils =	0	sf				

#### **Total Site Volume required to be recharged =**

$$416,172 \text{ sf} \times 1" / 12 \times 0.25 \text{ in} = \mathbf{8,794 \text{ cf}}$$

Site volume recharge provided by = volume within residential drywells

98 Drywells at each grouping of homes      Volume=      196

$$= \mathbf{19,208} \text{ c.f. Total Volume Recharged} > \mathbf{8,794 \text{ cf}} \quad ( \text{ OK } )$$